



SCI ENGINEERING, INC.

EARTH • SCIENCE • SOLUTIONS

GEOTECHNICAL
ENVIRONMENTAL
NATURAL RESOURCES
CULTURAL RESOURCES
CONSTRUCTION SERVICES

April 2, 2024

Michael Gegg
Mehlville School District
3120 Lemay Ferry Road
St. Louis, Missouri 63125

RE: Lead in Drinking Water Report
Oakville Elementary School
2911 Yaeger Road
St. Louis, Missouri
SCI No. 2016-0860.2T

Dear Michael Gegg:

INTRODUCTION

SCI Engineering, Inc. (SCI) is pleased to submit this report summarizing lead in drinking water sampling activities performed on January 2, 2024. The purpose of the sampling activities was to screen for elevated levels of lead in the drinking water at potable water sources throughout the above-referenced structure.

The drinking water survey is intended to satisfy the requirements for the “Get the Lead Out of School Drinking Water Act” (GTLOSDWA), Section 160.077 administered by the Missouri Department of Health and Senior Services. Potable water sources to be tested were identified by the school district prior to SCI’s field activities.

LIMITATIONS

SCI’s sampling activities were limited to locations identified by the school district. If any additional potable water sources need testing, please contact SCI, and we will make arrangements for sampling these fixtures. Potable water sources that were not sampled will need a sign placed near each fixture informing students and faculty it is not to be used as a drinking water source.

During the course of performing the drinking water sampling of the structure, SCI was unable to sample two fixtures because they were out of order. These fixtures included the water fountain near Room 101 and the ice machine in the kitchen. If these fixtures are made operational, they should be sampled or labeled non-potable. SCI was able to sample all other locations identified by the school district.

DRINKING WATER SURVEY

SCI collected “first draw” samples which consisted of collecting a water sample from each fixture or sample location after it remained stagnant for at least eight hours. Prior to sampling, SCI first mobilized

to the site to flush the identified potable water fixtures throughout the structure. Once each fixture was flushed, a sign was placed on the fixture indicating it should not be used. SCI then revisited the site, after a minimum of eight hours, to collect water samples from the fixtures.

SCI collected 33 drinking water samples (OES-1 through OES-33) from various water fixtures located throughout the structure and submitted them for analytical testing. The drinking water samples were analyzed for total lead by U.S. EPA Method 200.8. SCI collected a minimum of 250 milliliters of water from each location. Sampled water was containerized in laboratory-provided sample containers and shipped to the lab using standard chain-of-custody procedures. A figure depicting the locations of the sampled water fixtures is enclosed.

The drinking water samples were analyzed for lead in accordance with the GTLOSDWA, Section 160.077, which establishes an action level (AL) of 5 parts per billion (ppb). During the course of SCI's sampling, no drinking water samples exceeded the AL. A copy of the analytical test results and chain-of-custody for all samples is enclosed.

CONCLUSION AND REPORTING

As previously mentioned, no drinking water samples exceeded the AL of 5 ppb. Therefore, all tested fixtures are compliant per GTLOSDWA and should be tested every five years.

Within seven business days after receiving this report, the school district shall contact parents and staff via written notification which shall include the following:

- The test results and a summary that explains such results;
- A description of any remedial steps taken;
- A description of general health effects of lead contamination and community specific resources; and
- If there is not enough water to meet the drinking water needs of the students, teachers, and staff, bottled water shall be provided.

Additionally, within two weeks of receiving this report, the results and any lead remediation plans must be made available on the school's website.

This report, and subsequent annual testing reports, must be submitted to the Missouri Department of Health and Senior Services, Healthy Drinking Water Unit, PO Box 570, Jefferson City, MO 65102-0570.

Respectfully,

SCI ENGINEERING, INC.



Brian L. Lieb
Project Scientist




Jessica B. Keeven, CHMM
Senior Scientist

BLL/JBK/bms

Enclosure

Lead Drinking Water Sampling Plan
Lead Testing Results

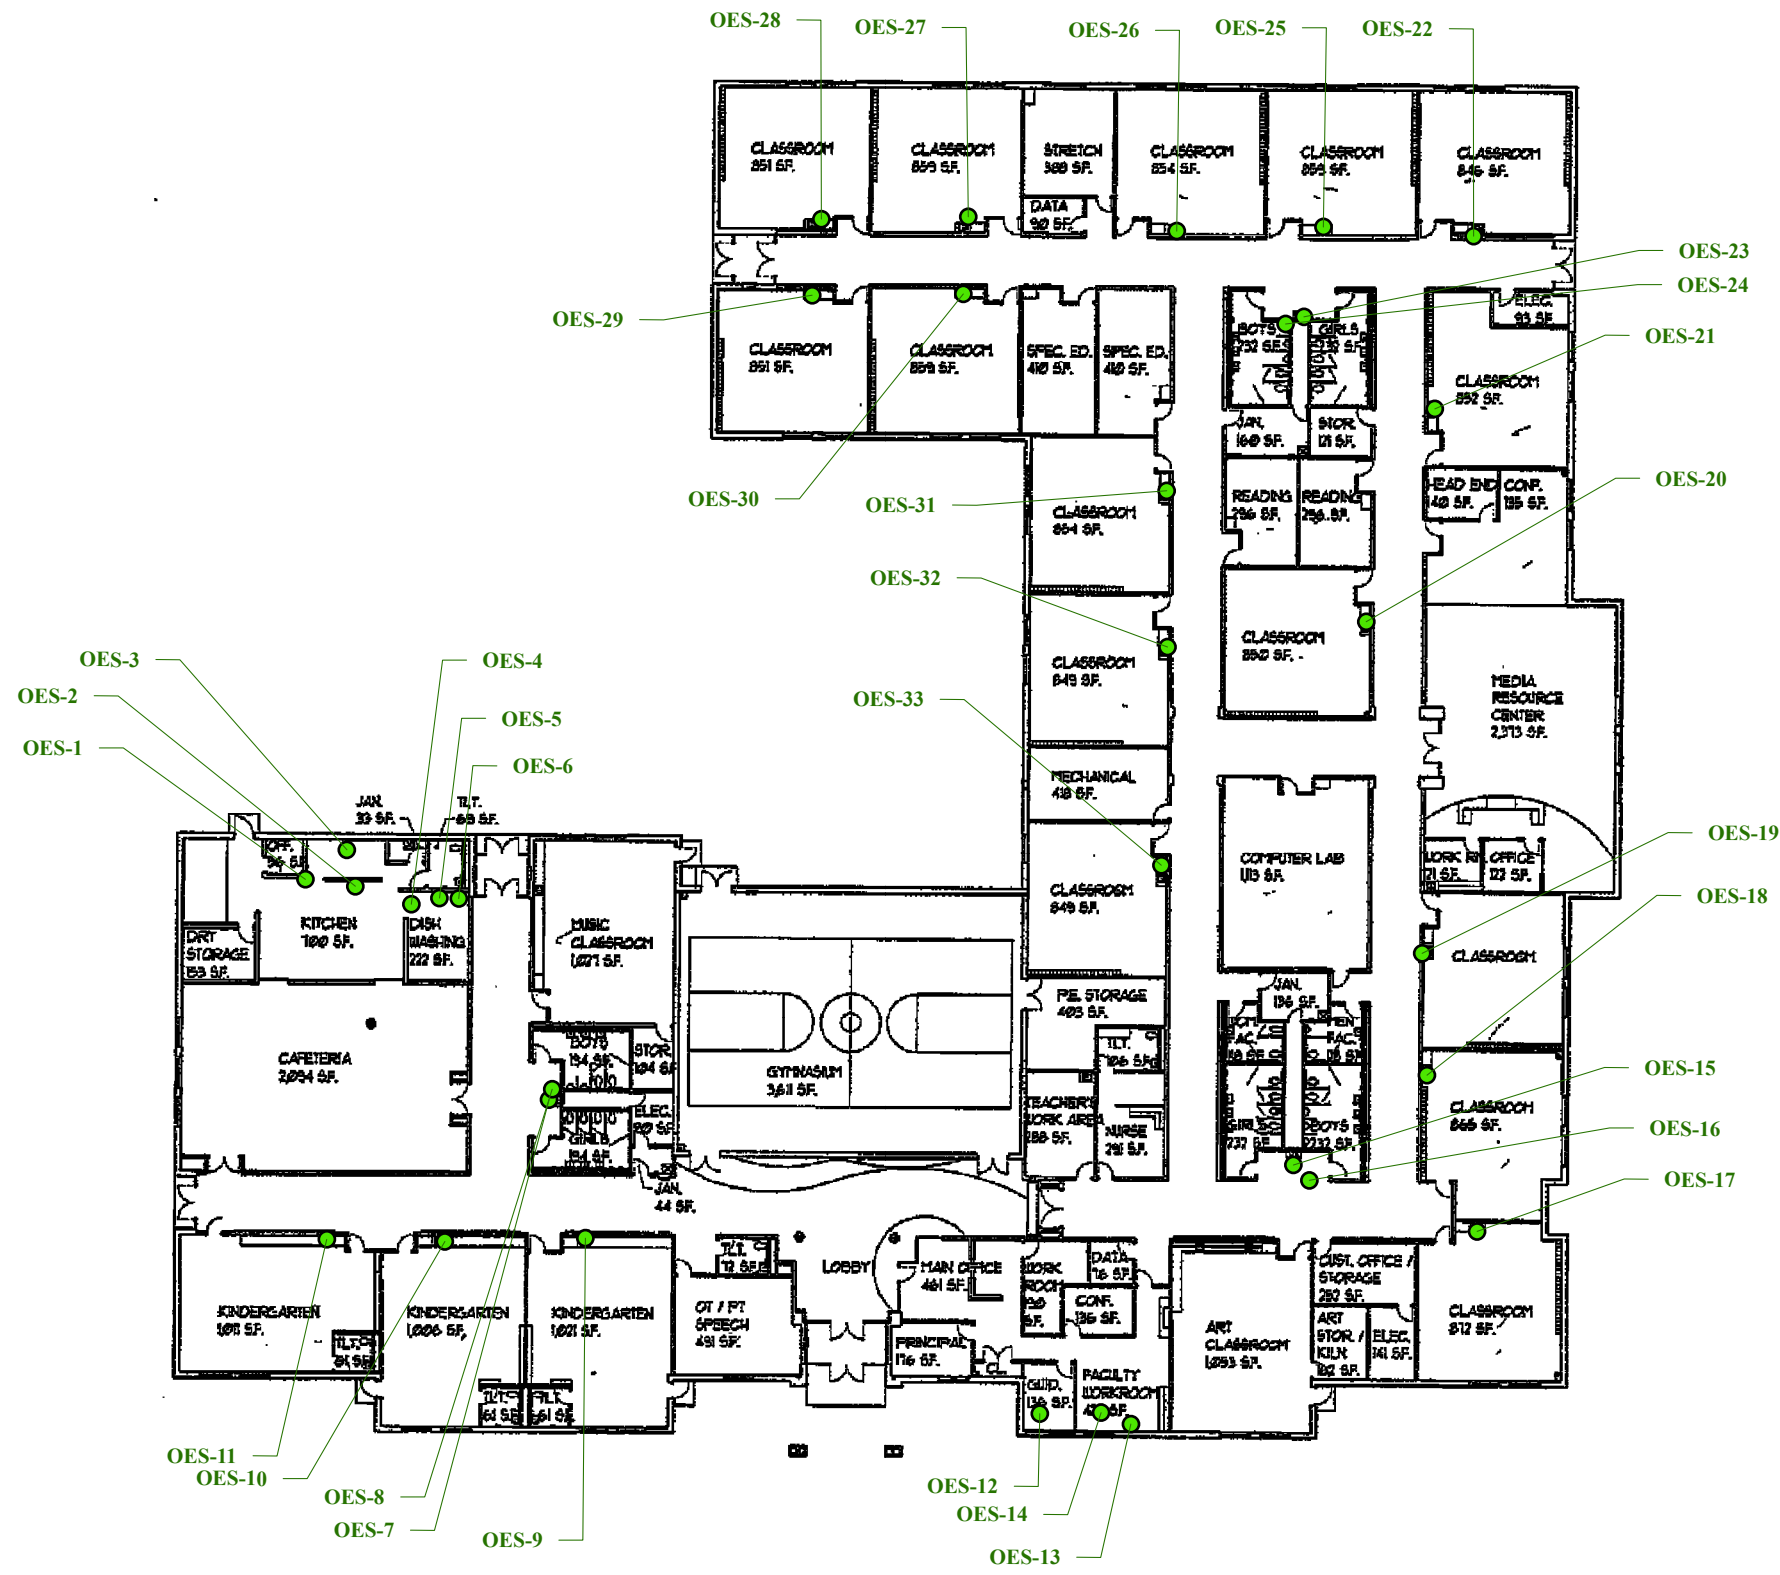


GENERAL NOTES/LEGEND


- RESULTS LESS THAN THE ACTION LEVEL OF 5 PARTS PER BILLION
- FLOOR PLANS PROVIDED BY MEHLVILLE SCHOOL DISTRICT. DIMENSIONS AND LOCATIONS ARE APPROXIMATE; ACTUAL MAY VARY. DRAWING SHALL NOT BE USED OUTSIDE THE CONTEXT OF THE REPORT FOR WHICH IT WAS GENERATED.

PROJECT NAME
 MEHLVILLE SCHOOL DISTRICT
 OAKVILLE ELEMENTARY SCHOOL
 ST. LOUIS, MISSOURI

LEAD DRINKING WATER SAMPLING PLAN



JOB NUMBER	2016-0860.2T
FIGURE DATE	02/27/2024
DRAWN BY	JTM
CHECKED BY	BLL
FIGURE	1





Pace Analytical Services, LLC

2231 W. Altorfer Drive

Peoria, IL 61615

(800)752-6651

January 22, 2024

Glenn Grissom
SCI Engineering
130 Point W. Blvd.
St. Chariles, MO 63301

RE: 2016-0860.2T Oakville Elem

Dear Glenn Grissom:

Please find enclosed the analytical results for the **33** sample(s) the laboratory received on **1/4/24 4:30 pm** and logged in under work order **HA00869**. All testing is performed according to our current TNI accreditations unless otherwise noted. This report cannot be reproduced, except in full, without the written permission of Pace Analytical Services, LLC.

If you have any questions regarding your report, please contact your project manager. Quality and timely data is of the utmost importance to us.

Pace Analytical Services appreciates the opportunity to provide you with analytical expertise. We are always trying to improve our customer service and we welcome you to contact the General Manager, Lisa Grant, with any feedback you have about your experience with our laboratory at 309-683-1764 or lisa.grant@pacelabs.com.

A handwritten signature in black ink, appearing to read "Chenise Lambert-Sykes".

Chenise Lambert-Sykes
Project Manager
(314)432-0550
Chenise.Lambert-Sykes@pacelabs.com



SAMPLE RECEIPT CHECK LIST

Items not applicable will be marked as in compliance

Work Order HA00869

YES	Samples received within temperature compliance when applicable
YES	COC present upon sample receipt
YES	COC completed & legible
YES	Sampler name & signature present
YES	Unique sample IDs assigned
YES	Sample collection location recorded
YES	Date & time collected recorded on COC
YES	Relinquished by client signature on COC
YES	COC & labels match
YES	Sample labels are legible
YES	Appropriate bottle(s) received
YES	Sufficient sample volume received
YES	Sample containers received undamaged
NO	Zero headspace, <6 mm present in VOA vials
NO	Trip blank(s) received
YES	All non-field analyses received within holding times
NO	Short hold time analysis
YES	Current PDC COC submitted
NO	Case narrative provided



ANALYTICAL RESULTS

Sample: HA00869-01
Name: OES-1
Alias: OAKVILLE ELEM

Sampled: 01/02/24 17:14
Received: 01/04/24 16:30
Matrix: Drinking Water - Regular Sample

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
Total Metals - PIA									
Lead	< 1.00	ug/L		01/19/24 12:47	1	1.00	01/19/24 19:43	wjm	EPA 200.8 REV 5.4

Sample: HA00869-02
Name: OES-2
Alias: OAKVILLE ELEM

Sampled: 01/02/24 17:16
Received: 01/04/24 16:30
Matrix: Drinking Water - Regular Sample

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
Total Metals - PIA									
Lead	1.53	ug/L		01/19/24 12:47	1	1.00	01/19/24 19:44	wjm	EPA 200.8 REV 5.4

Sample: HA00869-03
Name: OES-3
Alias: OAKVILLE ELEM

Sampled: 01/02/24 17:17
Received: 01/04/24 16:30
Matrix: Drinking Water - Regular Sample

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
Total Metals - PIA									
Lead	< 1.00	ug/L		01/19/24 12:47	1	1.00	01/19/24 19:46	wjm	EPA 200.8 REV 5.4

Sample: HA00869-04
Name: OES-4
Alias: OAKVILLE ELEM

Sampled: 01/02/24 17:19
Received: 01/04/24 16:30
Matrix: Drinking Water - Regular Sample

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
Total Metals - PIA									
Lead	< 1.00	ug/L		01/19/24 12:47	1	1.00	01/19/24 19:51	wjm	EPA 200.8 REV 5.4



ANALYTICAL RESULTS

Sample: HA00869-05
Name: OES-5
Alias: OAKVILLE ELEM

Sampled: 01/02/24 17:20
Received: 01/04/24 16:30
Matrix: Drinking Water - Regular Sample

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
Total Metals - PIA									
Lead	< 1.00	ug/L		01/19/24 12:47	1	1.00	01/19/24 19:52	wjm	EPA 200.8 REV 5.4

Sample: HA00869-06
Name: OES-6
Alias: OAKVILLE ELEM

Sampled: 01/02/24 17:20
Received: 01/04/24 16:30
Matrix: Drinking Water - Regular Sample

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
Total Metals - PIA									
Lead	< 1.00	ug/L		01/19/24 12:47	1	1.00	01/19/24 19:57	wjm	EPA 200.8 REV 5.4

Sample: HA00869-07
Name: OES-7
Alias: OAKVILLE ELEM

Sampled: 01/02/24 17:24
Received: 01/04/24 16:30
Matrix: Drinking Water - Regular Sample

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
Total Metals - PIA									
Lead	< 1.00	ug/L		01/19/24 12:47	1	1.00	01/19/24 19:59	wjm	EPA 200.8 REV 5.4

Sample: HA00869-08
Name: OES-8
Alias: OAKVILLE ELEM

Sampled: 01/02/24 17:24
Received: 01/04/24 16:30
Matrix: Drinking Water - Regular Sample

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
Total Metals - PIA									
Lead	< 1.00	ug/L		01/19/24 12:47	1	1.00	01/19/24 20:00	wjm	EPA 200.8 REV 5.4



ANALYTICAL RESULTS

Sample: HA00869-09
Name: OES-9
Alias: OAKVILLE ELEM

Sampled: 01/02/24 17:26
Received: 01/04/24 16:30
Matrix: Drinking Water - Regular Sample

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, < 1.00, ug/L, 01/19/24 12:47, 1, 1.00, 01/19/24 20:02, wjm, EPA 200.8 REV 5.4

Sample: HA00869-10
Name: OES-10
Alias: OAKVILLE ELEM

Sampled: 01/02/24 17:28
Received: 01/04/24 16:30
Matrix: Drinking Water - Regular Sample

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, < 1.00, ug/L, 01/19/24 12:47, 1, 1.00, 01/19/24 20:03, wjm, EPA 200.8 REV 5.4

Sample: HA00869-11
Name: OES-11
Alias: OAKVILLE ELEM

Sampled: 01/02/24 17:29
Received: 01/04/24 16:30
Matrix: Drinking Water - Regular Sample

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, < 1.00, ug/L, 01/19/24 12:47, 1, 1.00, 01/19/24 20:05, wjm, EPA 200.8 REV 5.4

Sample: HA00869-12
Name: OES-12
Alias: OAKVILLE ELEM

Sampled: 01/02/24 17:32
Received: 01/04/24 16:30
Matrix: Drinking Water - Regular Sample

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, < 1.00, ug/L, 01/19/24 12:47, 1, 1.00, 01/19/24 20:06, wjm, EPA 200.8 REV 5.4



ANALYTICAL RESULTS

Sample: HA00869-13
Name: OES-13
Alias: OAKVILLE ELEM

Sampled: 01/02/24 17:33
Received: 01/04/24 16:30
Matrix: Drinking Water - Regular Sample

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, < 1.00, ug/L, 01/19/24 12:47, 1, 1.00, 01/19/24 20:08, wjm, EPA 200.8 REV 5.4

Sample: HA00869-14
Name: OES-14
Alias: OAKVILLE ELEM

Sampled: 01/02/24 17:34
Received: 01/04/24 16:30
Matrix: Drinking Water - Regular Sample

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, < 1.00, ug/L, 01/19/24 12:47, 1, 1.00, 01/20/24 12:55, BRS, EPA 200.8 REV 5.4

Sample: HA00869-15
Name: OES-15
Alias: OAKVILLE ELEM

Sampled: 01/02/24 17:37
Received: 01/04/24 16:30
Matrix: Drinking Water - Regular Sample

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, < 1.00, ug/L, 01/19/24 12:47, 1, 1.00, 01/20/24 12:56, BRS, EPA 200.8 REV 5.4

Sample: HA00869-16
Name: OES-16
Alias: OAKVILLE ELEM

Sampled: 01/02/24 17:37
Received: 01/04/24 16:30
Matrix: Drinking Water - Regular Sample

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, < 1.00, ug/L, 01/20/24 07:33, 1, 1.00, 01/20/24 09:21, BRS, EPA 200.8 REV 5.4



ANALYTICAL RESULTS

Sample: HA00869-17
Name: OES-17
Alias: OAKVILLE ELEM

Sampled: 01/02/24 17:40
Received: 01/04/24 16:30
Matrix: Drinking Water - Regular Sample

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, < 1.00, ug/L, 01/20/24 07:33, 1, 1.00, 01/20/24 09:23, BRS, EPA 200.8 REV 5.4

Sample: HA00869-18
Name: OES-18
Alias: OAKVILLE ELEM

Sampled: 01/02/24 17:40
Received: 01/04/24 16:30
Matrix: Drinking Water - Regular Sample

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, < 1.00, ug/L, 01/20/24 07:33, 1, 1.00, 01/20/24 09:39, BRS, EPA 200.8 REV 5.4

Sample: HA00869-19
Name: OES-19
Alias: OAKVILLE ELEM

Sampled: 01/02/24 17:43
Received: 01/04/24 16:30
Matrix: Drinking Water - Regular Sample

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, < 1.00, ug/L, 01/20/24 07:33, 1, 1.00, 01/20/24 09:26, BRS, EPA 200.8 REV 5.4

Sample: HA00869-20
Name: OES-20
Alias: OAKVILLE ELEM

Sampled: 01/02/24 17:45
Received: 01/04/24 16:30
Matrix: Drinking Water - Regular Sample

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, < 1.00, ug/L, 01/20/24 07:33, 1, 1.00, 01/20/24 09:28, BRS, EPA 200.8 REV 5.4



ANALYTICAL RESULTS

Sample: HA00869-21
Name: OES-21
Alias: OAKVILLE ELEM

Sampled: 01/02/24 17:46
Received: 01/04/24 16:30
Matrix: Drinking Water - Regular Sample

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, < 1.00, ug/L, 01/20/24 07:33, 1, 1.00, 01/20/24 09:29, BRS, EPA 200.8 REV 5.4

Sample: HA00869-22
Name: OES-22
Alias: OAKVILLE ELEM

Sampled: 01/02/24 17:47
Received: 01/04/24 16:30
Matrix: Drinking Water - Regular Sample

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, < 1.00, ug/L, 01/20/24 07:33, 1, 1.00, 01/20/24 09:31, BRS, EPA 200.8 REV 5.4

Sample: HA00869-23
Name: OES-23
Alias: OAKVILLE ELEM

Sampled: 01/02/24 17:48
Received: 01/04/24 16:30
Matrix: Drinking Water - Regular Sample

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, < 1.00, ug/L, 01/20/24 07:33, 1, 1.00, 01/20/24 09:32, BRS, EPA 200.8 REV 5.4

Sample: HA00869-24
Name: OES-24
Alias: OAKVILLE ELEM

Sampled: 01/02/24 17:48
Received: 01/04/24 16:30
Matrix: Drinking Water - Regular Sample

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, < 1.00, ug/L, 01/20/24 07:33, 1, 1.00, 01/20/24 09:43, BRS, EPA 200.8 REV 5.4



ANALYTICAL RESULTS

Sample: HA00869-25
Name: OES-25
Alias: OAKVILLE ELEM

Sampled: 01/02/24 17:50
Received: 01/04/24 16:30
Matrix: Drinking Water - Regular Sample

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, < 1.00, ug/L, 01/20/24 07:33, 1, 1.00, 01/20/24 09:45, BRS, EPA 200.8 REV 5.4

Sample: HA00869-26
Name: OES-26
Alias: OAKVILLE ELEM

Sampled: 01/02/24 17:51
Received: 01/04/24 16:30
Matrix: Drinking Water - Regular Sample

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, < 1.00, ug/L, 01/20/24 07:33, 1, 1.00, 01/20/24 09:47, BRS, EPA 200.8 REV 5.4

Sample: HA00869-27
Name: OES-27
Alias: OAKVILLE ELEM

Sampled: 01/02/24 17:54
Received: 01/04/24 16:30
Matrix: Drinking Water - Regular Sample

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, < 1.00, ug/L, 01/20/24 07:33, 1, 1.00, 01/20/24 09:48, BRS, EPA 200.8 REV 5.4

Sample: HA00869-28
Name: OES-28
Alias: OAKVILLE ELEM

Sampled: 01/02/24 17:55
Received: 01/04/24 16:30
Matrix: Drinking Water - Regular Sample

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, < 1.00, ug/L, 01/20/24 07:33, 1, 1.00, 01/20/24 09:50, BRS, EPA 200.8 REV 5.4



ANALYTICAL RESULTS

Sample: HA00869-29
Name: OES-29
Alias: OAKVILLE ELEM

Sampled: 01/02/24 17:56
Received: 01/04/24 16:30
Matrix: Drinking Water - Regular Sample

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, < 1.00, ug/L, 01/20/24 07:33, 1, 1.00, 01/20/24 09:51, BRS, EPA 200.8 REV 5.4

Sample: HA00869-30
Name: OES-30
Alias: OAKVILLE ELEM

Sampled: 01/02/24 17:57
Received: 01/04/24 16:30
Matrix: Drinking Water - Regular Sample

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, < 1.00, ug/L, 01/20/24 07:33, 1, 1.00, 01/20/24 09:53, BRS, EPA 200.8 REV 5.4

Sample: HA00869-31
Name: OES-31
Alias: OAKVILLE ELEM

Sampled: 01/02/24 17:59
Received: 01/04/24 16:30
Matrix: Drinking Water - Regular Sample

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, < 1.00, ug/L, 01/20/24 07:33, 1, 1.00, 01/20/24 09:57, BRS, EPA 200.8 REV 5.4

Sample: HA00869-32
Name: OES-32
Alias: OAKVILLE ELEM

Sampled: 01/02/24 18:00
Received: 01/04/24 16:30
Matrix: Drinking Water - Regular Sample

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, < 1.00, ug/L, 01/20/24 07:33, 1, 1.00, 01/20/24 09:59, BRS, EPA 200.8 REV 5.4



ANALYTICAL RESULTS

Sample: HA00869-33
Name: OES-33
Alias: OAKVILLE ELEM

Sampled: 01/02/24 18:01
Received: 01/04/24 16:30
Matrix: Drinking Water - Regular Sample

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
Total Metals - PIA									
Lead	3.10	ug/L		01/20/24 07:33	1	1.00	01/20/24 10:00	BRS	EPA 200.8 REV 5.4



QC SAMPLE RESULTS

Parameter	Result	Unit	Qual	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit
Batch B423475 - DW 200.8 no prep - EPA 200.8 REV 5.4									
Blank (B423475-BLK1)				Prepared & Analyzed: 01/19/24					
Lead	< 1.00	ug/L							
LCS (B423475-BS1)				Prepared & Analyzed: 01/19/24					
Lead	51.8	ug/L		50.00		104	85-115		
Matrix Spike (B423475-MS1)				Sample: HA01066-10 Prepared & Analyzed: 01/19/24					
Lead	53.5	ug/L		50.00	2.57	102	70-130		
Matrix Spike (B423475-MS2)				Sample: HA01067-10 Prepared & Analyzed: 01/19/24					
Lead	52.1	ug/L		50.00	2.78	99	70-130		
Matrix Spike (B423475-MS3)				Sample: HA01068-07 Prepared & Analyzed: 01/19/24					
Lead	47.5	ug/L		50.00	0.384	94	70-130		
Matrix Spike (B423475-MS4)				Sample: HA01068-17 Prepared & Analyzed: 01/19/24					
Lead	53.0	ug/L		50.00	2.67	101	70-130		
Matrix Spike (B423475-MS5)				Sample: HA01068-27 Prepared & Analyzed: 01/19/24					
Lead	51.0	ug/L		50.00	3.03	96	70-130		
Matrix Spike (B423475-MS6)				Sample: HA01406-04 Prepared & Analyzed: 01/19/24					
Lead	50.5	ug/L		50.00	0.339	100	70-130		
Matrix Spike (B423475-MS7)				Sample: HA01406-14 Prepared & Analyzed: 01/19/24					
Lead	50.9	ug/L		50.00	1.16	100	70-130		
Matrix Spike (B423475-MS8)				Sample: HA01406-24 Prepared & Analyzed: 01/19/24					
Lead	51.8	ug/L		50.00	1.66	100	70-130		
Matrix Spike (B423475-MS9)				Sample: HA01424-06 Prepared & Analyzed: 01/19/24					
Lead	50.5	ug/L		50.00	2.76	95	70-130		
Matrix Spike (B423475-MSA)				Sample: HA01424-16 Prepared & Analyzed: 01/19/24					
Lead	55.6	ug/L		50.00	7.56	96	70-130		
Matrix Spike (B423475-MSB)				Sample: HA01424-26 Prepared & Analyzed: 01/19/24					
Lead	63.1	ug/L		50.00	15.4	95	70-130		
Matrix Spike (B423475-MSC)				Sample: HA01424-36 Prepared & Analyzed: 01/19/24					
Lead	51.2	ug/L		50.00	1.91	98	70-130		
Matrix Spike (B423475-MSD)				Sample: HA01424-44 Prepared & Analyzed: 01/19/24					
Lead	49.3	ug/L		50.00	0.552	97	70-130		
Matrix Spike Dup (B423475-MSD1)				Sample: HA01066-10 Prepared & Analyzed: 01/19/24					
Lead	51.8	ug/L		50.00	2.57	98	70-130	3	20
Matrix Spike Dup (B423475-MSD2)				Sample: HA01067-10 Prepared & Analyzed: 01/19/24					
Lead	52.2	ug/L		50.00	2.78	99	70-130	0.2	20
Matrix Spike Dup (B423475-MSD3)				Sample: HA01068-07 Prepared & Analyzed: 01/19/24					
Lead	50.6	ug/L		50.00	0.384	100	70-130	6	20
Matrix Spike Dup (B423475-MSD4)				Sample: HA01068-17 Prepared & Analyzed: 01/19/24					
Lead	52.5	ug/L		50.00	2.67	100	70-130	0.8	20
Matrix Spike Dup (B423475-MSD5)				Sample: HA01068-27 Prepared & Analyzed: 01/19/24					
Lead	53.7	ug/L		50.00	3.03	101	70-130	5	20
Matrix Spike Dup (B423475-MSD6)				Sample: HA01406-04 Prepared & Analyzed: 01/19/24					
Lead	51.8	ug/L		50.00	0.339	103	70-130	3	20
Matrix Spike Dup (B423475-MSD7)				Sample: HA01406-14 Prepared & Analyzed: 01/19/24					
Lead	49.6	ug/L		50.00	1.16	97	70-130	3	20



QC SAMPLE RESULTS

Parameter	Result	Unit	Qual	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit
Matrix Spike Dup (B423475-MSD8)	Sample: HA01406-24			Prepared & Analyzed: 01/19/24					
Lead	49.8	ug/L		50.00	1.66	96	70-130	4	20
Matrix Spike Dup (B423475-MSD9)	Sample: HA01424-06			Prepared & Analyzed: 01/19/24					
Lead	54.2	ug/L		50.00	2.76	103	70-130	7	20
Matrix Spike Dup (B423475-MSDA)	Sample: HA01424-16			Prepared & Analyzed: 01/19/24					
Lead	56.3	ug/L		50.00	7.56	97	70-130	1	20
Matrix Spike Dup (B423475-MSDB)	Sample: HA01424-26			Prepared & Analyzed: 01/19/24					
Lead	64.9	ug/L		50.00	15.4	99	70-130	3	20
Matrix Spike Dup (B423475-MSDC)	Sample: HA01424-36			Prepared & Analyzed: 01/19/24					
Lead	50.2	ug/L		50.00	1.91	97	70-130	2	20
Matrix Spike Dup (B423475-MSDD)	Sample: HA01424-44			Prepared & Analyzed: 01/19/24					
Lead	48.7	ug/L		50.00	0.552	96	70-130	1	20
Matrix Spike Dup (B423475-MSDE)	Sample: HA01052-02			Prepared & Analyzed: 01/19/24					
Lead	49.8	ug/L		50.00	5.64	88	70-130	0.2	20
Matrix Spike Dup (B423475-MSDF)	Sample: HA00869-03			Prepared & Analyzed: 01/19/24					
Lead	45.7	ug/L		50.00	0.311	91	70-130	5	20
Matrix Spike Dup (B423475-MSDG)	Sample: HA00869-13			Prepared & Analyzed: 01/19/24					
Lead	43.8	ug/L		50.00	0.196	87	70-130	7	20
Matrix Spike (B423475-MSE)	Sample: HA01052-02			Prepared & Analyzed: 01/19/24					
Lead	49.9	ug/L		50.00	5.64	89	70-130		
Matrix Spike (B423475-MSF)	Sample: HA00869-03			Prepared & Analyzed: 01/19/24					
Lead	47.8	ug/L		50.00	0.311	95	70-130		
Matrix Spike (B423475-MSG)	Sample: HA00869-13			Prepared & Analyzed: 01/19/24					
Lead	46.9	ug/L		50.00	0.196	93	70-130		
Batch B423513 - DW 200.8 no prep - EPA 200.8 REV 5.4									
Blank (B423513-BLK1)				Prepared & Analyzed: 01/20/24					
Lead	< 1.00	ug/L							
LCS (B423513-BS1)				Prepared & Analyzed: 01/20/24					
Lead	50.4	ug/L		50.00		101	85-115		
Matrix Spike (B423513-MS1)	Sample: HA00869-23			Prepared & Analyzed: 01/20/24					
Lead	51.6	ug/L		50.00	ND	103	70-130		
Matrix Spike (B423513-MS2)	Sample: HA00869-33			Prepared & Analyzed: 01/20/24					
Lead	51.9	ug/L		50.00	3.10	98	70-130		
Matrix Spike (B423513-MS3)	Sample: HA00877-10			Prepared & Analyzed: 01/20/24					
Lead	51.3	ug/L		50.00	ND	103	70-130		
Matrix Spike (B423513-MS4)	Sample: HA00877-20			Prepared & Analyzed: 01/20/24					
Lead	64.2	ug/L		50.00	11.7	105	70-130		
Matrix Spike (B423513-MS5)	Sample: HA00877-30			Prepared & Analyzed: 01/20/24					
Lead	51.4	ug/L		50.00	1.18	100	70-130		
Matrix Spike (B423513-MS6)	Sample: HA00877-40			Prepared & Analyzed: 01/20/24					
Lead	50.7	ug/L		50.00	0.468	100	70-130		
Matrix Spike (B423513-MS7)	Sample: HA00877-50			Prepared & Analyzed: 01/20/24					
Lead	50.8	ug/L		50.00	1.67	98	70-130		
Matrix Spike (B423513-MS8)	Sample: HA00877-60			Prepared & Analyzed: 01/20/24					
Lead	52.9	ug/L		50.00	0.610	105	70-130		



QC SAMPLE RESULTS

Parameter	Result	Unit	Qual	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit
Matrix Spike (B423513-MS9)	Sample: HA00884-10			Prepared & Analyzed: 01/20/24					
Lead	61.9	ug/L		50.00	13.6	97	70-130		
Matrix Spike (B423513-MSA)	Sample: HA00884-15			Prepared & Analyzed: 01/20/24					
Lead	55.2	ug/L		50.00	6.05	98	70-130		
Matrix Spike (B423513-MSB)	Sample: HA00884-25			Prepared & Analyzed: 01/20/24					
Lead	52.5	ug/L		50.00	ND	105	70-130		
Matrix Spike (B423513-MSC)	Sample: HA00884-35			Prepared & Analyzed: 01/20/24					
Lead	52.1	ug/L		50.00	1.66	101	70-130		
Matrix Spike (B423513-MSD)	Sample: HA00884-45			Prepared & Analyzed: 01/20/24					
Lead	51.5	ug/L		50.00	ND	103	70-130		
Matrix Spike Dup (B423513-MSD1)	Sample: HA00869-23			Prepared & Analyzed: 01/20/24					
Lead	50.0	ug/L		50.00	ND	100	70-130	3	20
Matrix Spike Dup (B423513-MSD2)	Sample: HA00869-33			Prepared & Analyzed: 01/20/24					
Lead	54.0	ug/L		50.00	3.10	102	70-130	4	20
Matrix Spike Dup (B423513-MSD3)	Sample: HA00877-10			Prepared & Analyzed: 01/20/24					
Lead	50.9	ug/L		50.00	ND	102	70-130	0.9	20
Matrix Spike Dup (B423513-MSD4)	Sample: HA00877-20			Prepared & Analyzed: 01/20/24					
Lead	64.6	ug/L		50.00	11.7	106	70-130	0.7	20
Matrix Spike Dup (B423513-MSD5)	Sample: HA00877-30			Prepared & Analyzed: 01/20/24					
Lead	51.0	ug/L		50.00	1.18	100	70-130	0.8	20
Matrix Spike Dup (B423513-MSD6)	Sample: HA00877-40			Prepared & Analyzed: 01/20/24					
Lead	50.2	ug/L		50.00	0.468	99	70-130	1	20
Matrix Spike Dup (B423513-MSD7)	Sample: HA00877-50			Prepared & Analyzed: 01/20/24					
Lead	50.2	ug/L		50.00	1.67	97	70-130	1	20
Matrix Spike Dup (B423513-MSD8)	Sample: HA00877-60			Prepared & Analyzed: 01/20/24					
Lead	50.3	ug/L		50.00	0.610	99	70-130	5	20
Matrix Spike Dup (B423513-MSD9)	Sample: HA00884-10			Prepared & Analyzed: 01/20/24					
Lead	61.8	ug/L		50.00	13.6	96	70-130	0.2	20
Matrix Spike Dup (B423513-MSDA)	Sample: HA00884-15			Prepared & Analyzed: 01/20/24					
Lead	54.3	ug/L		50.00	6.05	97	70-130	2	20
Matrix Spike Dup (B423513-MSDB)	Sample: HA00884-25			Prepared & Analyzed: 01/20/24					
Lead	51.0	ug/L		50.00	ND	102	70-130	3	20
Matrix Spike Dup (B423513-MSDC)	Sample: HA00884-35			Prepared & Analyzed: 01/20/24					
Lead	49.2	ug/L		50.00	1.66	95	70-130	6	20
Matrix Spike Dup (B423513-MSDD)	Sample: HA00884-45			Prepared & Analyzed: 01/20/24					
Lead	48.9	ug/L		50.00	ND	98	70-130	5	20
Matrix Spike Dup (B423513-MSDE)	Sample: HA01118-06			Prepared & Analyzed: 01/20/24					
Lead	55.9	ug/L		50.00	ND	112	70-130	3	20
Matrix Spike Dup (B423513-MSDF)	Sample: HA01118-16			Prepared & Analyzed: 01/20/24					
Lead	57.5	ug/L		50.00	0.219	115	70-130	3	20
Matrix Spike Dup (B423513-MSDG)	Sample: HA01118-27			Prepared & Analyzed: 01/20/24					
Lead	56.7	ug/L		50.00	0.111	113	70-130	0.2	20
Matrix Spike Dup (B423513-MSDH)	Sample: HA01118-37			Prepared & Analyzed: 01/20/24					
Lead	55.5	ug/L		50.00	ND	111	70-130	0.9	20
Matrix Spike Dup (B423513-MSDI)	Sample: HA01118-47			Prepared & Analyzed: 01/20/24					
Lead	56.3	ug/L		50.00	ND	113	70-130	2	20



QC SAMPLE RESULTS

Parameter	Result	Unit	Qual	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit
Matrix Spike (B423513-MSE)	Sample: HA01118-06			Prepared & Analyzed: 01/20/24					
Lead	54.3	ug/L		50.00	ND	109	70-130		
Matrix Spike (B423513-MSF)	Sample: HA01118-16			Prepared & Analyzed: 01/20/24					
Lead	55.7	ug/L		50.00	0.219	111	70-130		
Matrix Spike (B423513-MSG)	Sample: HA01118-27			Prepared & Analyzed: 01/20/24					
Lead	56.9	ug/L		50.00	0.111	113	70-130		
Matrix Spike (B423513-MSH)	Sample: HA01118-37			Prepared & Analyzed: 01/20/24					
Lead	56.0	ug/L		50.00	ND	112	70-130		
Matrix Spike (B423513-MSI)	Sample: HA01118-47			Prepared & Analyzed: 01/20/24					
Lead	55.5	ug/L		50.00	ND	111	70-130		



NOTES

Specifications regarding method revisions, method modifications, and calculations used for analysis are available upon request. Please contact your project manager.

* Not a TNI accredited analyte

Certifications

CHI - McHenry, IL - 4314-A W. Crystal Lake Road, McHenry, IL 60050

TNI Accreditation for Drinking Water and Wastewater Fields of Testing through IL EPA Accreditation No. 100279

Illinois Department of Public Health Bacterial Analysis in Drinking Water Approved Laboratory Registry No. 17556

PIA - Peoria, IL - 2231 W. Altorfer Drive, Peoria, IL 61615

TNI Accreditation for Drinking Water, Wastewater, Solid and Hazardous Material Fields of Testing through IL EPA Accreditation No. 100230

Illinois Department of Public Health Bacterial Analysis in Drinking Water Approved Laboratory Registry No. 17553

Drinking Water Certifications/Accreditations: Iowa (240); Kansas (E-10338); Missouri (870)

Wastewater Certifications/Accreditations: Arkansas (88-0677); Iowa (240); Kansas (E-10338)

Solid and Hazardous Material Certifications/Accreditations: Arkansas (88-0677); Iowa (240); Kansas (E-10338)

SPMO - Springfield, MO - 1805 W Sunset Street, Springfield, MO 65807

USEPA DMR-QA Program

STL - Hazelwood, MO - 944 Anglum Rd, Hazelwood, MO 63042

TNI Accreditation for Wastewater, Solid and Hazardous Material Fields of Testing through KS KDHE Certification No. E-10389

TNI Accreditation for Wastewater, Solid and Hazardous Material Fields of Testing through IL EPA Accreditation No. - 200080

Illinois Department of Public Health Bacterial Analysis in Drinking Water Approved Laboratory, Registry No. 171050

Missouri Department of Natural Resources - Certificate of Approval for Microbiological Laboratory Service - No. 1050



Certified by: Chenise Lambert-Sykes, Project Manager

REGULATORY PROGRAM (CIRCLE):	NPDES
MORBCA	RCRA
CCDD	TACO: RES OR IND/COMM

CHAIN OF CUSTODY RECORD
 STATE WHERE SAMPLE COLLECTED MO

ALL HIGHLIGHTED AREAS MUST BE COMPLETED BY CLIENT (PLEASE PRINT)

1 CLIENT SCI Engineering		PROJECT NUMBER 2016-0860.2T		PROJECT LOCATION Oakville Elem		PURCHASE ORDER #		3 ANALYSIS REQUESTED				4 (FOR LAB USE ONLY) LOGIN # <u>HA00869</u> LOGGED BY: <u>7051</u> CLIENT: <u>SCI Engineering</u> PROJECT: <u>Drinking Water Lead</u> PROJ. MGR.: <u>Chenise Lambert-Sykes</u> CUSTODY SEAL #: _____	
ADDRESS 130 Point West Blvd		PHONE NUMBER (314) 581-7570		E-MAIL blieb@sciengineering.com		DATE SHIPPED		DW Pb Turb Check				REMARKS	
CITY STATE ZIP St. Charles, MO 63301		SAMPLER (PLEASE PRINT) Kieran Kleinhenz		SAMPLER'S SIGNATURE <i>Kieran Kleinhenz</i>		MATRIX TYPES: <small> WW- WASTEWATER DW- DRINKING WATER GW- GROUND WATER WWSL- SLUDGE NAS- NON AQUEOUS SOLID LGHT- LEACHATE OIL- OIL SO- SOIL SOL- SOLID </small>							
CONTACT PERSON Brian Lieb		DATE COLLECTED		TIME COLLECTED		SAMPLE TYPE <small>GRAB COMP</small>		MATRIX TYPE		BOTTLE COUNT		PRES CODE <small>CLIENT PROVIDED</small>	
2 SAMPLE DESCRIPTION <small>(UNIQUE DESCRIPTION AS IT WILL APPEAR ON THE ANALYTICAL REPORT)</small>		OES-1		1/2/24 1714		X		DW		1 6		X X	
OES-2		1/2/24 1716		X		DW		1 6		X X			
OES-3		1/2/24 1717		X		DW		1 6		X X			
OES-4		1/2/24 1719		X		DW		1 6		X X			
OES-5		1/2/24 1720		X		DW		1 6		X X			
OES-6		1/2/24 1720		X		DW		1 6		X X			
OES-7		1/2/24 1724		X		DW		1 6		X X			
OES-8		1/2/24 1724		X		DW		1 6		X X			
OES-9		1/2/24 1726		X		DW		1 6		X X			
OES-10		1/2/24 1728		X		DW		1 6		X X			
OES-11		1/2/24 1729		X		DW		1 6		X X			
CHEMICAL PRESERVATION CODES: 1-HCL 2-H2SO4 3-HNO3 4-NAOH 5-NA2S2O3 6-UNPRESERVED 7-OTHER													
5 TURNAROUND TIME REQUESTED (PLEASE CIRCLE) NORMAL RUSH <small>(RUSH TAT IS SUBJECT TO PACE LABS APPROVAL AND SURCHARGE)</small>				DATE RESULTS NEEDED				6 I understand that by initialing this box I give the lab permission to proceed with analysis, even though it may not meet all sample conformance requirements as defined in the receiving facility's Sample Acceptance Policy and the data will be qualified. Qualified data may NOT be acceptable to report to all regulatory authorities.					
RUSH RESULTS VIA (PLEASE CIRCLE) EMAIL PHONE				PROCEED WITH ANALYSIS AND QUALIFY RESULTS: (INITIALS) _____									
7 RELINQUISHED BY: (SIGNATURE) <i>Brian Lieb</i>		DATE TIME		RECEIVED BY: (SIGNATURE) <i>Chenise Lambert-Sykes</i>				DATE TIME		8 COMMENTS: (FOR LAB USE ONLY)			
RELINQUISHED BY: (SIGNATURE) <i>Chenise Lambert-Sykes</i>		DATE TIME		RECEIVED BY: (SIGNATURE)				DATE TIME		SAMPLE TEMPERATURE UPON RECEIPT <u>19.0</u> °C			
RELINQUISHED BY: (SIGNATURE)		DATE TIME		RECEIVED BY: (SIGNATURE)				DATE TIME		CHILL PROCESS STARTED PRIOR TO RECEIPT Y OR N SAMPLE(S) RECEIVED ON ICE Y OR N SAMPLE ACCEPTANCE NONCONFORMANT REPORT IS NEEDED Y OR N			
								DATE TIME		DATE AND TIME TAKEN FROM SAMPLE BOTTLE			

REGULATORY PROGRAM (CIRCLE):	NPDES
MORBCA	RCRA
CCDD	TACO: RES OR IND/COMM

CHAIN OF CUSTODY RECORD
 STATE WHERE SAMPLE COLLECTED MO

ALL HIGHLIGHTED AREAS MUST BE COMPLETED BY CLIENT (PLEASE PRINT)

1 CLIENT SCI Engineering ADDRESS 130 Point West Blvd CITY STATE ZIP St. Charles, MO 63301 CONTACT PERSON Brian Lieb	PROJECT NUMBER 2016-0860.2T	PROJECT LOCATION Oakville Elem	PURCHASE ORDER #	3 ANALYSIS REQUESTED <input checked="" type="checkbox"/> DW Pb <input checked="" type="checkbox"/> Turb Check	4 (FOR LAB USE ONLY) LOGIN # <u>HA00869</u> LOGGED BY: <u>7051</u> CLIENT: SCI Engineering PROJECT: Drinking Water Lead PROJ. MGR.: Chenise Lambert-Sykes CUSTODY SEAL #: _____			
	PHONE NUMBER (314) 581-7570	E-MAIL blieb@sciengineering.com	DATE SHIPPED					
	SAMPLER (PLEASE PRINT) Kieran Kleinhenz	MATRIX TYPES: WW- WASTEWATER DW- DRINKING WATER GW- GROUND WATER WWSL- SLUDGE NAS- NON AQUEOUS SOLID LCHT- LEACHATE OIL- OIL SO- SOL SOL- SOLID						
	SAMPLER'S SIGNATURE							
2 SAMPLE DESCRIPTION (UNIQUE DESCRIPTION AS IT WILL APPEAR ON THE ANALYTICAL REPORT)	DATE COLLECTED	TIME COLLECTED	SAMPLE TYPE GRAB COMP	MATRIX TYPE	BOTTLE COUNT	PRES CODE CLIENT PROVIDED	DW Pb Turb Check	REMARKS
OES-12	1/2/24	1732	X	DW	1	6	X X	
OES-13	1/2/24	1733	X	DW	1	6	X X	
OES-14	1/2/24	1734	X	DW	1	6	X X	
OES-15	1/2/24	1737	X	DW	1	6	X X	
OES-16	1/2/24	1737	X	DW	1	6	X X	
OES-17	1/2/24	1740	X	DW	1	6	X X	
OES-18	1/2/24	1740	X	DW	1	6	X X	
OES-19	1/2/24	1743	X	DW	1	6	X X	
OES-20	1/2/24	1745	X	DW	1	6	X X	
OES-21	1/2/24	1746	X	DW	1	6	X X	
OES-22	1/2/24	1747	X	DW	1	6	X X	
CHEMICAL PRESERVATION CODES:		1 - HCL	2 - H2SO4	3 - HNO3	4 - NAOH	5 - NA2S2O3	6 - UNPRESERVED	7 - OTHER
5 TURNAROUND TIME REQUESTED (PLEASE CIRCLE) NORMAL RUSH (RUSH TAT IS SUBJECT TO PACE LABS APPROVAL AND SURCHARGE) RUSH RESULTS VIA (PLEASE CIRCLE) EMAIL PHONE EMAIL IF DIFFERENT FROM ABOVE: PHONE # IF DIFFERENT FROM ABOVE:	DATE RESULTS NEEDED		6 I understand that by initialing this box I give the lab permission to proceed with analysis, even though it may not meet all sample conformance requirements as defined in the receiving facility's Sample Acceptance Policy and the data will be qualified. Qualified data may NOT be acceptable to report to all regulatory authorities. PROCEED WITH ANALYSIS AND QUALIFY RESULTS: (INITIALS) _____					
7 RELINQUISHED BY: (SIGNATURE) <i>Kieran Kleinhenz</i>	DATE TIME	RECEIVED BY: (SIGNATURE) <i>[Signature]</i>		DATE TIME 1-4-24 1045	8 COMMENTS: (FOR LAB USE ONLY)			
RELINQUISHED BY: (SIGNATURE) <i>[Signature]</i>	DATE TIME 1-4-24 1600	RECEIVED BY: (SIGNATURE) <i>[Signature]</i>		DATE TIME	SAMPLE TEMPERATURE UPON RECEIPT <u>19.0</u> °C CHILL PROCESS STARTED PRIOR TO RECEIPT Y OR N SAMPLE(S) RECEIVED ON ICE Y OR N SAMPLE ACCEPTANCE NONCONFORMANT REPORT IS NEEDED Y OR N			
RELINQUISHED BY: (SIGNATURE) <i>[Signature]</i>	DATE TIME	RECEIVED BY: (SIGNATURE) <i>[Signature]</i>		DATE TIME 1/7/24 1630	DATE AND TIME TAKEN FROM SAMPLE BAG _____			

REGULATORY PROGRAM (CIRCLE):	NPDES
MORBCA	RCRA
CCDD	TACO: RES OR IND/COMM

CHAIN OF CUSTODY RECORD
STATE WHERE SAMPLE COLLECTED MO

ALL HIGHLIGHTED AREAS MUST BE COMPLETED BY CLIENT (PLEASE PRINT)

1 CLIENT SCI Engineering ADDRESS 130 Point West Blvd CITY STATE ZIP St. Charles, MO 63301 CONTACT PERSON Brian Lieb	PROJECT NUMBER 2016-0860.2T	PROJECT LOCATION Oakville Elem	PURCHASE ORDER #	3 ANALYSIS REQUESTED <input checked="" type="checkbox"/> DW Pb <input checked="" type="checkbox"/> Turb Check	4 (FOR LAB USE ONLY) LOGIN # <u>H400869</u> LOGGED BY: <u>JOSL</u> CLIENT: <u>SCI Engineering</u> PROJECT: <u>Drinking Water Lead</u> PROJ. MGR.: <u>Chenise Lambert-Sykes</u> CUSTODY SEAL #: _____
	PHONE NUMBER (314) 581-7570	E-MAIL blieb@sciengineering.com	DATE SHIPPED		
	SAMPLER (PLEASE PRINT) Kieran Kleinhenz	MATRIX TYPES: WW- WASTEWATER DW- DRINKING WATER GW- GROUND WATER WWSL- SLUDGE NAS- NON AQUEOUS SOLID LGHT- LEACHATE OIL- OIL SO- SOIL SOL- SOLID			
	SAMPLER'S SIGNATURE				

2 SAMPLE DESCRIPTION (UNIQUE DESCRIPTION AS IT WILL APPEAR ON THE ANALYTICAL REPORT)	DATE COLLECTED	TIME COLLECTED	SAMPLE TYPE		MATRIX TYPE	BOTTLE COUNT	PRES CODE CLIENT PROVIDED	DW Pb	Turb Check										REMARKS
			GRAB	COMP															
OES-23	1/2/24	1748	X		DW	1	6	X	X										
OES-24	1/2/24	1748	X		DW	1	6	X	X										
OES-25	1/2/24	1750	X		DW	1	6	X	X										
OES-26	1/2/24	1751	X		DW	1	6	X	X										
OES-27	1/2/24	1754	X		DW	1	6	X	X										
OES-28	1/2/24	1755	X		DW	1	6	X	X										
OES-29	1/2/24	1756	X		DW	1	6	X	X										
OES-30	1/2/24	1757	X		DW	1	6	X	X										
OES-31	1/2/24	1759	X		DW	1	6	X	X										
OES-32	1/2/24	1800	X		DW	1	6	X	X										
OES-33	1/2/24	1801	X		DW	1	6	X	X										

CHEMICAL PRESERVATION CODES: 1-HCL 2-H2SO4 3-HNO3 4-NAOH 5-NA2S2O3 6-UNPRESERVED 7-OTHER

5 TURNAROUND TIME REQUESTED (PLEASE CIRCLE) NORMAL RUSH (RUSH TAT IS SUBJECT TO PACE LABS APPROVAL AND SURCHARGE) RUSH RESULTS VIA (PLEASE CIRCLE) EMAIL PHONE EMAIL IF DIFFERENT FROM ABOVE: _____ PHONE # IF DIFFERENT FROM ABOVE: _____	DATE RESULTS NEEDED	6 I understand that by initialing this box I give the lab permission to proceed with analysis, even though it may not meet all sample conformance requirements as defined in the receiving facility's Sample Acceptance Policy and the data will be qualified. Qualified data may NOT be acceptable to report to all regulatory authorities. PROCEED WITH ANALYSIS AND QUALIFY RESULTS: (INITIALS) _____

7 RELINQUISHED BY: (SIGNATURE) <i>Brian Lieb</i> RELINQUISHED BY: (SIGNATURE) <i>Chenise Lambert-Sykes</i> RELINQUISHED BY: (SIGNATURE) <i>Chenise Lambert-Sykes</i>	DATE	RECEIVED BY: (SIGNATURE)	DATE	8 COMMENTS: (FOR LAB USE ONLY) SAMPLE TEMPERATURE UPON RECEIPT <u>190</u> °C CHILL PROCESS STARTED PRIOR TO RECEIPT <input type="checkbox"/> Y OR <input checked="" type="checkbox"/> N SAMPLE(S) RECEIVED ON ICE <input type="checkbox"/> Y OR <input checked="" type="checkbox"/> N SAMPLE ACCEPTANCE NONCONFORMANT REPORT IS NEEDED DATE AND TIME TAKEN FROM SAMPLE BOTTLE _____
	TIME	<i>Chenise Lambert-Sykes</i>	TIME	
	DATE	RECEIVED BY: (SIGNATURE)	DATE	
	1-4-24		1-4-24	
	TIME		TIME	
	1600		1045	
	DATE	RECEIVED BY: (SIGNATURE)	DATE	
		<i>Chenise Lambert-Sykes</i>	1/4/27	
	TIME		TIME	
			1630	