



SCI ENGINEERING, INC.

EARTH • SCIENCE • SOLUTIONS

GEOTECHNICAL
ENVIRONMENTAL
NATURAL RESOURCES
CULTURAL RESOURCES
CONSTRUCTION SERVICES

April 2, 2024

Michael Gegg
Mehlville School District
3120 Lemay Ferry Road
St. Louis, Missouri 63125

RE: Lead in Drinking Water Report
John Cary Early Childhood Center
3155 Koch Road
St. Louis, Missouri
SCI No. 2016-0860.2T

Dear Michael Gegg:

INTRODUCTION

SCI Engineering, Inc. (SCI) is pleased to submit this report summarizing lead in drinking water sampling activities performed on December 21 and December 22, 2023. The purpose of the sampling activities was to screen for elevated levels of lead in the drinking water at potable water sources throughout the above-referenced structure.

The drinking water survey is intended to satisfy the requirements for the “Get the Lead Out of School Drinking Water Act” (GTLOSDWA), Section 160.077 administered by the Missouri Department of Health and Senior Services. Potable water sources to be tested were identified by the school district prior to SCI’s field activities.

LIMITATIONS

SCI’s sampling activities were limited to locations identified by the school district. If any additional potable water sources need testing, please contact SCI, and we will make arrangements for sampling these fixtures. Potable water sources that were not sampled will need a sign placed near each fixture informing students and faculty it is not to be used as a drinking water source.

During the course of performing the drinking water sampling of the structure, SCI was unable to sample eight fixtures because they were out of order. These fixtures included water fountains in Room 7, Room 8, Room 9, Room 10, Room 11, Room 12, Room 13, and Room 14. If these fixtures are made operational, they should be sampled or labeled non-potable. SCI was able to sample all other locations identified by the school district.

DRINKING WATER SURVEY

SCI collected “first draw” samples which consisted of collecting a water sample from each fixture or sample location after it remained stagnant for at least eight hours. Prior to sampling, SCI first mobilized

to the site to flush the identified potable water fixtures throughout the structure. Once each fixture was flushed, a sign was placed on the fixture indicating it should not be used. SCI then revisited the site, after a minimum of eight hours, to collect water samples from the fixtures.

SCI collected 19 drinking water samples (JCECC-1 through JCECC-19) from various water fixtures located throughout the structure and submitted them for analytical testing. The drinking water samples were analyzed for total lead by U.S. EPA Method 200.8. SCI collected a minimum of 250 milliliters of water from each location. Sampled water was containerized in laboratory-provided sample containers and shipped to the lab using standard chain-of-custody procedures. A figure depicting the locations of the sampled water fixtures is enclosed.

The drinking water samples were analyzed for lead in accordance with the GTLOSDWA, Section 160.077, which establishes an action level (AL) of 5 parts per billion (ppb). During the course of SCI's sampling, no drinking water samples exceeded the AL. A copy of the analytical test results and chain-of-custody for all samples is enclosed.

CONCLUSION AND REPORTING

As previously mentioned, no drinking water samples exceeded the AL of 5 ppb. Therefore, all tested fixtures are compliant per GTLOSDWA and should be tested every five years.

Within seven business days after receiving this report, the school district shall contact parents and staff via written notification which shall include the following:


- The test results and a summary that explains such results;
- A description of any remedial steps taken;
- A description of general health effects of lead contamination and community specific resources;
and
- If there is not enough water to meet the drinking water needs of the students, teachers, and staff, bottled water shall be provided.

Additionally, within two weeks of receiving this report, the results and any lead remediation plans must be made available on the school's website.

This report, and subsequent annual testing reports, must be submitted to the Missouri Department of Health and Senior Services, Healthy Drinking Water Unit, PO Box 570, Jefferson City, MO 65102-0570.

Respectfully,

SCI ENGINEERING, INC.



Brian L. Lieb
Project Scientist




Jessica B. Keeven, CHMM
Senior Scientist

BLL/JBK/rah

Enclosure

Lead Drinking Water Sampling Plan
Lead Testing Results

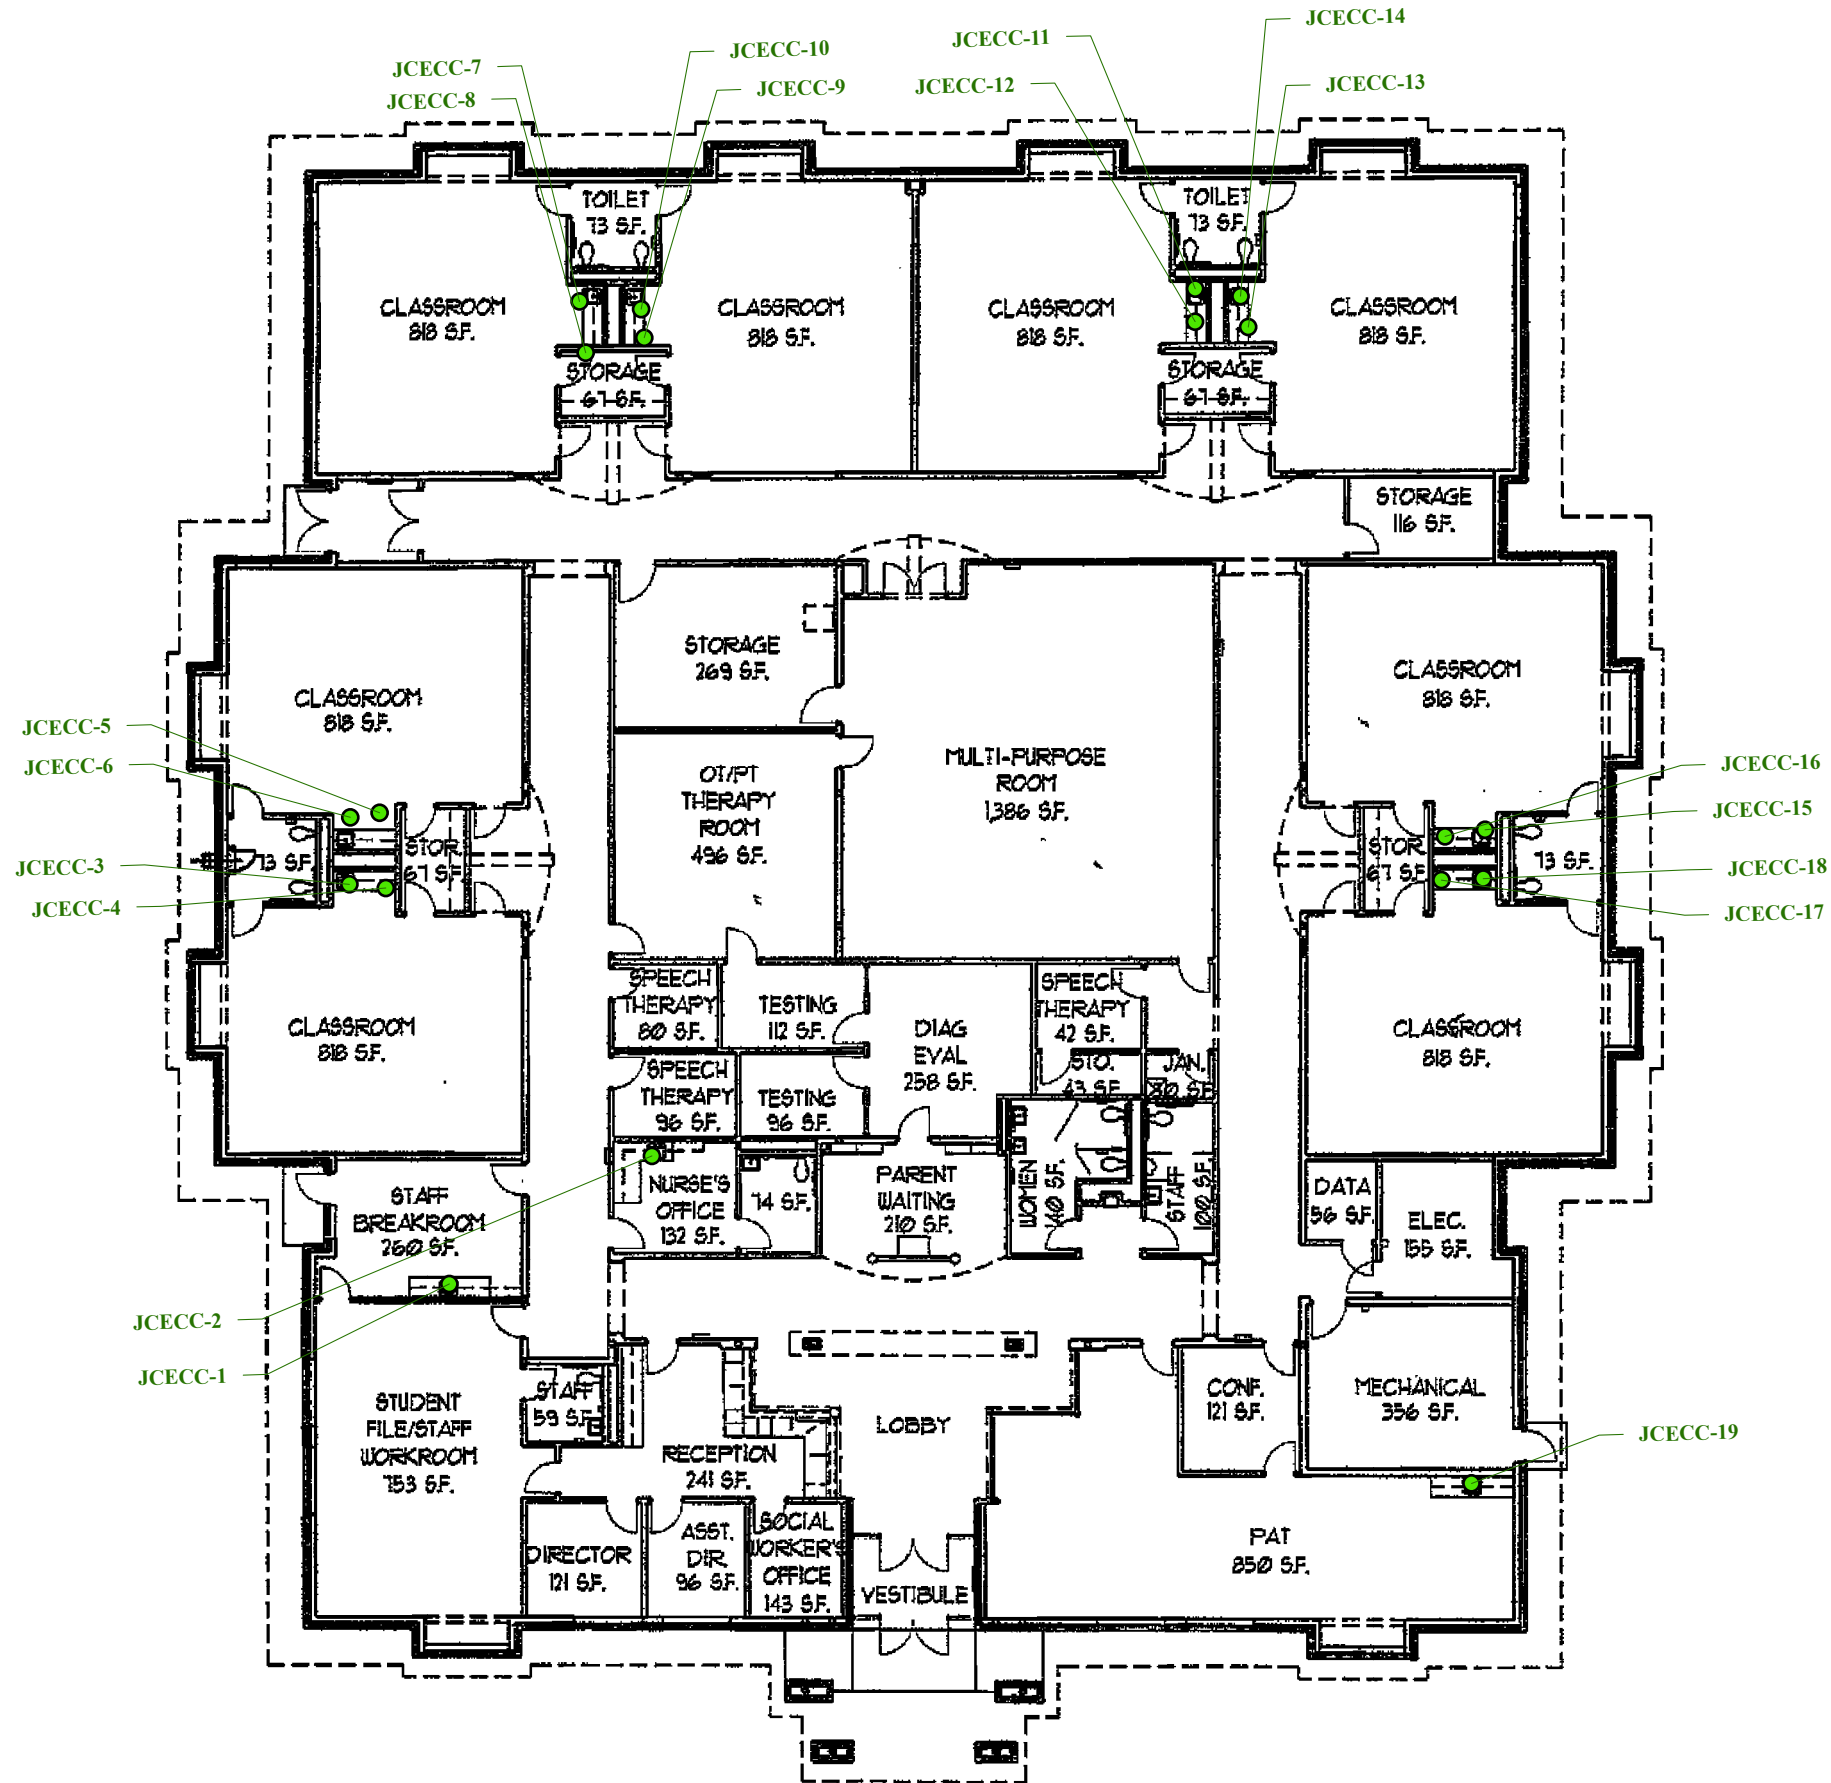

GENERAL NOTES/LEGEND


● RESULTS LESS THAN THE ACTION LEVEL OF 5 PARTS PER BILLION

FLOOR PLANS PROVIDED BY MEHILVILLE SCHOOL DISTRICT. DIMENSIONS AND LOCATIONS ARE APPROXIMATE; ACTUAL MAY VARY. DRAWING SHALL NOT BE USED OUTSIDE THE CONTEXT OF THE REPORT FOR WHICH IT WAS GENERATED.


PROJECT NAME

MEHILVILLE SCHOOL DISTRICT
JOHN CARY ECC
ST. LOUIS, MISSOURI

LEAD DRINKING WATER SAMPLING PLAN



JOB NUMBER	2016-0860.2T
FIGURE DATE	03/06/2024
DRAWN BY	JTM
CHECKED BY	BLL
FIGURE	1





Pace Analytical Services, LLC

2231 W. Altorfer Drive

Peoria, IL 61615

(800)752-6651

January 29, 2024

Glenn Grissom
SCI Engineering
130 Point W. Blvd.
St. Chariles, MO 63301

RE: 2016-0860.2T - JOHN CARY ECC

Dear Glenn Grissom:

Please find enclosed the analytical results for the **19** sample(s) the laboratory received on **1/2/24 3:35 pm** and logged in under work order **HA00085**. All testing is performed according to our current TNI accreditations unless otherwise noted. This report cannot be reproduced, except in full, without the written permission of Pace Analytical Services, LLC.

If you have any questions regarding your report, please contact your project manager. Quality and timely data is of the utmost importance to us.

Pace Analytical Services appreciates the opportunity to provide you with analytical expertise. We are always trying to improve our customer service and we welcome you to contact the General Manager, Lisa Grant, with any feedback you have about your experience with our laboratory at 309-683-1764 or lisa.grant@pacelabs.com.

A handwritten signature in black ink, appearing to read "Chenise Lambert-Sykes".

Chenise Lambert-Sykes
Project Manager
(314)432-0550
Chenise.Lambert-Sykes@pacelabs.com



SAMPLE RECEIPT CHECK LIST

Items not applicable will be marked as in compliance

Work Order HA00085

YES	Samples received within temperature compliance when applicable
YES	COC present upon sample receipt
YES	COC completed & legible
YES	Sampler name & signature present
YES	Unique sample IDs assigned
YES	Sample collection location recorded
YES	Date & time collected recorded on COC
YES	Relinquished by client signature on COC
YES	COC & labels match
YES	Sample labels are legible
YES	Appropriate bottle(s) received
YES	Sufficient sample volume received
YES	Sample containers received undamaged
NO	Zero headspace, <6 mm present in VOA vials
NO	Trip blank(s) received
YES	All non-field analyses received within holding times
NO	Short hold time analysis
YES	Current PDC COC submitted
NO	Case narrative provided



Pace Analytical Services, LLC

2231 W. Altorfer Drive

Peoria, IL 61615

(800)752-6651

Case Narrative

The drinking water lead analysis was performed at Pace-Ormond Beach, FL. Please refer to the subcontract section of the report for details.



ANALYTICAL RESULTS

**Sample:
Name:**

**Sampled:
Received:**

Reg ID:

PO #:

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------



Pace Analytical Services, LLC

2231 W. Altorfer Drive

Peoria, IL 61615

(800)752-6651

QC SAMPLE RESULTS

Parameter	Result	Unit	Qual	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit
-----------	--------	------	------	-------------	---------------	------	-------------	-----	-----------



NOTES

Specifications regarding method revisions, method modifications, and calculations used for analysis are available upon request. Please contact your project manager.

* Not a TNI accredited analyte

Certifications

CHI - McHenry, IL - 4314-A W. Crystal Lake Road, McHenry, IL 60050

TNI Accreditation for Drinking Water and Wastewater Fields of Testing through IL EPA Accreditation No. 100279

Illinois Department of Public Health Bacterial Analysis in Drinking Water Approved Laboratory Registry No. 17556

PIA - Peoria, IL - 2231 W. Altorfer Drive, Peoria, IL 61615

TNI Accreditation for Drinking Water, Wastewater, Solid and Hazardous Material Fields of Testing through IL EPA Accreditation No. 100230

Illinois Department of Public Health Bacterial Analysis in Drinking Water Approved Laboratory Registry No. 17553

Drinking Water Certifications/Accreditations: Iowa (240); Kansas (E-10338); Missouri (870)

Wastewater Certifications/Accreditations: Arkansas (88-0677); Iowa (240); Kansas (E-10338)

Solid and Hazardous Material Certifications/Accreditations: Arkansas (88-0677); Iowa (240); Kansas (E-10338)

SPMO - Springfield, MO - 1805 W Sunset Street, Springfield, MO 65807

USEPA DMR-QA Program

STL - Hazelwood, MO - 944 Anglum Rd, Hazelwood, MO 63042

TNI Accreditation for Wastewater, Solid and Hazardous Material Fields of Testing through KS KDHE Certification No. E-10389

TNI Accreditation for Wastewater, Solid and Hazardous Material Fields of Testing through IL EPA Accreditation No. - 200080

Illinois Department of Public Health Bacterial Analysis in Drinking Water Approved Laboratory, Registry No. 171050

Missouri Department of Natural Resources - Certificate of Approval for Microbiological Laboratory Service - No. 1050



Certified by: Chenise Lambert-Sykes, Project Manager



January 08, 2024

Chenise Lambert-Sykes
Pace Analytical Services, Inc - IL/MO
944 Anglum Road
Hazelwood, MO 63042

RE: Project: HA00085
Pace Project No.: 35851591

Dear Chenise Lambert-Sykes:

Enclosed are the analytical results for sample(s) received by the laboratory on January 04, 2024. The results relate only to the samples included in this report. Results reported herein conform to the applicable TNI/NELAC Standards and the laboratory's Quality Manual, where applicable, unless otherwise noted in the body of the report.

The test results provided in this final report were generated by each of the following laboratories within the Pace Network:

- Pace Analytical Services - Ormond Beach

If you have any questions concerning this report, please feel free to contact me.

Sincerely,

Brad Smith
brad.smith@pacelabs.com
(386) 672-5668
Project Manager

Enclosures



REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



CERTIFICATIONS

Project: HA00085

Pace Project No.: 35851591

Pace Analytical Services Ormond Beach

8 East Tower Circle, Ormond Beach, FL 32174

Alaska DEC- CS/UST/LUST

Alabama Certification #: 41320

California Certification# 3096

Colorado Certification: FL NELAC Reciprocity

Connecticut Certification #: PH-0216

Delaware Certification: FL NELAC Reciprocity

DoD-ANAB #:ADE-3199

Florida Certification #: E83079

Georgia Certification #: 955

Guam Certification: FL NELAC Reciprocity

Hawaii Certification: FL NELAC Reciprocity

Illinois Certification #: 200068

Indiana Certification: FL NELAC Reciprocity

Kansas Certification #: E-10383

Kentucky Certification #: 90050

Louisiana Certification #: FL NELAC Reciprocity

Louisiana Environmental Certificate #: 05007

Maine Certification #: FL01264

Maryland Certification: #346

Massachusetts Certification #: M-FL1264

Michigan Certification #: 9911

Mississippi Certification: FL NELAC Reciprocity

Missouri Certification #: 236

Montana Certification #: Cert 0074

Nebraska Certification: NE-OS-28-14

New Hampshire Certification #: 2958

New Jersey Certification #: FL022

New York Certification #: 11608

North Carolina Environmental Certificate #: 667

North Carolina Certification #: 12710

North Dakota Certification #: R-216

Ohio DEP 87780

Oklahoma Certification #: D9947

Pennsylvania Certification #: 68-00547

Puerto Rico Certification #: FL01264

South Carolina Certification: #96042001

Tennessee Certification #: TN02974

Texas Certification: FL NELAC Reciprocity

US Virgin Islands Certification: FL NELAC Reciprocity

Virginia Environmental Certification #: 460165

West Virginia Certification #: 9962C

Wisconsin Certification #: 399079670

Wyoming (EPA Region 8): FL NELAC Reciprocity

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



SAMPLE ANALYTE COUNT

Project: HA00085

Pace Project No.: 35851591

Lab ID	Sample ID	Method	Analysts	Analytes Reported	Laboratory
35851591001	HA00085-01	EPA 200.8	BSL	1	PASI-O
35851591002	HA00085-02	EPA 200.8	BSL	1	PASI-O
35851591003	HA00085-03	EPA 200.8	BSL	1	PASI-O
35851591004	HA00085-04	EPA 200.8	BSL	1	PASI-O
35851591005	HA00085-05	EPA 200.8	BSL	1	PASI-O
35851591006	HA00085-06	EPA 200.8	BSL	1	PASI-O
35851591007	HA00085-07	EPA 200.8	BSL	1	PASI-O
35851591008	HA00085-08	EPA 200.8	BSL	1	PASI-O
35851591009	HA00085-09	EPA 200.8	BSL	1	PASI-O
35851591010	HA00085-10	EPA 200.8	BSL	1	PASI-O
35851591011	HA00085-11	EPA 200.8	BSL	1	PASI-O
35851591012	HA00085-12	EPA 200.8	BSL	1	PASI-O
35851591013	HA00085-13	EPA 200.8	BSL	1	PASI-O
35851591014	HA00085-14	EPA 200.8	BSL	1	PASI-O
35851591015	HA00085-15	EPA 200.8	BSL	1	PASI-O
35851591016	HA00085-16	EPA 200.8	BSL	1	PASI-O
35851591017	HA00085-17	EPA 200.8	BSL	1	PASI-O
35851591018	HA00085-18	EPA 200.8	BSL	1	PASI-O
35851591019	HA00085-19	EPA 200.8	BSL	1	PASI-O

PASI-O = Pace Analytical Services - Ormond Beach

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: HA00085

Pace Project No.: 35851591

Sample: HA00085-01		Lab ID: 35851591001	Collected: 12/22/23 00:43	Received: 01/04/24 10:25	Matrix: Drinking Water			
Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
200.8 MET ICPMS Drinking Water		Analytical Method: EPA 200.8 Pace Analytical Services - Ormond Beach						
Lead	ND	ug/L	1.0	1		01/07/24 18:59	7439-92-1	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: HA00085

Pace Project No.: 35851591

Sample: HA00085-02	Lab ID: 35851591002	Collected: 12/22/23 00:46	Received: 01/04/24 10:25	Matrix: Drinking Water					
Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual	
200.8 MET ICPMS Drinking Water	Analytical Method: EPA 200.8 Pace Analytical Services - Ormond Beach								
Lead	ND	ug/L	1.0	1		01/07/24 19:03	7439-92-1		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: HA00085

Pace Project No.: 35851591

Sample: HA00085-03		Lab ID: 35851591003	Collected: 12/22/23 00:48	Received: 01/04/24 10:25	Matrix: Drinking Water			
Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
200.8 MET ICPMS Drinking Water		Analytical Method: EPA 200.8 Pace Analytical Services - Ormond Beach						
Lead	ND	ug/L	1.0	1		01/07/24 19:07	7439-92-1	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: HA00085

Pace Project No.: 35851591

Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
Sample: HA00085-04								
Lab ID: 35851591004								
Collected: 12/22/23 00:49								
Received: 01/04/24 10:25								
Matrix: Drinking Water								
200.8 MET ICPMS Drinking Water								
Analytical Method: EPA 200.8								
Pace Analytical Services - Ormond Beach								
Lead	ND	ug/L	1.0	1		01/07/24 19:09	7439-92-1	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full, without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: HA00085

Pace Project No.: 35851591

Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
Sample: HA00085-05								
Lab ID: 35851591005								
Collected: 12/22/23 00:50								
Received: 01/04/24 10:25								
Matrix: Drinking Water								
200.8 MET ICPMS Drinking Water								
Analytical Method: EPA 200.8								
Pace Analytical Services - Ormond Beach								
Lead	ND	ug/L	1.0	1		01/07/24 19:10	7439-92-1	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full, without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: HA00085

Pace Project No.: 35851591

Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
Sample: HA00085-06								
Lab ID: 35851591006								
Collected: 12/22/23 00:51								
Received: 01/04/24 10:25								
Matrix: Drinking Water								
200.8 MET ICPMS Drinking Water								
Analytical Method: EPA 200.8								
Pace Analytical Services - Ormond Beach								
Lead	ND	ug/L	1.0	1		01/07/24 19:11	7439-92-1	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full, without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: HA00085

Pace Project No.: 35851591

Sample: HA00085-07		Lab ID: 35851591007	Collected: 12/22/23 00:52	Received: 01/04/24 10:25	Matrix: Drinking Water			
Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
200.8 MET ICPMS Drinking Water		Analytical Method: EPA 200.8 Pace Analytical Services - Ormond Beach						
Lead	ND	ug/L	1.0	1		01/07/24 19:13	7439-92-1	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: HA00085

Pace Project No.: 35851591

Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
Sample: HA00085-08								
Lab ID: 35851591008								
Collected: 12/22/23 00:53								
Received: 01/04/24 10:25								
Matrix: Drinking Water								
200.8 MET ICPMS Drinking Water								
Analytical Method: EPA 200.8								
Pace Analytical Services - Ormond Beach								
Lead	ND	ug/L	1.0	1		01/07/24 19:14	7439-92-1	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: HA00085

Pace Project No.: 35851591

Sample: HA00085-09		Lab ID: 35851591009	Collected: 12/22/23 00:55	Received: 01/04/24 10:25	Matrix: Drinking Water			
Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
200.8 MET ICPMS Drinking Water		Analytical Method: EPA 200.8 Pace Analytical Services - Ormond Beach						
Lead	ND	ug/L	1.0	1		01/07/24 19:16	7439-92-1	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: HA00085
 Pace Project No.: 35851591

Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
Sample: HA00085-10								
Lab ID: 35851591010								
Collected: 12/22/23 00:55 Received: 01/04/24 10:25 Matrix: Drinking Water								
200.8 MET ICPMS Drinking Water	Analytical Method: EPA 200.8 Pace Analytical Services - Ormond Beach							
Lead	ND	ug/L	1.0	1		01/07/24 19:17	7439-92-1	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
 without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: HA00085

Pace Project No.: 35851591

Sample: HA00085-11		Lab ID: 35851591011	Collected: 12/22/23 00:57	Received: 01/04/24 10:25	Matrix: Drinking Water			
Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
200.8 MET ICPMS Drinking Water		Analytical Method: EPA 200.8 Pace Analytical Services - Ormond Beach						
Lead	ND	ug/L	1.0	1		01/07/24 19:18	7439-92-1	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: HA00085

Pace Project No.: 35851591

Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
Sample: HA00085-12								
Lab ID: 35851591012								
Collected: 12/22/23 00:58								
Received: 01/04/24 10:25								
Matrix: Drinking Water								
200.8 MET ICPMS Drinking Water								
Analytical Method: EPA 200.8								
Pace Analytical Services - Ormond Beach								
Lead	ND	ug/L	1.0	1		01/07/24 19:20	7439-92-1	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full, without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: HA00085

Pace Project No.: 35851591

Sample: HA00085-13		Lab ID: 35851591013	Collected: 12/22/23 00:59	Received: 01/04/24 10:25	Matrix: Drinking Water			
Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
200.8 MET ICPMS Drinking Water		Analytical Method: EPA 200.8 Pace Analytical Services - Ormond Beach						
Lead	ND	ug/L	1.0	1		01/07/24 19:24	7439-92-1	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: HA00085

Pace Project No.: 35851591

Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
Sample: HA00085-14								
Lab ID: 35851591014								
Collected: 12/22/23 01:02 Received: 01/04/24 10:25 Matrix: Drinking Water								
200.8 MET ICPMS Drinking Water								
Analytical Method: EPA 200.8								
Pace Analytical Services - Ormond Beach								
Lead	1.2	ug/L	1.0	1		01/07/24 19:26	7439-92-1	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full, without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: HA00085

Pace Project No.: 35851591

Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
Sample: HA00085-15								
Lab ID: 35851591015								
Collected: 12/22/23 01:03 Received: 01/04/24 10:25 Matrix: Drinking Water								
200.8 MET ICPMS Drinking Water	Analytical Method: EPA 200.8 Pace Analytical Services - Ormond Beach							
Lead	ND	ug/L	1.0	1		01/07/24 19:27	7439-92-1	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: HA00085

Pace Project No.: 35851591

Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
Sample: HA00085-16								
Lab ID: 35851591016								
Collected: 12/22/23 01:05 Received: 01/04/24 10:25 Matrix: Drinking Water								
200.8 MET ICPMS Drinking Water	Analytical Method: EPA 200.8 Pace Analytical Services - Ormond Beach							
Lead	ND	ug/L	1.0	1		01/07/24 19:28	7439-92-1	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: HA00085

Pace Project No.: 35851591

Sample: HA00085-17		Lab ID: 35851591017	Collected: 12/22/23 01:06	Received: 01/04/24 10:25	Matrix: Drinking Water			
Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
200.8 MET ICPMS Drinking Water		Analytical Method: EPA 200.8 Pace Analytical Services - Ormond Beach						
Lead	ND	ug/L	1.0	1		01/07/24 19:30	7439-92-1	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: HA00085

Pace Project No.: 35851591

Sample: HA00085-18		Lab ID: 35851591018	Collected: 12/22/23 01:07	Received: 01/04/24 10:25	Matrix: Drinking Water			
Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
200.8 MET ICPMS Drinking Water		Analytical Method: EPA 200.8 Pace Analytical Services - Ormond Beach						
Lead	ND	ug/L	1.0	1		01/07/24 19:31	7439-92-1	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: HA00085

Pace Project No.: 35851591

Sample: HA00085-19		Lab ID: 35851591019	Collected: 12/22/23 01:08	Received: 01/04/24 10:25	Matrix: Drinking Water			
Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
200.8 MET ICPMS Drinking Water		Analytical Method: EPA 200.8 Pace Analytical Services - Ormond Beach						
Lead	ND	ug/L	1.0	1		01/07/24 19:33	7439-92-1	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



QUALITY CONTROL DATA

Project: HA00085

Pace Project No.: 35851591

QC Batch:	978682	Analysis Method:	EPA 200.8
QC Batch Method:	EPA 200.8	Analysis Description:	200.8 MET No Prep Drinking Water
		Laboratory:	Pace Analytical Services - Ormond Beach
Associated Lab Samples:	35851591001, 35851591002, 35851591003, 35851591004, 35851591005, 35851591006, 35851591007, 35851591008, 35851591009, 35851591010, 35851591011, 35851591012, 35851591013, 35851591014, 35851591015, 35851591016, 35851591017, 35851591018, 35851591019		

METHOD BLANK:	5384605	Matrix:	Water
Associated Lab Samples:	35851591001, 35851591002, 35851591003, 35851591004, 35851591005, 35851591006, 35851591007, 35851591008, 35851591009, 35851591010, 35851591011, 35851591012, 35851591013, 35851591014, 35851591015, 35851591016, 35851591017, 35851591018, 35851591019		

Parameter	Units	Blank Result	Reporting Limit	Analyzed	Qualifiers
Lead	ug/L	ND	1.0	01/07/24 19:41	

LABORATORY CONTROL SAMPLE:	5384606					
Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Lead	ug/L	50	50.5	101	85-115	

MATRIX SPIKE & MATRIX SPIKE DUPLICATE:	5384601			5384602							
Parameter	Units	35851591001 Result	MS Spike Conc.	MSD Spike Conc.	MS Result	MSD Result	MS % Rec	MSD % Rec	% Rec Limits	RPD	Qual
Lead	ug/L	ND	50	50	49.4	49.0	99	98	70-130	1	

MATRIX SPIKE & MATRIX SPIKE DUPLICATE:	5384603			5384604							
Parameter	Units	35851600001 Result	MS Spike Conc.	MSD Spike Conc.	MS Result	MSD Result	MS % Rec	MSD % Rec	% Rec Limits	RPD	Qual
Lead	ug/L	7.7	50	50	57.3	56.6	99	98	70-130	1	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full, without the written consent of Pace Analytical Services, LLC.



QUALIFIERS

Project: HA00085

Pace Project No.: 35851591

DEFINITIONS

DF - Dilution Factor, if reported, represents the factor applied to the reported data due to dilution of the sample aliquot.

ND - Not Detected at or above adjusted reporting limit.

TNTC - Too Numerous To Count

MDL - Adjusted Method Detection Limit.

PQL - Practical Quantitation Limit.

RL - Reporting Limit - The lowest concentration value that meets project requirements for quantitative data with known precision and bias for a specific analyte in a specific matrix.

S - Surrogate

1,2-Diphenylhydrazine decomposes to and cannot be separated from Azobenzene using Method 8270. The result for each analyte is a combined concentration.

Consistent with EPA guidelines, unrounded data are displayed and have been used to calculate % recovery and RPD values.

LCS(D) - Laboratory Control Sample (Duplicate)

MS(D) - Matrix Spike (Duplicate)

DUP - Sample Duplicate

RPD - Relative Percent Difference

NC - Not Calculable.

SG - Silica Gel - Clean-Up

U - Indicates the compound was analyzed for, but not detected.

N-Nitrosodiphenylamine decomposes and cannot be separated from Diphenylamine using Method 8270. The result reported for each analyte is a combined concentration.

Reported results are not rounded until the final step prior to reporting. Therefore, calculated parameters that are typically reported as "Total" may vary slightly from the sum of the reported component parameters.

Pace Analytical is TNI accredited. Contact your Pace PM for the current list of accredited analytes.

TNI - The NELAC Institute.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



QUALITY CONTROL DATA CROSS REFERENCE TABLE

Project: HA00085

Pace Project No.: 35851591

Lab ID	Sample ID	QC Batch Method	QC Batch	Analytical Method	Analytical Batch
35851591001	HA00085-01	EPA 200.8	978682		
35851591002	HA00085-02	EPA 200.8	978682		
35851591003	HA00085-03	EPA 200.8	978682		
35851591004	HA00085-04	EPA 200.8	978682		
35851591005	HA00085-05	EPA 200.8	978682		
35851591006	HA00085-06	EPA 200.8	978682		
35851591007	HA00085-07	EPA 200.8	978682		
35851591008	HA00085-08	EPA 200.8	978682		
35851591009	HA00085-09	EPA 200.8	978682		
35851591010	HA00085-10	EPA 200.8	978682		
35851591011	HA00085-11	EPA 200.8	978682		
35851591012	HA00085-12	EPA 200.8	978682		
35851591013	HA00085-13	EPA 200.8	978682		
35851591014	HA00085-14	EPA 200.8	978682		
35851591015	HA00085-15	EPA 200.8	978682		
35851591016	HA00085-16	EPA 200.8	978682		
35851591017	HA00085-17	EPA 200.8	978682		
35851591018	HA00085-18	EPA 200.8	978682		
35851591019	HA00085-19	EPA 200.8	978682		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full, without the written consent of Pace Analytical Services, LLC.

SUBCONTRACT ORDER
Transfer Chain of Custody

Pace Analytical Services, LLC
HA00085

WO#: 35851591



SENDING LABORATORY

PDC Laboratories, Inc.
2231 W Altorfer Dr
Peoria, IL 61615
(800) 752-6651

RECEIVING LABORATORY

Pace Analytical - Ormond Beach
8 East Tower Circle
Ormond Beach, FL 32174
(386) 676-4842

Sample: HA00085-01
Name: JCECC - 1

Sampled: 12/21/23 23:43
Matrix: Drinking Water
Preservative: HNO₃, pH <2

Analysis	Due	Expires	Comments
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 23:43	
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 23:43	

Sample: HA00085-02
Name: JCECC - 2

Sampled: 12/21/23 23:46
Matrix: Drinking Water
Preservative: HNO₃, pH <2

Analysis	Due	Expires	Comments
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 23:46	
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 23:46	

Sample: HA00085-03
Name: JCECC - 3

Sampled: 12/21/23 23:48
Matrix: Drinking Water
Preservative: HNO₃, pH <2

Analysis	Due	Expires	Comments
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 23:48	
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 23:48	

Sample: HA00085-04
Name: JCECC - 4

Sampled: 12/21/23 23:49
Matrix: Drinking Water
Preservative: HNO₃, pH <2

Analysis	Due	Expires	Comments
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 23:49	
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 23:49	

SUBCONTRACT ORDER
Transfer Chain of Custody
Pace Analytical Services, LLC
HA00085

SENDING LABORATORY

PDC Laboratories, Inc.
 2231 W Altorfer Dr
 Peoria, IL 61615
 (800) 752-6651

RECEIVING LABORATORY

Pace Analytical - Ormond Beach
 8 East Tower Circle
 Ormond Beach, FL 32174
 (386) 676-4842

Sample: HA00085-05
Name: JCECC - 5

Sampled: 12/21/23 23:50
Matrix: Drinking Water
Preservative: HNO3, pH <2

Analysis	Due	Expires	Comments
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 23:50	
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 23:50	

Sample: HA00085-06
Name: JCECC - 6

Sampled: 12/21/23 23:51
Matrix: Drinking Water
Preservative: HNO3, pH <2

Analysis	Due	Expires	Comments
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 23:51	
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 23:51	

Sample: HA00085-07
Name: JCECC - 7

Sampled: 12/21/23 23:52
Matrix: Drinking Water
Preservative: HNO3, pH <2

Analysis	Due	Expires	Comments
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 23:52	
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 23:52	

Sample: HA00085-08
Name: JCECC - 8

Sampled: 12/21/23 23:53
Matrix: Drinking Water
Preservative: HNO3, pH <2

Analysis	Due	Expires	Comments
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 23:53	
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 23:53	

SUBCONTRACT ORDER
Transfer Chain of Custody
Pace Analytical Services, LLC
HA00085

SENDING LABORATORY

PDC Laboratories, Inc.
 2231 W Altorfer Dr
 Peoria, IL 61615
 (800) 752-6651

RECEIVING LABORATORY

Pace Analytical - Ormond Beach
 8 East Tower Circle
 Ormond Beach, FL 32174
 (386) 676-4842

Sample: HA00085-09
Name: JCECC - 9

Sampled: 12/21/23 23:55
Matrix: Drinking Water
Preservative: HNO₃, pH <2

Analysis	Due	Expires	Comments
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 23:55	
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 23:55	

Sample: HA00085-10
Name: JCECC - 10

Sampled: 12/21/23 23:55
Matrix: Drinking Water
Preservative: HNO₃, pH <2

Analysis	Due	Expires	Comments
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 23:55	
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 23:55	

Sample: HA00085-11
Name: JCECC - 11

Sampled: 12/21/23 23:57
Matrix: Drinking Water
Preservative: HNO₃, pH <2

Analysis	Due	Expires	Comments
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 23:57	
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 23:57	

Sample: HA00085-12
Name: JCECC - 12

Sampled: 12/21/23 23:58
Matrix: Drinking Water
Preservative: HNO₃, pH <2

Analysis	Due	Expires	Comments
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 23:58	
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 23:58	

**SUBCONTRACT ORDER
Transfer Chain of Custody**

Pace Analytical Services, LLC

HA00085

SENDING LABORATORY

PDC Laboratories, Inc.
2231 W Altorfer Dr
Peoria, IL 61615
(800) 752-6651

RECEIVING LABORATORY

Pace Analytical - Ormond Beach
8 East Tower Circle
Ormond Beach, FL 32174
(386) 676-4842

Sample: HA00085-13
Name: JCECC - 13

Sampled: 12/22/23 23:59
Matrix: Drinking Water
Preservative: HNO₃, pH <2

Analysis	Due	Expires	Comments
01-Pb 200.8 DW Schools	01/15/24 16:00	06/19/24 23:59	
01-Pb 200.8 DW Schools	01/15/24 16:00	06/19/24 23:59	

Sample: HA00085-14
Name: JCECC - 14

Sampled: 12/22/23 00:02
Matrix: Drinking Water
Preservative: HNO₃, pH <2

Analysis	Due	Expires	Comments
01-Pb 200.8 DW Schools	01/15/24 16:00	06/19/24 00:02	
01-Pb 200.8 DW Schools	01/15/24 16:00	06/19/24 00:02	

Sample: HA00085-15
Name: JCECC - 15

Sampled: 12/22/23 00:03
Matrix: Drinking Water
Preservative: HNO₃, pH <2

Analysis	Due	Expires	Comments
01-Pb 200.8 DW Schools	01/15/24 16:00	06/19/24 00:03	
01-Pb 200.8 DW Schools	01/15/24 16:00	06/19/24 00:03	

Sample: HA00085-16
Name: JCECC - 16

Sampled: 12/22/23 00:05
Matrix: Drinking Water
Preservative: HNO₃, pH <2

Analysis	Due	Expires	Comments
01-Pb 200.8 DW Schools	01/15/24 16:00	06/19/24 00:05	
01-Pb 200.8 DW Schools	01/15/24 16:00	06/19/24 00:05	

**SUBCONTRACT ORDER
Transfer Chain of Custody**

Pace Analytical Services, LLC

HA00085

SENDING LABORATORY

PDC Laboratories, Inc.
2231 W Altorfer Dr
Peoria, IL 61615
(800) 752-6651

RECEIVING LABORATORY

Pace Analytical - Ormond Beach
8 East Tower Circle
Ormond Beach, FL 32174
(386) 676-4842

Sample: HA00085-17
Name: JCECC - 17

Sampled: 12/22/23 00:06
Matrix: Drinking Water
Preservative: HNO3, pH <2

Analysis	Due	Expires	Comments
01-Pb 200.8 DW Schools	01/15/24 16:00	06/19/24 00:06	
01-Pb 200.8 DW Schools	01/15/24 16:00	06/19/24 00:06	

Sample: HA00085-18
Name: JCECC - 18

Sampled: 12/22/23 00:07
Matrix: Drinking Water
Preservative: HNO3, pH <2

Analysis	Due	Expires	Comments
01-Pb 200.8 DW Schools	01/15/24 16:00	06/19/24 00:07	
01-Pb 200.8 DW Schools	01/15/24 16:00	06/19/24 00:07	

Sample: HA00085-19
Name: JCECC - 19

Sampled: 12/22/23 00:08
Matrix: Drinking Water
Preservative: HNO3, pH <2

Analysis	Due	Expires	Comments
01-Pb 200.8 DW Schools	01/15/24 16:00	06/19/24 00:08	
01-Pb 200.8 DW Schools	01/15/24 16:00	06/19/24 00:08	

SUBCONTRACT ORDER
Transfer Chain of Custody


Pace Analytical Services, LLC

HA00085

Please email results to Chenise Lambert-Sykes at Chenise.Lambert-Sykes@pacelabs.com

Date Shipped: 1/3/24 Total # of Containers: 19 Sample Origin (State): _____ PO #: _____

Turn-Around Time Requested NORMAL RUSH Date Results Needed: 1/14/24

Relinquished By	Date/Time	Received By	Date/Time	Sample Temperature Upon Receipt	_____ °C
	<u>1/3/24 1438</u>	<u>2ms IM</u> <u>1/14/24 2ms, trace</u>	<u>1/14/24 1225</u>	Sample(s) Received on Ice	Y or N
				Proper Bottles Received in Good Condition	Y or N
				Bottles Filled with Adequate Volume	Y or N
				Samples Received Within Hold Time	Y or N
Relinquished By	Date/Time	Received By	Date/Time	Date/Time Taken From Sample Bottle	Y or N

Pace

Sample Condition Upon Receipt Form (SCUR)

Project #
Project Manager:
Client:

WO#: 35851591
PM: BTS Due Date: 01/11/24
CLIENT: PACHAZ

Date and Initials of person:

Examining contents:

Label:

Deliver: NP/FTSI

pH:

Initials: ZRB

Thermometer Used: T-409

Date: 1/4/24

Time: 1027

State of Origin:

For WV projects, all containers verified to ±0.5 °C

Cooler #1 Temp. °C	13.7 (Visual)	-0.1 (Correction Factor)	13.6 (Actual)
Cooler #2 Temp. °C	13.5 (Visual)	(Correction Factor)	13.4 (Actual)
Cooler #3 Temp. °C	14.8 (Visual)	(Correction Factor)	14.7 (Actual)
Cooler #4 Temp. °C	15.3 (Visual)	(Correction Factor)	15.2 (Actual)
Cooler #5 Temp. °C	16.0 (Visual)	(Correction Factor)	15.9 (Actual)
Cooler #6 Temp. °C	15.7 (Visual)	(Correction Factor)	15.6 (Actual)
Recheck for OOT °C	14.4 (Visual)	(Correction Factor)	14.3 (Actual)

- Samples on ice, cooling process has begun.
- Samples on ice, cooling process has begun.
- Samples on ice, cooling process has begun.
- Samples on ice, cooling process has begun.
- Samples on ice, cooling process has begun.
- Samples on ice, cooling process has begun.

Courier: Fed Ex UPS USPS Client Commercial Pace Other:

Shipping Method: Standard Overnight First Overnight Priority Overnight Ground International Priority

Billing: Recipient Sender Third Party Credit Card Unknown

Tracking # 700378109884

Custody Seal Present: Yes No Seal properly placed and intact: Yes No

Packing Material: Bubble Wrap Bubble Bags None Other:

Ice: Wet Blue Dry None Melted

Samples shorted to lab: Yes No (if yes, complete the following)

Shorted Date:

Bottle Quantity / Type:

Shorted Time:

Chain of Custody: Present: Yes No | Filled Out: Yes No N/A | Sampler Name: Yes No N/A

Relinquished To Pace: Yes No N/A | Sampling Date(s): Yes No N/A | Sampling Time(s): Yes No N/A

- Samples Arrived within Hold Time: Yes No N/A
- Rush Turnaround Requested on COC: Yes No N/A
- Sufficient Volume: Yes No N/A
- Correct Containers Used: Yes No N/A
- Containers Intact: Yes No N/A
- Sample Labels Match COC (Sample ID, Date/Time of Collection): Yes No N/A
- Containers needing acid / base preservation have been checked: Yes No N/A

Containers needing preservation are found to be in compliance with recommendation: Yes No N/A

Exceptions: Vials, Microbiology, O&G, PFAS

Space in Volatile Vials? (>6mm): Yes No N/A

Blank Present: Yes No N/A

Comments / Resolutions (use back for additional comments):

Preservative: _____		Date: _____	
Lot / Trace: _____		Time: _____	
Amount added (mL): _____		Initials: _____	



Sample Condition Upon Receipt Form (SCUR)

Project #
Project Manager:
Client:

1025

Date and Initials of person:

Examining contents: _____

Label: _____

Deliver: N/A

pH: _____

Initials: ZNB

Thermometer Used: T-409

Date: 1/14/24

Time: 1027

State of Origin: _____

For WV projects, all containers verified to ≤6 °C

Cooler #1 Temp. °C 16.4 (Visual) -0.1 (Correction Factor) 16.3 (Actual)

Cooler #2 Temp. °C 17.2 (Visual) _____ (Correction Factor) 17.1 (Actual)

Cooler #3 Temp. °C 15.6 (Visual) _____ (Correction Factor) 15.5 (Actual)

Cooler #4 Temp. °C 14.5 (Visual) _____ (Correction Factor) 14.4 (Actual)

Cooler #5 Temp. °C 15.8 (Visual) _____ (Correction Factor) 15.7 (Actual)

Cooler #6 Temp. °C 16.3 (Visual) _____ (Correction Factor) 16.2 (Actual)

Recheck for OOT °C _____ (Visual) _____ (Correction Factor) _____ (Actual)

- Samples on ice, cooling process has begun.
- Samples on ice, cooling process has begun.
- Samples on ice, cooling process has begun.
- Samples on ice, cooling process has begun.
- Samples on ice, cooling process has begun.
- Samples on ice, cooling process has begun.

Time: _____ Initials: _____

Courier: Fed Ex UPS USPS Client Commercial Pace Other: _____

Shipping Method: Standard Overnight First Overnight Priority Overnight Ground International Priority Other: _____

Billing: Recipient Sender Third Party Credit Card Unknown

Tracking # _____

Custody Seal Present: Yes No Seal properly placed and intact: Yes No

Ice: Wet Blue Dry None Melted

Packing Material: Bubble Wrap Bubble Bags None Other: _____

Samples shorted to lab: Yes No (If yes, complete the following)

Shorted Date: _____

Shorted Time: _____

Bottle Quantity / Type: _____

Chain of Custody:	Present: <input type="checkbox"/> Yes <input type="checkbox"/> No Filled Out: <input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A Sampler Name: <input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A														
	Relinquished To Pace: <input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A Sampling Date(s): <input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A Sampling Time(s): <input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A														
Samples Arrived within Hold Time.	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	Comments:													
Rush Turnaround Requested on COC.	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	Comments:													
Sufficient Volume.	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	Comments:													
Correct Containers Used.	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	Comments:													
Containers Intact.	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	Comments:													
Sample Labels Match COC (Sample ID, Date/Time of Collection).	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	Comments:													
All containers needing acid / base preservation have been checked.	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	<table border="1"> <tr> <th colspan="3">Preservation Information</th> </tr> <tr> <td>Preservative: _____</td> <td>Date: _____</td> <td></td> </tr> <tr> <td>Lot / Trace: _____</td> <td>Time: _____</td> <td></td> </tr> <tr> <td>Amount added (mL): _____</td> <td>Initials: _____</td> <td></td> </tr> </table>		Preservation Information			Preservative: _____	Date: _____		Lot / Trace: _____	Time: _____		Amount added (mL): _____	Initials: _____	
Preservation Information															
Preservative: _____	Date: _____														
Lot / Trace: _____	Time: _____														
Amount added (mL): _____	Initials: _____														
All containers needing preservation are found to be in compliance with EPA recommendation: <small>Exceptions: Vials, Microbiology, O&G, PFAS</small>	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A														
Headspace in Volatile Vials? (>6mm):	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A														
Trip Blank Present:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A														

Comments / Resolutions (use back for additional comments):

Sample Condition Upon Receipt Form (SCUR)



Project #
Project Manager:
Client:

WO#: 35851591
PM: BTS Due Date: 01/11/24
CLIENT: PACHAZ

Date and Initials of person:

Examining contents:

Label:

Deliver: NO

pH:

Initials: ZNS

Thermometer Used: T-409

Date: 1/4/24

Time: 1027

State of Origin:

For WV projects, all containers verified to 56 °C

Cooler #1 Temp. °C 4.9 (Visual) 0.1 (Correction Factor) 14.8 (Actual)

Cooler #2 Temp. °C 15.9 (Visual) (Correction Factor) 15.8 (Actual)

Cooler #3 Temp. °C 13.7 (Visual) (Correction Factor) 13.6 (Actual)

Cooler #4 Temp. °C 14.2 (Visual) (Correction Factor) 14.1 (Actual)

Cooler #5 Temp. °C 14.9 (Visual) (Correction Factor) 14.7 (Actual)

Cooler #6 Temp. °C 15.1 (Visual) (Correction Factor) 15.0 (Actual)

Recheck for OOT °C 16.2 (Visual) (Correction Factor) 16.1 (Actual)

Samples on ice, cooling process has begun.

Samples on ice, cooling process has begun.

Samples on ice, cooling process has begun.

Samples on ice, cooling process has begun.

Samples on ice, cooling process has begun.

Samples on ice, cooling process has begun.

Time: _____ Initials: _____

Courier: Fed Ex UPS USPS Client Commercial Pace Other:

Shipping Method: Standard Overnight First Overnight Priority Overnight Ground International Priority Other:

Billing: Recipient Sender Third Party Credit Card Unknown

Tracking #

Custody Seal Present: Yes No Seal properly placed and intact: Yes No

Ice: Wet Blue Dry None Melted

Packing Material: Bubble Wrap Bubble Bags None Other:

Samples shorted to lab: Yes No (if yes, complete the following)

Shorted Date:

Shorted Time:

Bottle Quantity / Type:

Chain of Custody:	Present: <input type="checkbox"/> Yes <input type="checkbox"/> No Filled Out: <input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A Sampler Name: <input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A								
	Relinquished To Pace: <input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A Sampling Date(s): <input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A Sampling Time(s): <input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A								
Samples Arrived within Hold Time.	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A Comments:								
Rush Turnaround Requested on COC	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A Comments:								
Sufficient Volume	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A Comments:								
Correct Containers Used	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A Comments:								
Containers Intact	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A Comments:								
Sample Labels Match COC: (Sample ID, Date/Time of Collection)	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A Comments:								
All containers needing acid / base preservation have been checked.	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A								
All containers needing preservation are found to be in compliance with EPA recommendation:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A								
Exceptions: Vials, Microbiology, O&G, PFAS									
Headspace in Volatile Vials? (>6mm):	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A								
Trip Blank Present:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A								
<table border="1"> <thead> <tr> <th colspan="2">Preservation Information</th> </tr> </thead> <tbody> <tr> <td>Preservative: _____</td> <td>Date: _____</td> </tr> <tr> <td>Lot / Trace: _____</td> <td>Time: _____</td> </tr> <tr> <td>Amount added (mL): _____</td> <td>Initials: _____</td> </tr> </tbody> </table>		Preservation Information		Preservative: _____	Date: _____	Lot / Trace: _____	Time: _____	Amount added (mL): _____	Initials: _____
Preservation Information									
Preservative: _____	Date: _____								
Lot / Trace: _____	Time: _____								
Amount added (mL): _____	Initials: _____								

Comments / Resolutions (use back for additional comments):

REGULATORY PROGRAM (CIRCLE):	NPDES
MORBCA	RCRA
CCDD	TACO: RES OR IND/COMM

ALL HIGHLIGHTED AREAS MUST BE COMPLETED BY CLIENT (PLEASE PRINT)

1 CLIENT SCI Engineering ADDRESS 130 Point West Blvd CITY STATE ZIP St. Charles, MO 63301 CONTACT PERSON Glen Grissom	PROJECT NUMBER 2016-0860-21	PROJECT LOCATION John Cary LLC	PURCHASE ORDER #	3 ANALYSIS REQUESTED + + DW Pb Turb Check	4 (FOR LAB USE ONLY) LOGIN # <u>1/A00085</u> LOGGED BY: CLIENT: <u>SCI Engineering</u> PROJECT: <u>Drinking Water Lead</u> PROJ. MGR.: <u>Chenise Lambert-Sykes</u> CUSTODY SEAL #:
	PHONE NUMBER (314) 581-7570	E-MAIL ggriissom@sciengineering.com	DATE SHIPPED		
	SAMPLER (PLEASE PRINT) Dan Vrelwicker	MATRIX TYPES: WW- WASTEWATER DW- DRINKING WATER GW- GROUND WATER WWSL- SLUDGE NAS- NON AQUEOUS SOLID LCHL- LEACHATE OIL-OIL SO-SOIL SOL-SOLID			
	SAMPLER'S SIGNATURE 				

2 SAMPLE DESCRIPTION (UNIQUE DESCRIPTION AS IT WILL APPEAR ON THE ANALYTICAL REPORT)	DATE COLLECTED	TIME COLLECTED	SAMPLE TYPE		MATRIX TYPE	BOTTLE COUNT	PRES CODE CLIENT PROVIDED	DW	Pb	Turb	Check	REMARKS
			GRAB	COMP								
JCECC-1	12-21-23	2343	X		DW	1	6	X	X			
JCECC-2		2346						X	X			
JCECC-3		2348						X	X			
JCECC-4		2349						X	X			
JCECC-5		2350						X	X			
JCECC-6		2351						X	X			
JCECC-7		2352						X	X			
JCECC-8		2353						X	X			
JCECC-9		2355						X	X			
JCECC-10		2355						X	X			
JCECC-11		2357						X	X			

CHEMICAL PRESERVATION CODES: 1 - HCL 2 - H2SO4 3 - HNO3 4 - NAOH 5 - NA2S2O3 6 - UNPRESERVED 7 - OTHER

5 TURNAROUND TIME REQUESTED (PLEASE CIRCLE) (RUSH TAT IS SUBJECT TO PACE LABS APPROVAL AND SURCHARGE) NORMAL <input checked="" type="radio"/> RUSH <input type="radio"/> RUSH RESULTS VIA (PLEASE CIRCLE) EMAIL PHONE EMAIL IF DIFFERENT FROM ABOVE: PHONE # IF DIFFERENT FROM ABOVE:	DATE RESULTS NEEDED	6 I understand that by initialing this box I give the lab permission to proceed with analysis, even though it may not meet all sample conformance requirements as defined in the receiving facility's Sample Acceptance Policy and the data will be qualified. Qualified data may NOT be acceptable to report to all regulatory authorities. PROCEED WITH ANALYSIS AND QUALIFY RESULTS: (INITIALS)
--	---------------------	--

7 RELINQUISHED BY: (SIGNATURE) DATE 12/29/23 TIME 4:00pm RELINQUISHED BY: (SIGNATURE) DATE 1/2/24 TIME 8:05 RELINQUISHED BY: (SIGNATURE) DATE 1-2-24 TIME 1535	RECEIVED BY: (SIGNATURE) DATE 12/29/23 TIME 1640 RECEIVED BY: (SIGNATURE) DATE 1-2-24 TIME 1020 RECEIVED BY: (SIGNATURE) DATE 1/2/24 TIME 1535	8 COMMENTS: (FOR LAB USE ONLY) SAMPLE TEMPERATURE UPON RECEIPT <u>22.4</u> °C IR 5 CHILL PROCESS STARTED PRIOR TO RECEIPT Y OR N SAMPLE(S) RECEIVED ON ICE Y OR N SAMPLE ACCEPTANCE NONCONFORMANT REPORT IS NEEDED Y OR N DATE AND TIME TAKEN FROM SAMPLE BOTTLE
---	--	---

REGULATORY PROGRAM (CIRCLE):	NPDES
MORBCA	RCRA
CCDD	TACO: RES OR IND/COMM

CHAIN OF CUSTODY RECORD

STATE WHERE SAMPLE COLLECTED MO

ALL HIGHLIGHTED AREAS MUST BE COMPLETED BY CLIENT (PLEASE PRINT)

1 CLIENT SCI Engineering	PROJECT NUMBER 2016-0860-21	PROJECT LOCATION John Cary ELL	PURCHASE ORDER #	3 ANALYSIS REQUESTED	4 (FOR LAB USE ONLY)
ADDRESS 130 Point West Blvd	PHONE NUMBER (314) 581-7570	E-MAIL ggrissom@sciengineering.com	DATE SHIPPED	<input checked="" type="checkbox"/> DW Pb <input checked="" type="checkbox"/> Turb Check	LOGIN # <u>HA00085</u>
CITY STATE ZIP St. Charles, MO 63301	SAMPLER (PLEASE PRINT) Dan Vrelwicker	MATRIX TYPES: <small> WW- WASTEWATER DW- DRINKING WATER GW- GROUND WATER WWSL- SLUDGE NAS- NON AQUEOUS SOLID LCL- LEACHATE OIL-OIL SO-SOIL SOL-SOLID </small>			LOGGED BY: _____
CONTACT PERSON Glen Grissom	SAMPLER'S SIGNATURE <i>[Signature]</i>				CLIENT: <u>SCI Engineering</u>
					PROJECT: <u>Drinking Water Lead</u>
					PROJ. MGR.: <u>Chenise Lambert-Sykes</u>
					CUSTODY SEAL #: _____

2 SAMPLE DESCRIPTION (UNIQUE DESCRIPTION AS IT WILL APPEAR ON THE ANALYTICAL REPORT)	DATE COLLECTED	TIME COLLECTED	SAMPLE TYPE		MATRIX TYPE	BOTTLE COUNT	PRES CODE CLIENT PROVIDED	DW Pb	Turb Check	REMARKS
			GRAB	COMP						
JLELL-12	12-21-23	2358	X		DW	1	6	X	X	
JLELL-13	↓	2359						X	X	
JLELL-14	12-22-23	0002						X	X	
JLELL-15		0003						X	X	
JLELL-16		0005						X	X	
JLELL-17		0006						X	X	
JLELL-18		0007						X	X	
JLELL-19		0008						X	X	

CHEMICAL PRESERVATION CODES: 1-HCL 2-H2SO4 3-HNO3 4-NAOH 5-NA2S2O3 6-UNPRESERVED 7-OTHER

5 TURNAROUND TIME REQUESTED (PLEASE CIRCLE) <small>(RUSH TAT IS SUBJECT TO PACE LABS APPROVAL AND SURCHARGE)</small> <input checked="" type="radio"/> NORMAL <input type="radio"/> RUSH	DATE RESULTS NEEDED	6 I understand that by initialing this box I give the lab permission to proceed with analysis, even though it may not meet all sample conformance requirements as defined in the receiving facility's Sample Acceptance Policy and the data will be qualified. Qualified data may NOT be acceptable to report to all regulatory authorities.
RUSH RESULTS VIA (PLEASE CIRCLE) EMAIL <input type="checkbox"/> PHONE <input type="checkbox"/>		PROCEED WITH ANALYSIS AND QUALIFY RESULTS: (INITIALS) _____
EMAIL IF DIFFERENT FROM ABOVE: _____	PHONE # IF DIFFERENT FROM ABOVE: _____	

7 RELINQUISHED BY: (SIGNATURE) <i>[Signature]</i>	DATE TIME	RECEIVED BY: (SIGNATURE) <i>[Signature]</i>	DATE TIME 12/29/23 1640	8 COMMENTS: (FOR LAB USE ONLY)
RELINQUISHED BY: (SIGNATURE) <i>[Signature]</i>	DATE TIME 1/2/24 8:05	RECEIVED BY: (SIGNATURE) <i>[Signature]</i>	DATE TIME 1-2-24 1920	
RELINQUISHED BY: (SIGNATURE) <i>[Signature]</i>	DATE TIME 1-2-24 1535	RECEIVED BY: (SIGNATURE) <i>[Signature]</i>	DATE TIME 1/2/24 1535	
			SAMPLE TEMPERATURE UPON RECEIPT IR 5 22.4 °C	
			CHILL PROCESS STARTED PRIOR TO RECEIPT Y OR N	
			SAMPLE(S) RECEIVED ON ICE Y OR N	
			SAMPLE ACCEPTANCE NONCONFORMANT REPORT IS NEEDED Y OR N	
			DATE AND TIME TAKEN FROM SAMPLE BOTTLE	

REGULATORY PROGRAM (CIRCLE):	NPDES
MORBCA	RCRA
CCDD	TACO: RES OR IND/COMM

ALL HIGHLIGHTED AREAS MUST BE COMPLETED BY CLIENT (PLEASE PRINT)

1 CLIENT SCI Engineering	PROJECT NUMBER <u>2016-0860-RT</u>	PROJECT LOCATION <u>JB Facilities</u>	PURCHASE ORDER #	3 ANALYSIS REQUESTED <input checked="" type="checkbox"/> DW <input checked="" type="checkbox"/> Pb <input type="checkbox"/> Turb Check	4 (FOR LAB USE ONLY) LOGIN # <u>HA00685</u> LOGGED BY: CLIENT: <u>SCI Engineering</u> PROJECT: <u>Drinking Water Lead</u> PROJ. MGR.: <u>Cherise Lambert-Sykes</u> CUSTODY SEAL #:	
	ADDRESS <u>130 Point West Blvd</u>	PHONE NUMBER <u>(314) 581-7570</u>	E-MAIL <u>ggrissom@sciengineering.com</u>			DATE SHIPPED
	CITY STATE ZIP <u>St. Charles, MO 63301</u>	SAMPLER (PLEASE PRINT) <u>Dan Vrelycher</u>	MATRIX TYPES: WW-WASTEWATER DW-DRINKING WATER GW-GROUND WATER WWSL-SLUDGE NAS-NON AQUEOUS SOLID LCHT-LEACHATE OIL-OIL SO-SOIL SOL-SOLID			
	CONTACT PERSON <u>Glen Grissom</u>	SAMPLER'S SIGNATURE <u>Dan Vrelycher</u>				

2 SAMPLE DESCRIPTION (UNIQUE DESCRIPTION AS IT WILL APPEAR ON THE ANALYTICAL REPORT)	DATE COLLECTED	TIME COLLECTED	SAMPLE TYPE		MATRIX TYPE	BOTTLE COUNT	PRES CODE CLIENT PROVIDED	DW	Pb	Turb	Check	REMARKS
			GRAB	COMP								
JBF-1	12-21-23	2144	X		DW	1	6	X	X			
JBF-2		2155						X	X			
JBF-3		2158						X	X			
JBF-4		2200						X	X			
JBF-5		2201						X	X			

CHEMICAL PRESERVATION CODES: 1 - HCL 2 - H2SO4 3 - HNO3 4 - NAOH 5 - NA2S2O3 6 - UNPRESERVED 7 - OTHER

5 TURNAROUND TIME REQUESTED (PLEASE CIRCLE) <u>NORMAL</u> RUSH	DATE RESULTS NEEDED	6 I understand that by initialing this box I give the lab permission to proceed with analysis, even though it may not meet all sample conformance requirements as defined in the receiving facility's Sample Acceptance Policy and the data will be qualified. Qualified data may <u>NOT</u> be acceptable to report to all regulatory authorities.
RUSH RESULTS VIA (PLEASE CIRCLE) EMAIL PHONE	PROCEED WITH ANALYSIS AND QUALIFY RESULTS: (INITIALS)	
EMAIL IF DIFFERENT FROM ABOVE: PHONE # IF DIFFERENT FROM ABOVE:		

7 RELINQUISHED BY: (SIGNATURE) <u>Dan Vrelycher</u>	DATE <u>12/29/23</u>	RECEIVED BY: (SIGNATURE) <u>Dawn Campbell</u>	8 COMMENTS: (FOR LAB USE ONLY) SAMPLE TEMPERATURE UPON RECEIPT <u>22.4</u> °C CHILL PROCESS STARTED PRIOR TO RECEIPT Y OR N SAMPLE(S) RECEIVED ON ICE Y OR N SAMPLE ACCEPTANCE NONCONFORMANT REPORT IS NEEDED Y OR N DATE AND TIME TAKEN FROM SAMPLE BOTTLE
	TIME <u>4:00pm</u>		
	RELINQUISHED BY: (SIGNATURE) <u>Glen Grissom</u>	DATE <u>1/2/24</u>	
RELINQUISHED BY: (SIGNATURE) <u>Cherise Lambert-Sykes</u>	TIME <u>8:05</u>		
	DATE <u>1-2-24</u>	RECEIVED BY: (SIGNATURE) <u>[Signature]</u>	
	TIME <u>1535</u>		