



SCI ENGINEERING, INC.

EARTH • SCIENCE • SOLUTIONS

GEOTECHNICAL
ENVIRONMENTAL
NATURAL RESOURCES
CULTURAL RESOURCES
CONSTRUCTION SERVICES

April 2, 2024

Michael Gegg
Mehlville School District
3120 Lemay Ferry Road
St. Louis, Missouri 63125

RE: Lead in Drinking Water Report
Buerkle Middle School
623 Buckley Road
St. Louis, Missouri
SCI No. 2016-0860.2T

Dear Michael Gegg:

INTRODUCTION

SCI Engineering, Inc. (SCI) is pleased to submit this report summarizing lead in drinking water sampling activities performed on December 21, 2023. The purpose of the sampling activities was to screen for elevated levels of lead in the drinking water at potable water sources throughout the above-referenced structure.

The drinking water survey is intended to satisfy the requirements for the “Get the Lead Out of School Drinking Water Act” (GTLOSDWA), Section 160.077 administered by the Missouri Department of Health and Senior Services. Potable water sources to be tested were identified by the school district prior to SCI’s field activities.

LIMITATIONS

SCI’s sampling activities were limited to locations identified by the school district. If any additional potable water sources need testing, please contact SCI, and we will make arrangements for sampling these fixtures. Potable water sources that were not sampled will need a sign placed near each fixture informing students and faculty it is not to be used as a drinking water source.

During the course of performing the drinking water sampling of the structure, the north sink in the second floor Home Economics room was non-operational. If this fixture is made operational, it should be sampled or labeled non-potable. SCI was able to sample all other locations identified by the school district.

DRINKING WATER SURVEY

SCI collected “first draw” samples which consisted of collecting a water sample from each fixture or sample location after it remained stagnant for at least eight hours. Prior to sampling, SCI first mobilized

to the site to flush the identified potable water fixtures throughout the structure. Once each fixture was flushed, a sign was placed on the fixture indicating it should not be used. SCI then revisited the site, after a minimum of eight hours, to collect water samples from the fixtures.

SCI collected 53 drinking water samples (BKMS-1 through BKMS-53) from various water fixtures located throughout the structure and submitted them for analytical testing. The drinking water samples were analyzed for total lead by U.S. EPA Method 200.8. SCI collected a minimum of 250 milliliters of water from each location. Sampled water was containerized in laboratory-provided sample containers and shipped to the lab using standard chain-of-custody procedures. Figures depicting the locations of the sampled water fixtures are enclosed.

The drinking water samples were analyzed for lead in accordance with the GTLOSDWA, Section 160.077, which establishes an action level (AL) of 5 parts per billion (ppb). The drinking water samples which exceeded the AL are identified in Table 1, below. SCI collected samples from the science room lab sinks, however, SCI was then informed that the school district did not need these tested and signs will be put up indicating these sinks are non-potable. Therefore, any exceedances from the science room lab sinks are not included in Table 1 below. A copy of the analytical test results and chain-of-custody for all samples is enclosed.

Table 1 – Lead in Drinking Water Results

Sample Number	Sample Location	Sample Description	Result (ppb)
BKMS-3	Room 104 - Workroom	Sink	33.2
BKMS-4	Room 104	North Sink	23.6
BKMS-5	Room 104	South Sink	26.0
BKMS-34	Dishwashing Room	Hand Wash Sink	5.0

CONCLUSION AND RECOMMENDATIONS

As can be seen in Table 1, above, four drinking water samples, not including the science room lab sinks, exceeded the AL. SCI recommends any fixture which exceeds the AL be taken out of service until remediated and follow up testing indicates results less than the AL. Alternatively, if a water fixture is determined not to be a potable drinking water source, signage may be installed indicating the purpose and/or restrictions of the fixture.

According to GTLOSDWA, any water fixtures which exceed the AL shall be remediated prior to August 1, 2024, or the first day on which students will be present in the building, whichever is later. Any replacement fixture shall be lead free, as defined in 40 CFR 143.12.

REPORTING

Within seven business days after receiving this report, the school district shall contact parents and staff via written notification which shall include the following:

- The test results and a summary that explains such results;
- A description of any remedial steps taken;

- A description of general health effects of lead contamination and community specific resources; and
- If there is not enough water to meet the drinking water needs of the students, teachers and staff, bottled water shall be provided.

Additionally, within two weeks of receiving this report, the results and any lead remediation plans must be made available on the school's website.

This report, and subsequent annual testing reports, must be submitted to the Missouri Department of Health and Senior Services, Healthy Drinking Water Unit, PO Box 570, Jefferson City, MO 65102-0570.


FUTURE TESTING

After the fixtures identified in Table 1, above, have been remediated, at least 25 percent of the remediated fixtures must be sampled annually until all remediated sources have been tested. However, SCI recommends all fixtures be tested once they have been remediated. Once all fixtures have been tested and are below the action level, the school shall test the potable drinking water fixtures once every five years.

SCI appreciates the opportunity to be of service to you on this project, and we look forward to working with you in the future. Please contact us if you have any questions or comments regarding the information provided.

Respectfully,

SCI ENGINEERING, INC.



Brian L. Lieb
Project Scientist




Jessica B. Keeven, CHMM
Senior Scientist

BLL/JBK/rah

Enclosure

Lead Drinking Water Sampling Plan
Lead Testing Results

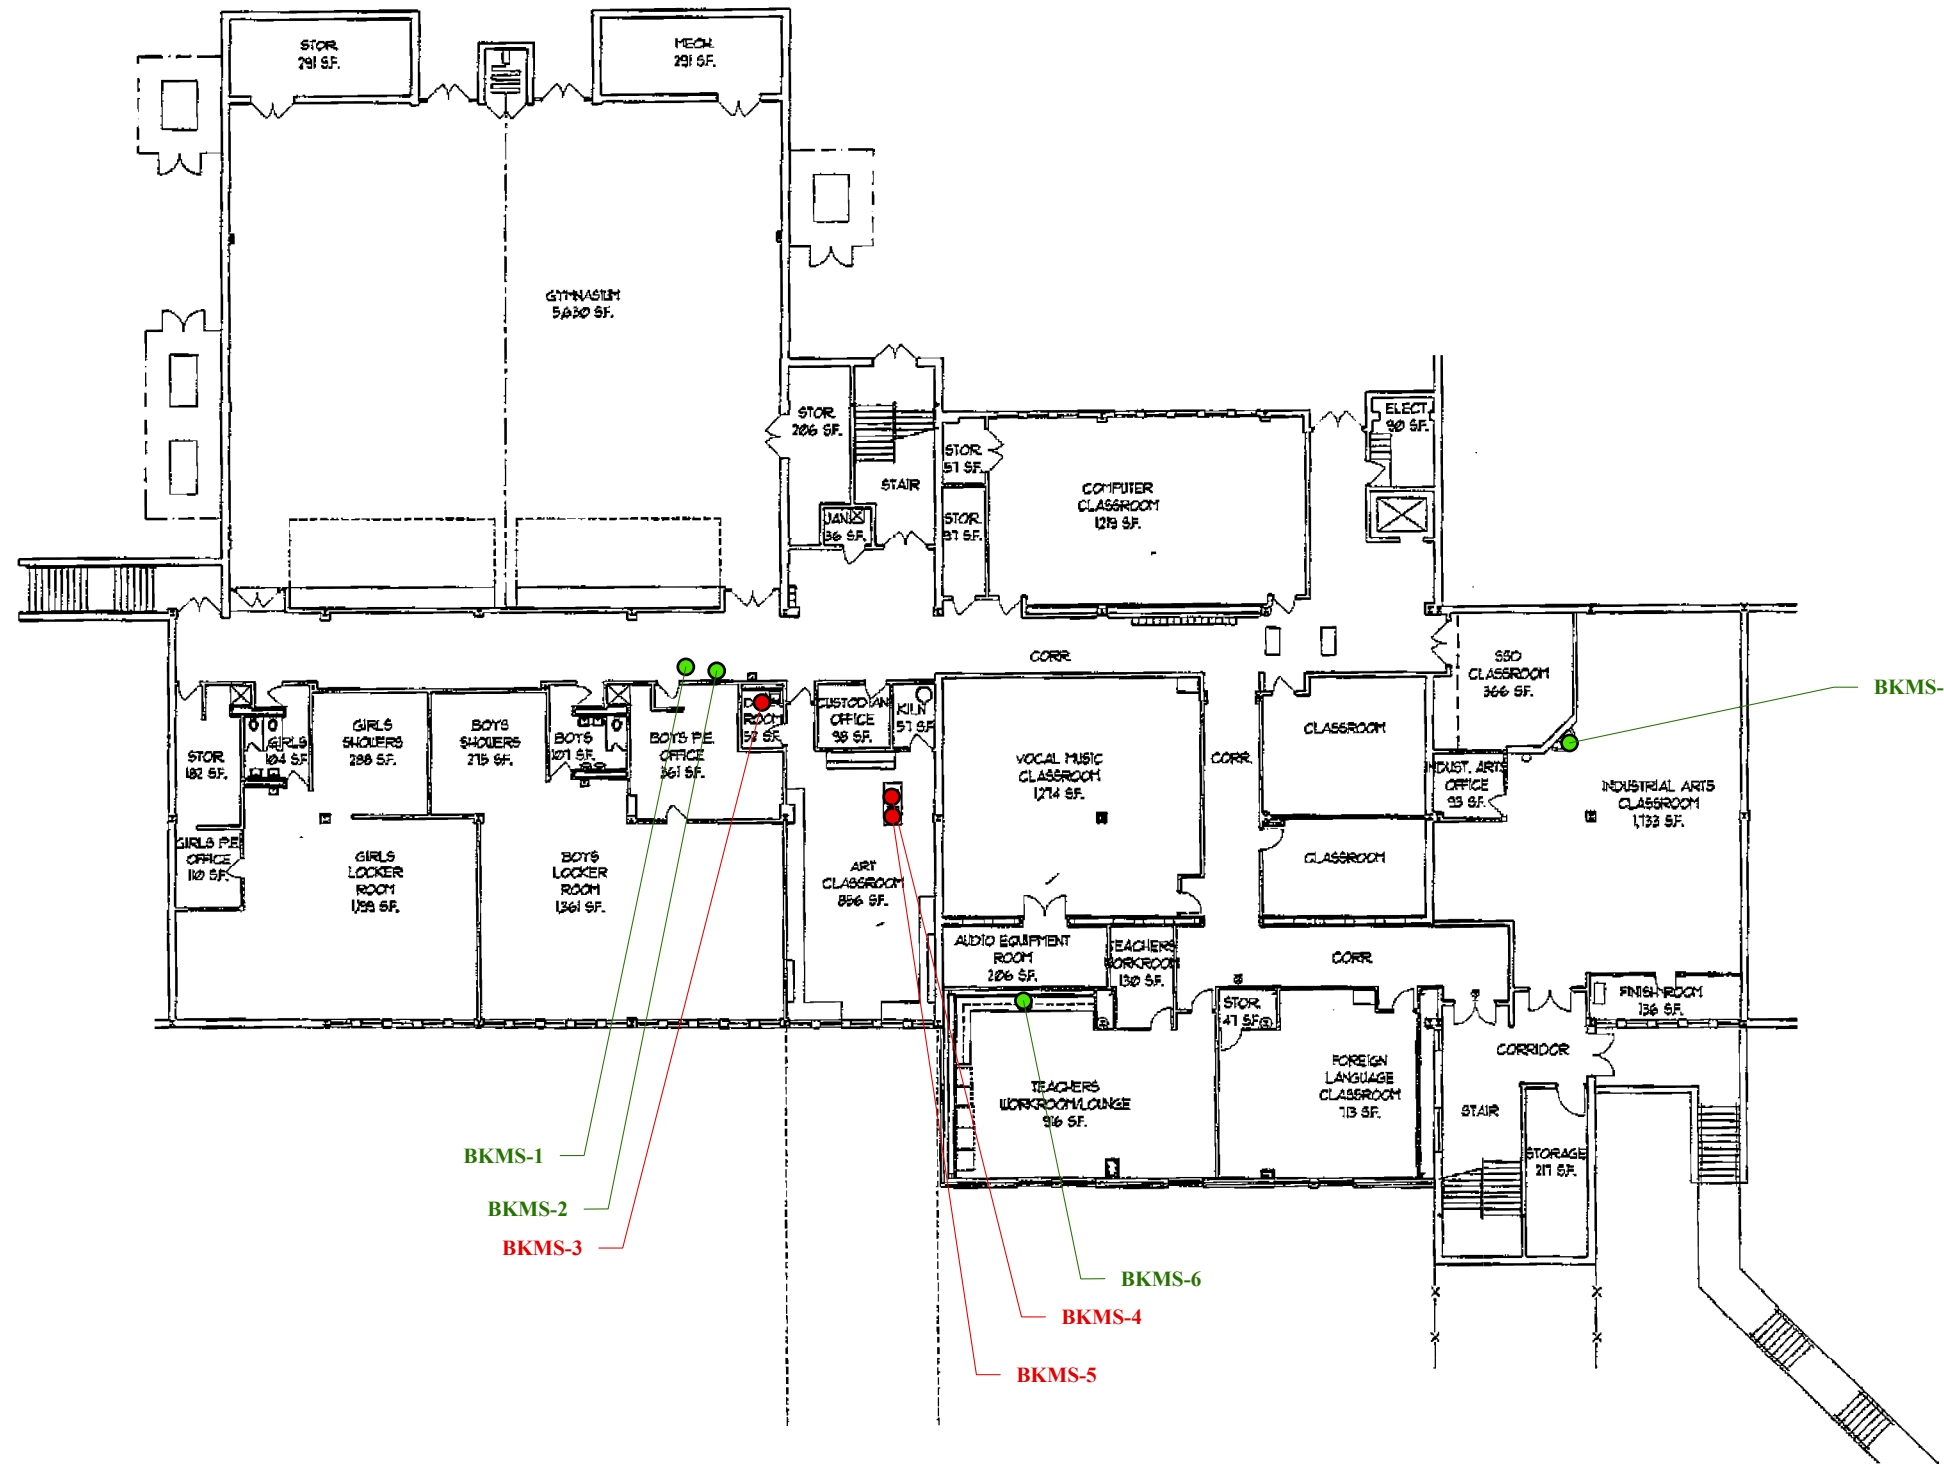

GENERAL NOTES/LEGEND

- RESULTS GREATER THAN THE ACTION LEVEL OF 5 PARTS PER BILLION
- RESULTS LESS THAN THE ACTION LEVEL OF 5 PARTS PER BILLION


FLOOR PLANS PROVIDED BY MEHLVILLE SCHOOL DISTRICT. DIMENSIONS AND LOCATIONS ARE APPROXIMATE; ACTUAL MAY VARY. DRAWING SHALL NOT BE USED OUTSIDE THE CONTEXT OF THE REPORT FOR WHICH IT WAS GENERATED.


PROJECT NAME
 MEHLVILLE SCHOOL DISTRICT
 BUERKLE MIDDLE SCHOOL - 1ST FLOOR
 ST. LOUIS, MISSOURI

LEAD DRINKING WATER SAMPLING PLAN



JOB NUMBER	2016-0860.2T
FIGURE DATE	02/22/2024
DRAWN BY	JTM
CHECKED BY	BLL
FIGURE	1



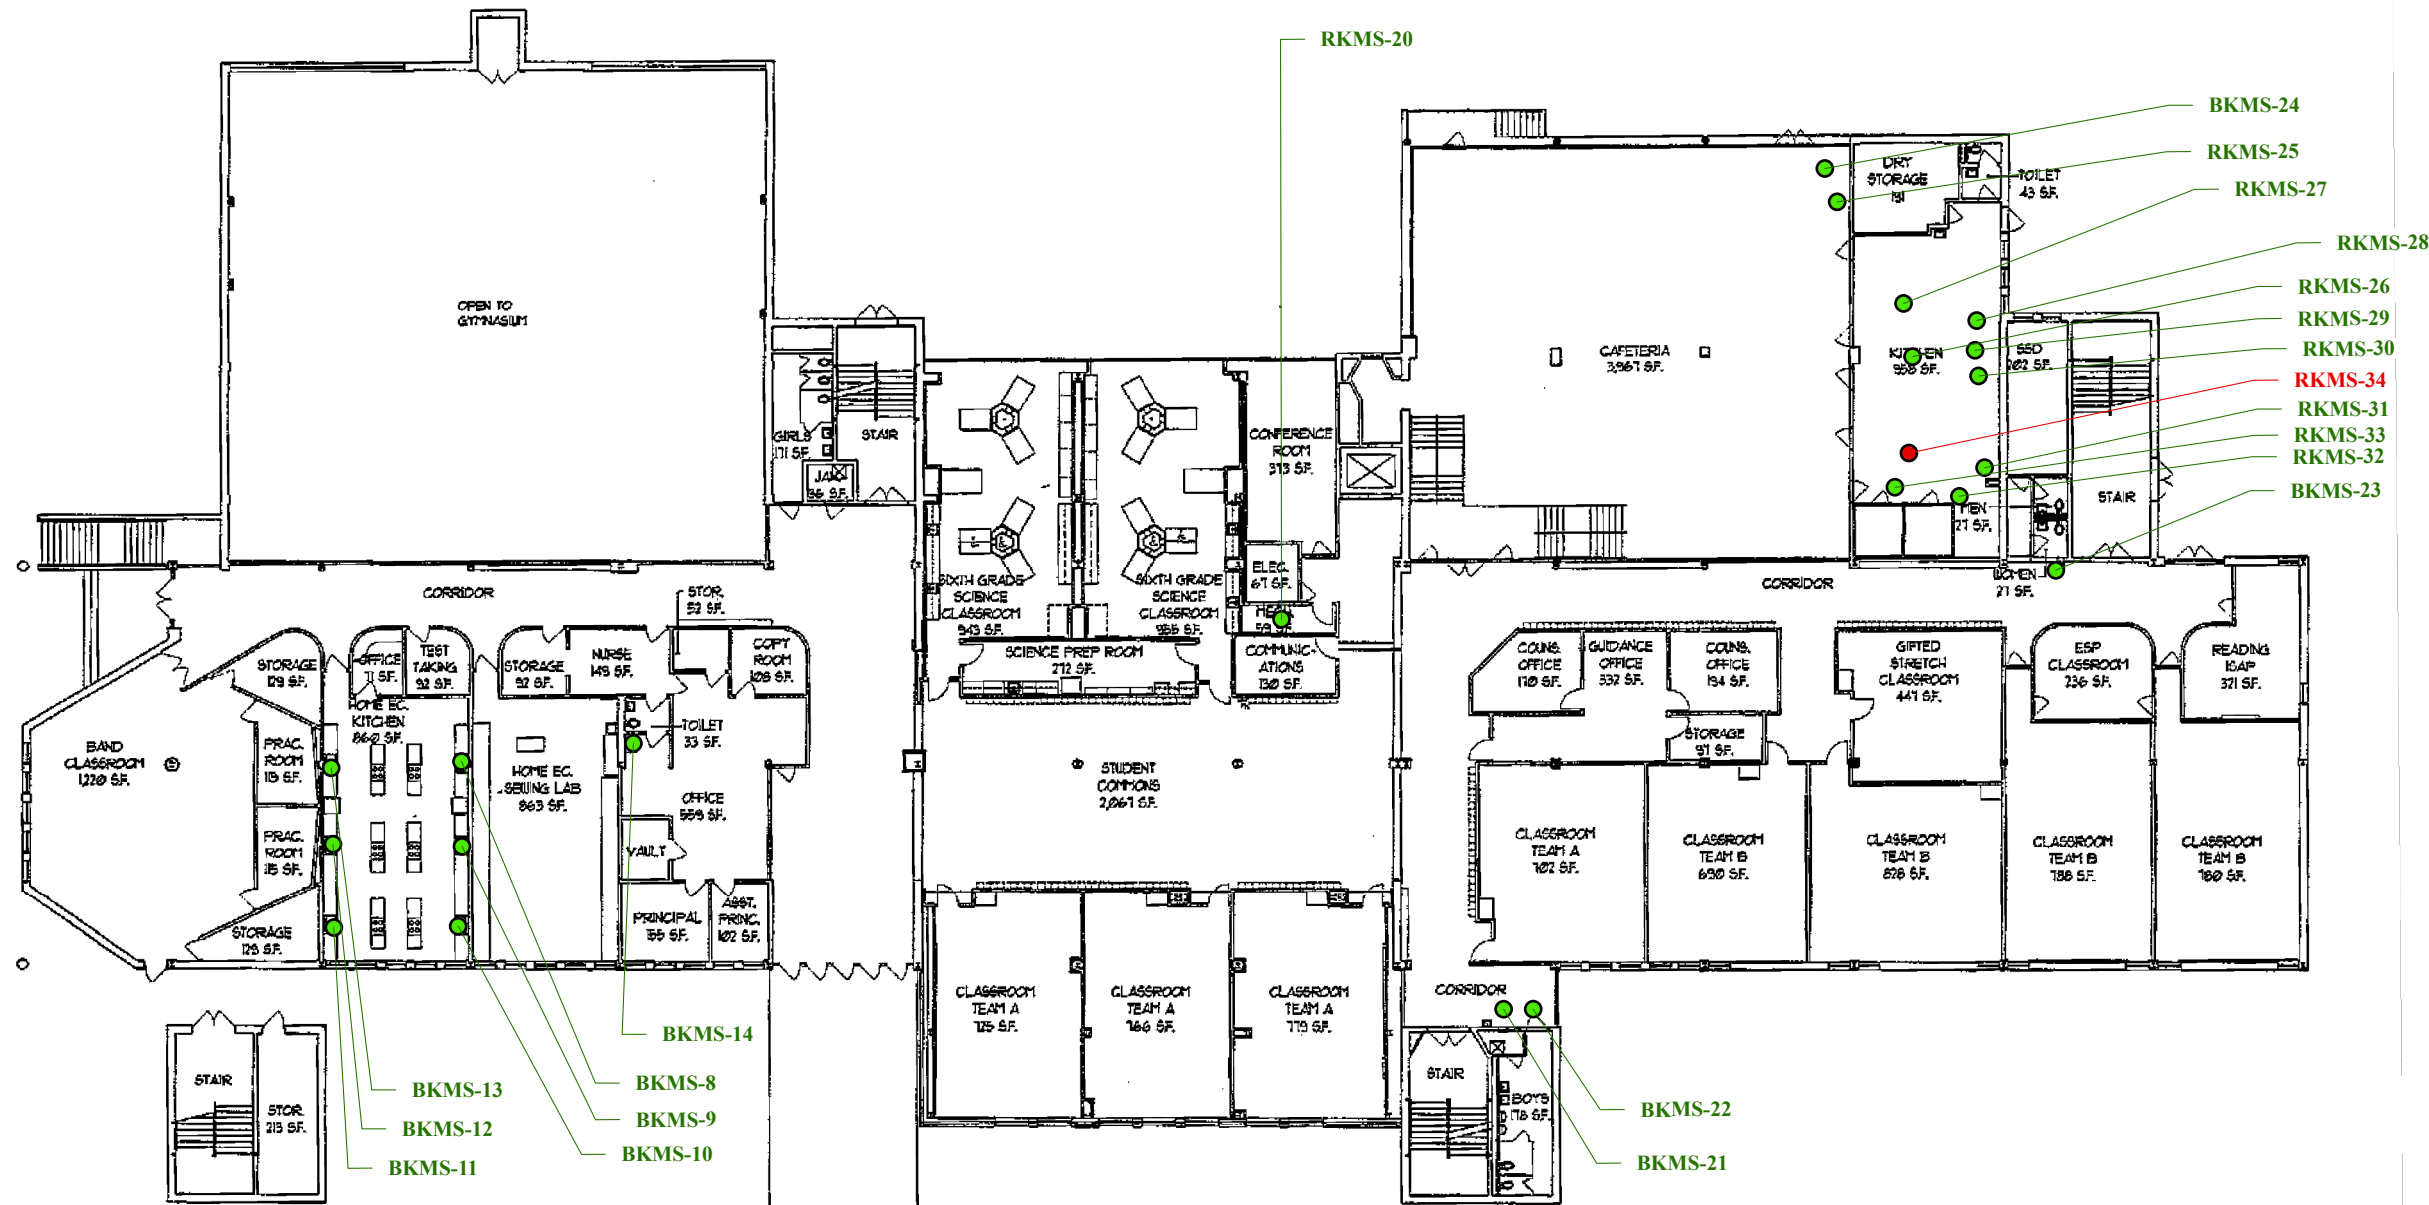


GENERAL NOTES/LEGEND

- RESULTS GREATER THAN THE ACTION LEVEL OF 5 PARTS PER BILLION
- RESULTS LESS THAN THE ACTION LEVEL OF 5 PARTS PER BILLION

FLOOR PLANS PROVIDED BY MEHLVILLE SCHOOL DISTRICT. DIMENSIONS AND LOCATIONS ARE APPROXIMATE; ACTUAL MAY VARY. DRAWING SHALL NOT BE USED OUTSIDE THE CONTEXT OF THE REPORT FOR WHICH IT WAS GENERATED.

PROJECT NAME
 MEHLVILLE SCHOOL DISTRICT
 BUERKLE MIDDLE SCHOOL - 2ND FLOOR
 ST. LOUIS, MISSOURI

LEAD DRINKING WATER SAMPLING PLAN




JOB NUMBER
2016-0860.2T

FIGURE DATE
03/07/2024

DRAWN BY
JTM

CHECKED BY
BLL

FIGURE
2






GENERAL NOTES/LEGEND


- RESULTS GREATER THAN THE ACTION LEVEL OF 5 PARTS PER BILLION
- RESULTS LESS THAN THE ACTION LEVEL OF 5 PARTS PER BILLION

FLOOR PLANS PROVIDED BY MEHLVILLE SCHOOL DISTRICT. DIMENSIONS AND LOCATIONS ARE APPROXIMATE; ACTUAL MAY VARY. DRAWING SHALL NOT BE USED OUTSIDE THE CONTEXT OF THE REPORT FOR WHICH IT WAS GENERATED.

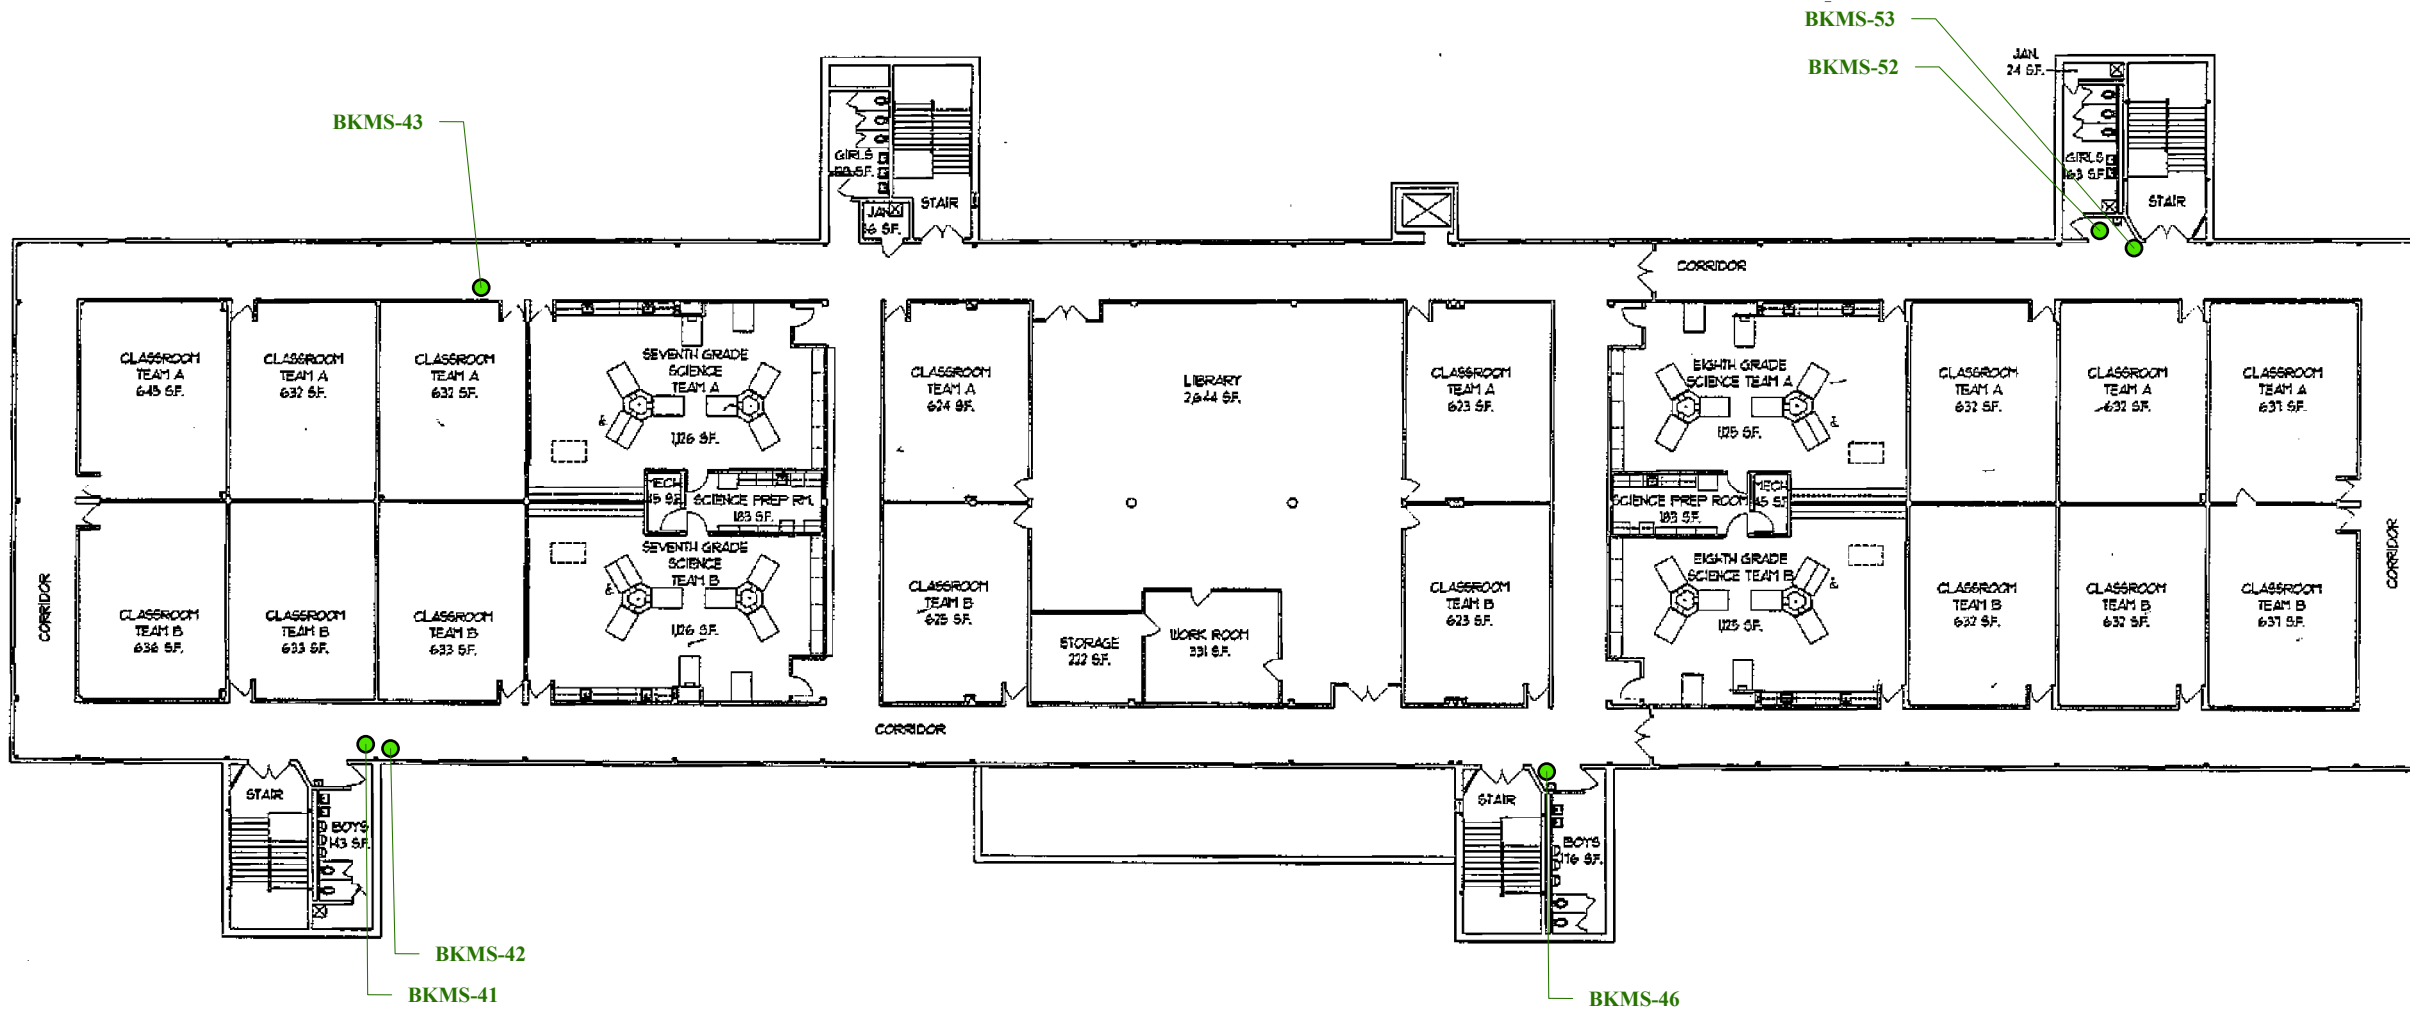

PROJECT NAME
MEHLVILLE SCHOOL DISTRICT
BUERKLE MIDDLE SCHOOL - 3RD FLOOR
ST. LOUIS, MISSOURI

LEAD DRINKING WATER SAMPLING PLAN




JOB NUMBER
2016-0860.2T

FIGURE DATE
03/07/2024

DRAWN BY
JTM

CHECKED BY
BLL

FIGURE
3





Pace Analytical Services, LLC

2231 W. Altorfer Drive

Peoria, IL 61615

(800)752-6651

January 30, 2024

Glenn Grissom
SCI Engineering
130 Point W. Blvd.
St. Chariles, MO 63301

RE: 2016-0860.2T - BUERKLE

Dear Glenn Grissom:

Please find enclosed the analytical results for the **53** sample(s) the laboratory received on **1/2/24 3:35 pm** and logged in under work order **HA00106**. All testing is performed according to our current TNI accreditations unless otherwise noted. This report cannot be reproduced, except in full, without the written permission of Pace Analytical Services, LLC.

If you have any questions regarding your report, please contact your project manager. Quality and timely data is of the utmost importance to us.

Pace Analytical Services appreciates the opportunity to provide you with analytical expertise. We are always trying to improve our customer service and we welcome you to contact the General Manager, Lisa Grant, with any feedback you have about your experience with our laboratory at 309-683-1764 or lisa.grant@pacelabs.com.

A handwritten signature in black ink, appearing to read "Chenise Lambert-Sykes".

Chenise Lambert-Sykes
Project Manager
(314)432-0550
Chenise.Lambert-Sykes@pacelabs.com



SAMPLE RECEIPT CHECK LIST

Items not applicable will be marked as in compliance

Work Order HA00106

YES	Samples received within temperature compliance when applicable
YES	COC present upon sample receipt
YES	COC completed & legible
YES	Sampler name & signature present
YES	Unique sample IDs assigned
YES	Sample collection location recorded
YES	Date & time collected recorded on COC
YES	Relinquished by client signature on COC
YES	COC & labels match
YES	Sample labels are legible
YES	Appropriate bottle(s) received
YES	Sufficient sample volume received
YES	Sample containers received undamaged
NO	Zero headspace, <6 mm present in VOA vials
NO	Trip blank(s) received
YES	All non-field analyses received within holding times
NO	Short hold time analysis
YES	Current PDC COC submitted
NO	Case narrative provided



Pace Analytical Services, LLC
2231 W. Altorfer Drive
Peoria, IL 61615
(800)752-6651

Case Narrative

The drinking water lead analysis was performed at Pace-Ormond Beach, FL. Please refer to the subcontract section of the report for details.



ANALYTICAL RESULTS

Sample: HA00106-01
Name: BKMS - 1
Matrix: Drinking Water - Grab

Sampled: 12/21/23 19:06
Received: 01/02/24 15:35

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Subcontracted Analysis - Pace Analytical - Ormond Beach

Table row for Lead: Result < 1, Unit ug/L, Prepared 12/21/23 19:06, Dilution 1, MRL 1, Analyst PACE, Method EPA 200.8 REV 5.4

Sample: HA00106-02
Name: BKMS - 2
Matrix: Drinking Water - Grab

Sampled: 12/21/23 19:09
Received: 01/02/24 15:35

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Subcontracted Analysis - Pace Analytical - Ormond Beach

Table row for Lead: Result 1.1, Unit ug/L, Prepared 12/21/23 19:09, Dilution 1, MRL 1, Analyst PACE, Method EPA 200.8 REV 5.4

Sample: HA00106-03
Name: BKMS - 3
Matrix: Drinking Water - Grab

Sampled: 12/21/23 19:10
Received: 01/02/24 15:35

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Subcontracted Analysis - Pace Analytical - Ormond Beach

Table row for Lead: Result 33.2, Unit ug/L, Prepared 12/21/23 19:10, Dilution 1, MRL 1, Analyst PACE, Method EPA 200.8 REV 5.4

Sample: HA00106-04
Name: BKMS - 4
Matrix: Drinking Water - Grab

Sampled: 12/21/23 19:12
Received: 01/02/24 15:35

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Subcontracted Analysis - Pace Analytical - Ormond Beach

Table row for Lead: Result 23.6, Unit ug/L, Prepared 12/21/23 19:12, Dilution 1, MRL 1, Analyst PACE, Method EPA 200.8 REV 5.4



ANALYTICAL RESULTS

Sample: HA00106-05
Name: BKMS - 5
Matrix: Drinking Water - Grab

Sampled: 12/21/23 19:13
Received: 01/02/24 15:35

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Subcontracted Analysis - Pace Analytical - Ormond Beach

Table row for Lead: Result 26.0, Unit ug/L, Prepared 12/21/23 19:13, Dilution 1, MRL 1, Analyst PACE, Method EPA 200.8 REV 5.4

Sample: HA00106-06
Name: BKMS - 6
Matrix: Drinking Water - Grab

Sampled: 12/21/23 19:17
Received: 01/02/24 15:35

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Subcontracted Analysis - Pace Analytical - Ormond Beach

Table row for Lead: Result < 1, Unit ug/L, Prepared 12/21/23 19:17, Dilution 1, MRL 1, Analyst PACE, Method EPA 200.8 REV 5.4

Sample: HA00106-07
Name: BKMS - 7
Matrix: Drinking Water - Grab

Sampled: 12/21/23 19:18
Received: 01/02/24 15:35

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Subcontracted Analysis - Pace Analytical - Ormond Beach

Table row for Lead: Result < 1, Unit ug/L, Prepared 12/21/23 19:18, Dilution 1, MRL 1, Analyst PACE, Method EPA 200.8 REV 5.4

Sample: HA00106-08
Name: BKMS - 8
Matrix: Drinking Water - Grab

Sampled: 12/21/23 19:23
Received: 01/02/24 15:35

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Subcontracted Analysis - Pace Analytical - Ormond Beach

Table row for Lead: Result 2.1, Unit ug/L, Prepared 12/21/23 19:23, Dilution 1, MRL 1, Analyst PACE, Method EPA 200.8 REV 5.4



ANALYTICAL RESULTS

Sample: HA00106-09
Name: BKMS - 9
Matrix: Drinking Water - Grab

Sampled: 12/21/23 19:27
Received: 01/02/24 15:35

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Subcontracted Analysis - Pace Analytical - Ormond Beach

Table row for Lead: Result 3.4, Unit ug/L, Prepared 12/21/23 19:27, Dilution 1, MRL 1, Analyst PACE, Method EPA 200.8 REV 5.4

Sample: HA00106-10
Name: BKMS - 10
Matrix: Drinking Water - Grab

Sampled: 12/21/23 19:29
Received: 01/02/24 15:35

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Subcontracted Analysis - Pace Analytical - Ormond Beach

Table row for Lead: Result 2.2, Unit ug/L, Prepared 12/21/23 19:29, Dilution 1, MRL 1, Analyst PACE, Method EPA 200.8 REV 5.4

Sample: HA00106-11
Name: BKMS - 11
Matrix: Drinking Water - Grab

Sampled: 12/21/23 19:31
Received: 01/02/24 15:35

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Subcontracted Analysis - Pace Analytical - Ormond Beach

Table row for Lead: Result 1.8, Unit ug/L, Prepared 12/21/23 19:31, Dilution 1, MRL 1, Analyst PACE, Method EPA 200.8 REV 5.4

Sample: HA00106-12
Name: BKMS - 12
Matrix: Drinking Water - Grab

Sampled: 12/21/23 19:32
Received: 01/02/24 15:35

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Subcontracted Analysis - Pace Analytical - Ormond Beach

Table row for Lead: Result 1.4, Unit ug/L, Prepared 12/21/23 19:32, Dilution 1, MRL 1, Analyst PACE, Method EPA 200.8 REV 5.4



ANALYTICAL RESULTS

Sample: HA00106-13
Name: BKMS - 13
Matrix: Drinking Water - Grab

Sampled: 12/21/23 19:34
Received: 01/02/24 15:35

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Subcontracted Analysis - Pace Analytical - Ormond Beach

Table row for Lead: Result 2.8, Unit ug/L, Prepared 12/21/23 19:34, Dilution 1, MRL 1, Analyst PACE, Method EPA 200.8 REV 5.4

Sample: HA00106-14
Name: BKMS - 14
Matrix: Drinking Water - Grab

Sampled: 12/21/23 19:36
Received: 01/02/24 15:35

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Subcontracted Analysis - Pace Analytical - Ormond Beach

Table row for Lead: Result 2.0, Unit ug/L, Prepared 12/21/23 19:36, Dilution 1, MRL 1, Analyst PACE, Method EPA 200.8 REV 5.4

Sample: HA00106-15
Name: BKMS - 15
Matrix: Drinking Water - Grab

Sampled: 12/21/23 19:38
Received: 01/02/24 15:35

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Subcontracted Analysis - Pace Analytical - Ormond Beach

Table row for Lead: Result 16.2, Unit ug/L, Prepared 12/21/23 19:38, Dilution 1, MRL 1, Analyst PACE, Method EPA 200.8 REV 5.4

Sample: HA00106-16
Name: BKMS - 16
Matrix: Drinking Water - Grab

Sampled: 12/21/23 19:39
Received: 01/02/24 15:35

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Subcontracted Analysis - Pace Analytical - Ormond Beach

Table row for Lead: Result 23.3, Unit ug/L, Prepared 12/21/23 19:39, Dilution 1, MRL 1, Analyst PACE, Method EPA 200.8 REV 5.4



ANALYTICAL RESULTS

Sample: HA00106-17
Name: BKMS - 17
Matrix: Drinking Water - Grab

Sampled: 12/21/23 19:41
Received: 01/02/24 15:35

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Subcontracted Analysis - Pace Analytical - Ormond Beach

Table row for Lead: 60.6 ug/L, 12/21/23 19:41, 1, 1, PACE, EPA 200.8 REV 5.4

Sample: HA00106-18
Name: BKMS - 18
Matrix: Drinking Water - Grab

Sampled: 12/21/23 19:44
Received: 01/02/24 15:35

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Subcontracted Analysis - Pace Analytical - Ormond Beach

Table row for Lead: 23.8 ug/L, 12/21/23 19:44, 1, 1, PACE, EPA 200.8 REV 5.4

Sample: HA00106-19
Name: BKMS - 19
Matrix: Drinking Water - Grab

Sampled: 12/21/23 19:45
Received: 01/02/24 15:35

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Subcontracted Analysis - Pace Analytical - Ormond Beach

Table row for Lead: 30.2 ug/L, 12/21/23 19:45, 1, 1, PACE, EPA 200.8 REV 5.4

Sample: HA00106-20
Name: BKMS - 20
Matrix: Drinking Water - Grab

Sampled: 12/21/23 20:50
Received: 01/02/24 15:35

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Subcontracted Analysis - Pace Analytical - Ormond Beach

Table row for Lead: < 1 ug/L, 12/21/23 20:50, 1, 1, PACE, EPA 200.8 REV 5.4



ANALYTICAL RESULTS

Sample: HA00106-21
Name: BKMS - 21
Matrix: Drinking Water - Grab

Sampled: 12/21/23 19:49
Received: 01/02/24 15:35

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Subcontracted Analysis - Pace Analytical - Ormond Beach

Table row for Lead: Result < 1, Unit ug/L, Prepared 12/21/23 19:49, Dilution 1, MRL 1, Analyst PACE, Method EPA 200.8 REV 5.4

Sample: HA00106-22
Name: BKMS - 22
Matrix: Drinking Water - Grab

Sampled: 12/21/23 19:50
Received: 01/02/24 15:35

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Subcontracted Analysis - Pace Analytical - Ormond Beach

Table row for Lead: Result < 1, Unit ug/L, Prepared 12/21/23 19:50, Dilution 1, MRL 1, Analyst PACE, Method EPA 200.8 REV 5.4

Sample: HA00106-23
Name: BKMS - 23
Matrix: Drinking Water - Grab

Sampled: 12/21/23 19:52
Received: 01/02/24 15:35

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Subcontracted Analysis - Pace Analytical - Ormond Beach

Table row for Lead: Result 1.4, Unit ug/L, Prepared 12/21/23 19:52, Dilution 1, MRL 1, Analyst PACE, Method EPA 200.8 REV 5.4

Sample: HA00106-24
Name: BKMS - 24
Matrix: Drinking Water - Grab

Sampled: 12/21/23 19:55
Received: 01/02/24 15:35

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Subcontracted Analysis - Pace Analytical - Ormond Beach

Table row for Lead: Result < 1, Unit ug/L, Prepared 12/21/23 19:55, Dilution 1, MRL 1, Analyst PACE, Method EPA 200.8 REV 5.4



ANALYTICAL RESULTS

Sample: HA00106-25
Name: BKMS - 25
Matrix: Drinking Water - Grab

Sampled: 12/21/23 19:56
Received: 01/02/24 15:35

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Subcontracted Analysis - Pace Analytical - Ormond Beach

Table row for Lead: Result < 1, Unit ug/L, Prepared 12/21/23 19:56, Dilution 1, MRL 1, Analyst PACE, Method EPA 200.8 REV 5.4

Sample: HA00106-26
Name: BKMS - 26
Matrix: Drinking Water - Grab

Sampled: 12/21/23 19:59
Received: 01/02/24 15:35

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Subcontracted Analysis - Pace Analytical - Ormond Beach

Table row for Lead: Result < 1, Unit ug/L, Prepared 12/21/23 19:59, Dilution 1, MRL 1, Analyst PACE, Method EPA 200.8 REV 5.4

Sample: HA00106-27
Name: BKMS - 27
Matrix: Drinking Water - Grab

Sampled: 12/21/23 20:00
Received: 01/02/24 15:35

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Subcontracted Analysis - Pace Analytical - Ormond Beach

Table row for Lead: Result 4.7, Unit ug/L, Prepared 12/21/23 20:00, Dilution 1, MRL 1, Analyst PACE, Method EPA 200.8 REV 5.4

Sample: HA00106-28
Name: BKMS - 28
Matrix: Drinking Water - Grab

Sampled: 12/21/23 20:01
Received: 01/02/24 15:35

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Subcontracted Analysis - Pace Analytical - Ormond Beach

Table row for Lead: Result 1.0, Unit ug/L, Prepared 12/21/23 20:01, Dilution 1, MRL 1, Analyst PACE, Method EPA 200.8 REV 5.4



ANALYTICAL RESULTS

Sample: HA00106-29
Name: BKMS - 29
Matrix: Drinking Water - Grab

Sampled: 12/21/23 20:02
Received: 01/02/24 15:35

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Subcontracted Analysis - Pace Analytical - Ormond Beach

Table row for Lead: < 1 ug/L, 12/21/23 20:02, 1, 1, PACE, EPA 200.8 REV 5.4

Sample: HA00106-30
Name: BKMS - 30
Matrix: Drinking Water - Grab

Sampled: 12/21/23 20:04
Received: 01/02/24 15:35

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Subcontracted Analysis - Pace Analytical - Ormond Beach

Table row for Lead: < 1 ug/L, 12/21/23 20:04, 1, 1, PACE, EPA 200.8 REV 5.4

Sample: HA00106-31
Name: BKMS - 31
Matrix: Drinking Water - Grab

Sampled: 12/21/23 20:05
Received: 01/02/24 15:35

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Subcontracted Analysis - Pace Analytical - Ormond Beach

Table row for Lead: < 1 ug/L, 12/21/23 20:05, 1, 1, PACE, EPA 200.8 REV 5.4

Sample: HA00106-32
Name: BKMS - 32
Matrix: Drinking Water - Grab

Sampled: 12/21/23 20:07
Received: 01/02/24 15:35

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Subcontracted Analysis - Pace Analytical - Ormond Beach

Table row for Lead: < 1 ug/L, 12/21/23 20:07, 1, 1, PACE, EPA 200.8 REV 5.4



ANALYTICAL RESULTS

Sample: HA00106-33
Name: BKMS - 33
Matrix: Drinking Water - Grab

Sampled: 12/21/23 20:08
Received: 01/02/24 15:35

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Subcontracted Analysis - Pace Analytical - Ormond Beach

Table row for Lead: < 1 ug/L, 12/21/23 20:08, 1, 1, PACE, EPA 200.8 REV 5.4

Sample: HA00106-34
Name: BKMS - 34
Matrix: Drinking Water - Grab

Sampled: 12/21/23 20:09
Received: 01/02/24 15:35

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Subcontracted Analysis - Pace Analytical - Ormond Beach

Table row for Lead: 5.0 ug/L, 12/21/23 20:09, 1, 1, PACE, EPA 200.8 REV 5.4

Sample: HA00106-35
Name: BKMS - 35
Matrix: Drinking Water - Grab

Sampled: 12/21/23 20:15
Received: 01/02/24 15:35

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Subcontracted Analysis - Pace Analytical - Ormond Beach

Table row for Lead: 32.2 ug/L, 12/21/23 20:15, 1, 1, PACE, EPA 200.8 REV 5.4

Sample: HA00106-36
Name: BKMS - 36
Matrix: Drinking Water - Grab

Sampled: 12/21/23 20:18
Received: 01/02/24 15:35

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Subcontracted Analysis - Pace Analytical - Ormond Beach

Table row for Lead: 26.0 ug/L, 12/21/23 20:18, 1, 1, PACE, EPA 200.8 REV 5.4



ANALYTICAL RESULTS

Sample: HA00106-37
Name: BKMS - 37
Matrix: Drinking Water - Grab

Sampled: 12/21/23 20:18
Received: 01/02/24 15:35

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Subcontracted Analysis - Pace Analytical - Ormond Beach

Table row for Lead: 17.0 ug/L, 12/21/23 20:18, 1, 1, PACE, EPA 200.8 REV 5.4

Sample: HA00106-38
Name: BKMS - 38
Matrix: Drinking Water - Grab

Sampled: 12/21/23 20:19
Received: 01/02/24 15:35

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Subcontracted Analysis - Pace Analytical - Ormond Beach

Table row for Lead: 15.9 ug/L, 12/21/23 20:19, 1, 1, PACE, EPA 200.8 REV 5.4

Sample: HA00106-39
Name: BKMS - 39
Matrix: Drinking Water - Grab

Sampled: 12/21/23 20:20
Received: 01/02/24 15:35

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Subcontracted Analysis - Pace Analytical - Ormond Beach

Table row for Lead: 9.1 ug/L, 12/21/23 20:20, 1, 1, PACE, EPA 200.8 REV 5.4

Sample: HA00106-40
Name: BKMS - 40
Matrix: Drinking Water - Grab

Sampled: 12/21/23 20:22
Received: 01/02/24 15:35

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Subcontracted Analysis - Pace Analytical - Ormond Beach

Table row for Lead: 25.6 ug/L, 12/21/23 20:22, 1, 1, PACE, EPA 200.8 REV 5.4



ANALYTICAL RESULTS

Sample: HA00106-41
Name: BKMS - 41
Matrix: Drinking Water - Grab

Sampled: 12/21/23 20:24
Received: 01/02/24 15:35

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Subcontracted Analysis - Pace Analytical - Ormond Beach

Table row for Lead: < 1 ug/L, 12/21/23 20:24, 1, 1, PACE, EPA 200.8 REV 5.4

Sample: HA00106-42
Name: BKMS - 42
Matrix: Drinking Water - Grab

Sampled: 12/21/23 20:25
Received: 01/02/24 15:35

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Subcontracted Analysis - Pace Analytical - Ormond Beach

Table row for Lead: < 1 ug/L, 12/21/23 20:25, 1, 1, PACE, EPA 200.8 REV 5.4

Sample: HA00106-43
Name: BKMS - 43
Matrix: Drinking Water - Grab

Sampled: 12/21/23 20:27
Received: 01/02/24 15:35

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Subcontracted Analysis - Pace Analytical - Ormond Beach

Table row for Lead: 1.9 ug/L, 12/21/23 20:27, 1, 1, PACE, EPA 200.8 REV 5.4

Sample: HA00106-44
Name: BKMS - 44
Matrix: Drinking Water - Grab

Sampled: 12/21/23 20:28
Received: 01/02/24 15:35

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Subcontracted Analysis - Pace Analytical - Ormond Beach

Table row for Lead: 25.6 ug/L, 12/21/23 20:28, 1, 1, PACE, EPA 200.8 REV 5.4



ANALYTICAL RESULTS

Sample: HA00106-45
Name: BKMS - 45
Matrix: Drinking Water - Grab

Sampled: 12/21/23 20:29
Received: 01/02/24 15:35

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Subcontracted Analysis - Pace Analytical - Ormond Beach

Table row for Lead: Result 34.9, Unit ug/L, Prepared 12/21/23 20:29, Dilution 1, MRL 1, Analyst PACE, Method EPA 200.8 REV 5.4

Sample: HA00106-46
Name: BKMS - 46
Matrix: Drinking Water - Grab

Sampled: 12/21/23 20:35
Received: 01/02/24 15:35

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Subcontracted Analysis - Pace Analytical - Ormond Beach

Table row for Lead: Result < 1, Unit ug/L, Prepared 12/21/23 20:35, Dilution 1, MRL 1, Analyst PACE, Method EPA 200.8 REV 5.4

Sample: HA00106-47
Name: BKMS - 47
Matrix: Drinking Water - Grab

Sampled: 12/21/23 20:32
Received: 01/02/24 15:35

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Subcontracted Analysis - Pace Analytical - Ormond Beach

Table row for Lead: Result 32.4, Unit ug/L, Prepared 12/21/23 20:32, Dilution 1, MRL 1, Analyst PACE, Method EPA 200.8 REV 5.4

Sample: HA00106-48
Name: BKMS - 48
Matrix: Drinking Water - Grab

Sampled: 12/21/23 20:33
Received: 01/02/24 15:35

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Subcontracted Analysis - Pace Analytical - Ormond Beach

Table row for Lead: Result 40.9, Unit ug/L, Prepared 12/21/23 20:33, Dilution 1, MRL 1, Analyst PACE, Method EPA 200.8 REV 5.4



ANALYTICAL RESULTS

Sample: HA00106-49
Name: BKMS - 49
Matrix: Drinking Water - Grab

Sampled: 12/21/23 20:36
Received: 01/02/24 15:35

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Subcontracted Analysis - Pace Analytical - Ormond Beach

Table row for Lead: 25.6 ug/L, 12/21/23 20:36, 1, 1, PACE, EPA 200.8 REV 5.4

Sample: HA00106-50
Name: BKMS - 50
Matrix: Drinking Water - Grab

Sampled: 12/21/23 20:37
Received: 01/02/24 15:35

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Subcontracted Analysis - Pace Analytical - Ormond Beach

Table row for Lead: 43.3 ug/L, 12/21/23 20:37, 1, 1, PACE, EPA 200.8 REV 5.4

Sample: HA00106-51
Name: BKMS - 51
Matrix: Drinking Water - Grab

Sampled: 12/21/23 20:39
Received: 01/02/24 15:35

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Subcontracted Analysis - Pace Analytical - Ormond Beach

Table row for Lead: 19.3 ug/L, 12/21/23 20:39, 1, 1, PACE, EPA 200.8 REV 5.4

Sample: HA00106-52
Name: BKMS - 52
Matrix: Drinking Water - Grab

Sampled: 12/21/23 20:41
Received: 01/02/24 15:35

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Subcontracted Analysis - Pace Analytical - Ormond Beach

Table row for Lead: < 1 ug/L, 12/21/23 20:41, 1, 1, PACE, EPA 200.8 REV 5.4



ANALYTICAL RESULTS

Sample: HA00106-53
Name: BKMS - 53
Matrix: Drinking Water - Grab

Sampled: 12/21/23 20:42
Received: 01/02/24 15:35

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
-----------	--------	------	-----------	----------	----------	-----	----------	---------	--------

Subcontracted Analysis - Pace Analytical - Ormond Beach

Lead	< 1	ug/L		12/21/23 20:42	1	1		PACE	EPA 200.8 REV 5.4
------	-----	------	--	----------------	---	---	--	------	-------------------



QC SAMPLE RESULTS

Parameter	Result	Unit	Qual	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit
<u>Batch [none] - DW 200.8 no prep - EPA 200.8 REV 5.4</u>									
BLK (BATCH-BLK1 (Water))				Prepared & Analyzed:					
Lead	< 0.2	ug/L					0-0		0
BS (BATCH-BS1 (Water))				Prepared & Analyzed:					
Lead	< 0.2	ug/L					85-115		20
MS (BATCH-MS1 (Water))				Prepared & Analyzed:					
Lead	< 0.2	ug/L					70-130		20
MSD (BATCH-MSD1 (Water))				Prepared & Analyzed:					
Lead	< 0.2	ug/L					70-130		20



NOTES

Specifications regarding method revisions, method modifications, and calculations used for analysis are available upon request. Please contact your project manager.

* Not a TNI accredited analyte

Certifications

CHI - McHenry, IL - 4314-A W. Crystal Lake Road, McHenry, IL 60050

TNI Accreditation for Drinking Water and Wastewater Fields of Testing through IL EPA Accreditation No. 100279

Illinois Department of Public Health Bacterial Analysis in Drinking Water Approved Laboratory Registry No. 17556

PIA - Peoria, IL - 2231 W. Altorfer Drive, Peoria, IL 61615

TNI Accreditation for Drinking Water, Wastewater, Solid and Hazardous Material Fields of Testing through IL EPA Accreditation No. 100230

Illinois Department of Public Health Bacterial Analysis in Drinking Water Approved Laboratory Registry No. 17553

Drinking Water Certifications/Accreditations: Iowa (240); Kansas (E-10338); Missouri (870)

Wastewater Certifications/Accreditations: Arkansas (88-0677); Iowa (240); Kansas (E-10338)

Solid and Hazardous Material Certifications/Accreditations: Arkansas (88-0677); Iowa (240); Kansas (E-10338)

SPMO - Springfield, MO - 1805 W Sunset Street, Springfield, MO 65807

USEPA DMR-QA Program

STL - Hazelwood, MO - 944 Anglum Rd, Hazelwood, MO 63042

TNI Accreditation for Wastewater, Solid and Hazardous Material Fields of Testing through KS KDHE Certification No. E-10389

TNI Accreditation for Wastewater, Solid and Hazardous Material Fields of Testing through IL EPA Accreditation No. - 200080

Illinois Department of Public Health Bacterial Analysis in Drinking Water Approved Laboratory, Registry No. 171050

Missouri Department of Natural Resources - Certificate of Approval for Microbiological Laboratory Service - No. 1050



Certified by: Chenise Lambert-Sykes, Project Manager



January 12, 2024

Chenise Lambert-Sykes
Pace Analytical Services, Inc - IL/MO
944 Anglum Road
Hazelwood, MO 63042

RE: Project: HA00106
Pace Project No.: 35851647

Dear Chenise Lambert-Sykes:

Enclosed are the analytical results for sample(s) received by the laboratory on January 04, 2024. The results relate only to the samples included in this report. Results reported herein conform to the applicable TNI/NELAC Standards and the laboratory's Quality Manual, where applicable, unless otherwise noted in the body of the report.

The test results provided in this final report were generated by each of the following laboratories within the Pace Network:

- Pace Analytical Services - Ormond Beach

If you have any questions concerning this report, please feel free to contact me.

Sincerely,

Brad Smith
brad.smith@pacelabs.com
(386) 672-5668
Project Manager

Enclosures



REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



CERTIFICATIONS

Project: HA00106

Pace Project No.: 35851647

Pace Analytical Services Ormond Beach

8 East Tower Circle, Ormond Beach, FL 32174

Alaska DEC- CS/UST/LUST

Alabama Certification #: 41320

California Certification# 3096

Colorado Certification: FL NELAC Reciprocity

Connecticut Certification #: PH-0216

Delaware Certification: FL NELAC Reciprocity

DoD-ANAB #:ADE-3199

Florida Certification #: E83079

Georgia Certification #: 955

Guam Certification: FL NELAC Reciprocity

Hawaii Certification: FL NELAC Reciprocity

Illinois Certification #: 200068

Indiana Certification: FL NELAC Reciprocity

Kansas Certification #: E-10383

Kentucky Certification #: 90050

Louisiana Certification #: FL NELAC Reciprocity

Louisiana Environmental Certificate #: 05007

Maine Certification #: FL01264

Maryland Certification: #346

Massachusetts Certification #: M-FL1264

Michigan Certification #: 9911

Mississippi Certification: FL NELAC Reciprocity

Missouri Certification #: 236

Montana Certification #: Cert 0074

Nebraska Certification: NE-OS-28-14

New Hampshire Certification #: 2958

New Jersey Certification #: FL022

New York Certification #: 11608

North Carolina Environmental Certificate #: 667

North Carolina Certification #: 12710

North Dakota Certification #: R-216

Ohio DEP 87780

Oklahoma Certification #: D9947

Pennsylvania Certification #: 68-00547

Puerto Rico Certification #: FL01264

South Carolina Certification: #96042001

Tennessee Certification #: TN02974

Texas Certification: FL NELAC Reciprocity

US Virgin Islands Certification: FL NELAC Reciprocity

Virginia Environmental Certification #: 460165

West Virginia Certification #: 9962C

Wisconsin Certification #: 399079670

Wyoming (EPA Region 8): FL NELAC Reciprocity

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



SAMPLE ANALYTE COUNT

Project: HA00106

Pace Project No.: 35851647

Lab ID	Sample ID	Method	Analysts	Analytes Reported	Laboratory
35851647001	HA00106-01	EPA 200.8	BSL	1	PASI-O
35851647002	HA00106-02	EPA 200.8	BSL	1	PASI-O
35851647003	HA00106-03	EPA 200.8	BSL	1	PASI-O
35851647004	HA00106-04	EPA 200.8	BSL	1	PASI-O
35851647005	HA00106-05	EPA 200.8	BSL	1	PASI-O
35851647006	HA00106-06	EPA 200.8	BSL	1	PASI-O
35851647007	HA00106-07	EPA 200.8	BSL	1	PASI-O
35851647008	HA00106-08	EPA 200.8	BSL	1	PASI-O
35851647009	HA00106-09	EPA 200.8	BSL	1	PASI-O
35851647010	HA00106-10	EPA 200.8	BSL	1	PASI-O
35851647011	HA00106-11	EPA 200.8	BSL	1	PASI-O
35851647012	HA00106-12	EPA 200.8	BSL	1	PASI-O
35851647013	HA00106-13	EPA 200.8	BSL	1	PASI-O
35851647014	HA00106-14	EPA 200.8	BSL	1	PASI-O
35851647015	HA00106-15	EPA 200.8	BSL	1	PASI-O
35851647016	HA00106-16	EPA 200.8	BSL	1	PASI-O
35851647017	HA00106-17	EPA 200.8	BSL	1	PASI-O
35851647018	HA00106-18	EPA 200.8	BSL	1	PASI-O
35851647019	HA00106-19	EPA 200.8	BSL	1	PASI-O
35851647020	HA00106-20	EPA 200.8	BSL	1	PASI-O
35851647021	HA00106-21	EPA 200.8	BSL	1	PASI-O
35851647022	HA00106-22	EPA 200.8	BSL	1	PASI-O
35851647023	HA00106-23	EPA 200.8	BSL	1	PASI-O
35851647024	HA00106-24	EPA 200.8	BSL	1	PASI-O
35851647025	HA00106-25	EPA 200.8	EAP	1	PASI-O
35851647026	HA00106-26	EPA 200.8	EAP	1	PASI-O
35851647027	HA00106-27	EPA 200.8	EAP	1	PASI-O
35851647028	HA00106-28	EPA 200.8	EAP	1	PASI-O
35851647029	HA00106-29	EPA 200.8	EAP	1	PASI-O
35851647030	HA00106-30	EPA 200.8	EAP	1	PASI-O
35851647031	HA00106-31	EPA 200.8	EAP	1	PASI-O
35851647032	HA00106-32	EPA 200.8	EAP	1	PASI-O
35851647033	HA00106-33	EPA 200.8	EAP	1	PASI-O
35851647034	HA00106-34	EPA 200.8	EAP	1	PASI-O
35851647035	HA00106-35	EPA 200.8	EAP	1	PASI-O
35851647036	HA00106-36	EPA 200.8	EAP	1	PASI-O
35851647037	HA00106-37	EPA 200.8	EAP	1	PASI-O

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full, without the written consent of Pace Analytical Services, LLC.



SAMPLE ANALYTE COUNT

Project: HA00106

Pace Project No.: 35851647

Lab ID	Sample ID	Method	Analysts	Analytes Reported	Laboratory
35851647038	HA00106-38	EPA 200.8	EAP	1	PASI-O
35851647039	HA00106-39	EPA 200.8	LEC	1	PASI-O
35851647040	HA00106-40	EPA 200.8	EAP	1	PASI-O
35851647041	HA00106-41	EPA 200.8	EAP	1	PASI-O
35851647042	HA00106-42	EPA 200.8	EAP	1	PASI-O
35851647043	HA00106-43	EPA 200.8	EAP	1	PASI-O
35851647044	HA00106-44	EPA 200.8	EAP	1	PASI-O
35851647045	HA00106-45	EPA 200.8	EAP	1	PASI-O
35851647046	HA00106-46	EPA 200.8	EAP	1	PASI-O
35851647047	HA00106-47	EPA 200.8	EAP	1	PASI-O
35851647048	HA00106-48	EPA 200.8	EAP	1	PASI-O
35851647049	HA00106-49	EPA 200.8	EAP	1	PASI-O
35851647050	HA00106-50	EPA 200.8	EAP	1	PASI-O
35851647051	HA00106-51	EPA 200.8	EAP	1	PASI-O
35851647052	HA00106-52	EPA 200.8	EAP	1	PASI-O
35851647053	HA00106-53	EPA 200.8	EAP	1	PASI-O

PASI-O = Pace Analytical Services - Ormond Beach

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: HA00106

Pace Project No.: 35851647

Sample: HA00106-01		Lab ID: 35851647001	Collected: 12/21/23 20:06	Received: 01/04/24 10:25	Matrix: Drinking Water			
Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
200.8 MET ICPMS Drinking Water		Analytical Method: EPA 200.8 Pace Analytical Services - Ormond Beach						
Lead	ND	ug/L	1.0	1		01/09/24 09:15	7439-92-1	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: HA00106

Pace Project No.: 35851647

Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
Sample: HA00106-02								
Lab ID: 35851647002								
Collected: 12/21/23 20:09 Received: 01/04/24 10:25 Matrix: Drinking Water								
200.8 MET ICPMS Drinking Water								
Analytical Method: EPA 200.8								
Pace Analytical Services - Ormond Beach								
Lead	1.1	ug/L	1.0	1		01/09/24 09:19	7439-92-1	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full, without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: HA00106

Pace Project No.: 35851647

Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
Sample: HA00106-03								
Lab ID: 35851647003								
Collected: 12/21/23 20:10 Received: 01/04/24 10:25 Matrix: Drinking Water								
200.8 MET ICPMS Drinking Water								
Analytical Method: EPA 200.8								
Pace Analytical Services - Ormond Beach								
Lead	33.2	ug/L	1.0	1		01/09/24 10:49	7439-92-1	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full, without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: HA00106

Pace Project No.: 35851647

Sample: HA00106-04		Lab ID: 35851647004	Collected: 12/21/23 20:12	Received: 01/04/24 10:25	Matrix: Drinking Water			
Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
200.8 MET ICPMS Drinking Water		Analytical Method: EPA 200.8 Pace Analytical Services - Ormond Beach						
Lead	23.6	ug/L	1.0	1		01/09/24 10:41	7439-92-1	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: HA00106

Pace Project No.: 35851647

Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
Sample: HA00106-05								
Lab ID: 35851647005								
Collected: 12/21/23 20:13 Received: 01/04/24 10:25 Matrix: Drinking Water								
200.8 MET ICPMS Drinking Water								
Analytical Method: EPA 200.8								
Pace Analytical Services - Ormond Beach								
Lead	26.0	ug/L	1.0	1		01/09/24 10:42	7439-92-1	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full, without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: HA00106

Pace Project No.: 35851647

Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
Sample: HA00106-06								
Lab ID: 35851647006								
Collected: 12/21/23 20:17 Received: 01/04/24 10:25 Matrix: Drinking Water								
200.8 MET ICPMS Drinking Water	Analytical Method: EPA 200.8 Pace Analytical Services - Ormond Beach							
Lead	ND	ug/L	1.0	1		01/09/24 10:44	7439-92-1	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: HA00106

Pace Project No.: 35851647

Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
Sample: HA00106-07								
Lab ID: 35851647007								
Collected: 12/21/23 20:18 Received: 01/04/24 10:25 Matrix: Drinking Water								
200.8 MET ICPMS Drinking Water								
Analytical Method: EPA 200.8								
Pace Analytical Services - Ormond Beach								
Lead	ND	ug/L	1.0	1		01/09/24 10:45	7439-92-1	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full, without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: HA00106

Pace Project No.: 35851647

Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
Sample: HA00106-08								
Lab ID: 35851647008								
Collected: 12/21/23 01:00 Received: 01/04/24 10:25 Matrix: Drinking Water								
200.8 MET ICPMS Drinking Water								
Analytical Method: EPA 200.8								
Pace Analytical Services - Ormond Beach								
Lead	2.1	ug/L	1.0	1		01/09/24 10:46	7439-92-1	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full, without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: HA00106

Pace Project No.: 35851647

Sample: HA00106-09		Lab ID: 35851647009	Collected: 12/21/23 20:27	Received: 01/04/24 10:25	Matrix: Drinking Water			
Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
200.8 MET ICPMS Drinking Water		Analytical Method: EPA 200.8 Pace Analytical Services - Ormond Beach						
Lead	3.4	ug/L	1.0	1		01/09/24 10:48	7439-92-1	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: HA00106

Pace Project No.: 35851647

Sample: HA00106-10		Lab ID: 35851647010	Collected: 12/21/23 20:29	Received: 01/04/24 10:25	Matrix: Drinking Water			
Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
200.8 MET ICPMS Drinking Water		Analytical Method: EPA 200.8 Pace Analytical Services - Ormond Beach						
Lead	2.2	ug/L	1.0	1		01/09/24 10:54	7439-92-1	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: HA00106

Pace Project No.: 35851647

Sample: HA00106-11		Lab ID: 35851647011	Collected: 12/21/23 20:31	Received: 01/04/24 10:25	Matrix: Drinking Water			
Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
200.8 MET ICPMS Drinking Water		Analytical Method: EPA 200.8 Pace Analytical Services - Ormond Beach						
Lead	1.8	ug/L	1.0	1		01/09/24 10:55	7439-92-1	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: HA00106

Pace Project No.: 35851647

Sample: HA00106-12		Lab ID: 35851647012	Collected: 12/21/23 20:32	Received: 01/04/24 10:25	Matrix: Drinking Water			
Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
200.8 MET ICPMS Drinking Water		Analytical Method: EPA 200.8 Pace Analytical Services - Ormond Beach						
Lead	1.4	ug/L	1.0	1		01/09/24 10:56	7439-92-1	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: HA00106

Pace Project No.: 35851647

Sample: HA00106-13		Lab ID: 35851647013	Collected: 12/21/23 20:34	Received: 01/04/24 10:25	Matrix: Drinking Water			
Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
200.8 MET ICPMS Drinking Water		Analytical Method: EPA 200.8 Pace Analytical Services - Ormond Beach						
Lead	2.8	ug/L	1.0	1		01/09/24 10:58	7439-92-1	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: HA00106
 Pace Project No.: 35851647

Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
Sample: HA00106-14								
Lab ID: 35851647014								
Collected: 12/21/23 01:00 Received: 01/04/24 10:25 Matrix: Drinking Water								
200.8 MET ICPMS Drinking Water								
Analytical Method: EPA 200.8								
Pace Analytical Services - Ormond Beach								
Lead	2.0	ug/L	1.0	1		01/09/24 10:59	7439-92-1	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
 without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: HA00106

Pace Project No.: 35851647

Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
Sample: HA00106-15								
Lab ID: 35851647015								
Collected: 12/21/23 20:38								
Received: 01/04/24 10:25								
Matrix: Drinking Water								
200.8 MET ICPMS Drinking Water								
Analytical Method: EPA 200.8								
Pace Analytical Services - Ormond Beach								
Lead	16.2	ug/L	1.0	1		01/09/24 11:01	7439-92-1	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full, without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: HA00106

Pace Project No.: 35851647

Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
Sample: HA00106-16								
Lab ID: 35851647016								
Collected: 12/21/23 20:39								
Received: 01/04/24 10:25								
Matrix: Drinking Water								
200.8 MET ICPMS Drinking Water								
Analytical Method: EPA 200.8								
Pace Analytical Services - Ormond Beach								
Lead	23.3	ug/L	1.0	1		01/09/24 11:02	7439-92-1	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full, without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: HA00106

Pace Project No.: 35851647

Sample: HA00106-17		Lab ID: 35851647017	Collected: 12/21/23 20:41	Received: 01/04/24 10:25	Matrix: Drinking Water			
Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
200.8 MET ICPMS Drinking Water		Analytical Method: EPA 200.8 Pace Analytical Services - Ormond Beach						
Lead	60.6	ug/L	1.0	1		01/09/24 11:04	7439-92-1	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: HA00106

Pace Project No.: 35851647

Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
Sample: HA00106-18								
Lab ID: 35851647018								
Collected: 12/21/23 20:44								
Received: 01/04/24 10:25								
Matrix: Drinking Water								
200.8 MET ICPMS Drinking Water								
Analytical Method: EPA 200.8								
Pace Analytical Services - Ormond Beach								
Lead	23.8	ug/L	1.0	1		01/09/24 11:05	7439-92-1	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full, without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: HA00106

Pace Project No.: 35851647

Sample: HA00106-19		Lab ID: 35851647019	Collected: 12/21/23 20:45	Received: 01/04/24 10:25	Matrix: Drinking Water			
Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
200.8 MET ICPMS Drinking Water		Analytical Method: EPA 200.8 Pace Analytical Services - Ormond Beach						
Lead	30.2	ug/L	1.0	1		01/09/24 11:06	7439-92-1	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: HA00106

Pace Project No.: 35851647

Sample: HA00106-20		Lab ID: 35851647020	Collected: 12/21/23 21:50	Received: 01/04/24 10:25	Matrix: Drinking Water			
Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
200.8 MET ICPMS Drinking Water		Analytical Method: EPA 200.8 Pace Analytical Services - Ormond Beach						
Lead	ND	ug/L	1.0	1		01/09/24 11:11	7439-92-1	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: HA00106

Pace Project No.: 35851647

Sample: HA00106-21		Lab ID: 35851647021	Collected: 12/21/23 20:49	Received: 01/04/24 10:25	Matrix: Drinking Water			
Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
200.8 MET ICPMS Drinking Water		Analytical Method: EPA 200.8 Pace Analytical Services - Ormond Beach						
Lead	ND	ug/L	1.0	1		01/09/24 11:12	7439-92-1	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: HA00106

Pace Project No.: 35851647

Sample: HA00106-22		Lab ID: 35851647022	Collected: 12/21/23 20:50	Received: 01/04/24 10:25	Matrix: Drinking Water			
Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
200.8 MET ICPMS Drinking Water		Analytical Method: EPA 200.8 Pace Analytical Services - Ormond Beach						
Lead	ND	ug/L	1.0	1		01/09/24 11:13	7439-92-1	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: HA00106

Pace Project No.: 35851647

Sample: HA00106-23		Lab ID: 35851647023	Collected: 12/21/23 20:52	Received: 01/04/24 10:25	Matrix: Drinking Water			
Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
200.8 MET ICPMS Drinking Water		Analytical Method: EPA 200.8 Pace Analytical Services - Ormond Beach						
Lead	1.4	ug/L	1.0	1		01/09/24 10:00	7439-92-1	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: HA00106

Pace Project No.: 35851647

Sample: HA00106-24		Lab ID: 35851647024	Collected: 12/21/23 20:55	Received: 01/04/24 10:25	Matrix: Drinking Water			
Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
200.8 MET ICPMS Drinking Water		Analytical Method: EPA 200.8 Pace Analytical Services - Ormond Beach						
Lead	ND	ug/L	1.0	1		01/09/24 12:53	7439-92-1	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: HA00106

Pace Project No.: 35851647

Sample: HA00106-25		Lab ID: 35851647025	Collected: 12/21/23 20:56	Received: 01/04/24 10:25	Matrix: Drinking Water			
Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
200.8 MET ICPMS Drinking Water		Analytical Method: EPA 200.8 Pace Analytical Services - Ormond Beach						
Lead	ND	ug/L	1.0	1		01/09/24 16:12	7439-92-1	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: HA00106

Pace Project No.: 35851647

Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
Sample: HA00106-26								
Lab ID: 35851647026								
Collected: 12/21/23 20:59 Received: 01/04/24 10:25 Matrix: Drinking Water								
200.8 MET ICPMS Drinking Water	Analytical Method: EPA 200.8 Pace Analytical Services - Ormond Beach							
Lead	ND	ug/L	1.0	1		01/09/24 16:13	7439-92-1	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: HA00106

Pace Project No.: 35851647

Sample: HA00106-27		Lab ID: 35851647027	Collected: 12/21/23 21:00	Received: 01/04/24 10:25	Matrix: Drinking Water			
Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
200.8 MET ICPMS Drinking Water		Analytical Method: EPA 200.8 Pace Analytical Services - Ormond Beach						
Lead	4.7	ug/L	1.0	1		01/09/24 16:15	7439-92-1	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: HA00106

Pace Project No.: 35851647

Sample: HA00106-28		Lab ID: 35851647028	Collected: 12/21/23 21:01	Received: 01/04/24 10:25	Matrix: Drinking Water			
Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
200.8 MET ICPMS Drinking Water		Analytical Method: EPA 200.8 Pace Analytical Services - Ormond Beach						
Lead	1.0	ug/L	1.0	1		01/09/24 16:16	7439-92-1	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: HA00106

Pace Project No.: 35851647

Sample: HA00106-29		Lab ID: 35851647029	Collected: 12/21/23 21:02	Received: 01/04/24 10:25	Matrix: Drinking Water			
Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
200.8 MET ICPMS Drinking Water		Analytical Method: EPA 200.8 Pace Analytical Services - Ormond Beach						
Lead	ND	ug/L	1.0	1		01/09/24 16:21	7439-92-1	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: HA00106

Pace Project No.: 35851647

Sample: HA00106-30		Lab ID: 35851647030	Collected: 12/21/23 21:04	Received: 01/04/24 10:25	Matrix: Drinking Water			
Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
200.8 MET ICPMS Drinking Water		Analytical Method: EPA 200.8 Pace Analytical Services - Ormond Beach						
Lead	ND	ug/L	1.0	1		01/09/24 16:22	7439-92-1	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: HA00106

Pace Project No.: 35851647

Sample: HA00106-31		Lab ID: 35851647031	Collected: 12/21/23 21:05	Received: 01/04/24 10:25	Matrix: Drinking Water			
Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
200.8 MET ICPMS Drinking Water		Analytical Method: EPA 200.8 Pace Analytical Services - Ormond Beach						
Lead	ND	ug/L	1.0	1		01/09/24 16:23	7439-92-1	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: HA00106

Pace Project No.: 35851647

Sample: HA00106-32		Lab ID: 35851647032	Collected: 12/21/23 21:07	Received: 01/04/24 10:25	Matrix: Drinking Water			
Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
200.8 MET ICPMS Drinking Water		Analytical Method: EPA 200.8 Pace Analytical Services - Ormond Beach						
Lead	ND	ug/L	1.0	1		01/09/24 16:25	7439-92-1	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: HA00106

Pace Project No.: 35851647

Sample: HA00106-33		Lab ID: 35851647033	Collected: 12/21/23 21:08	Received: 01/04/24 10:25	Matrix: Drinking Water			
Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
200.8 MET ICPMS Drinking Water		Analytical Method: EPA 200.8 Pace Analytical Services - Ormond Beach						
Lead	ND	ug/L	1.0	1		01/09/24 16:26	7439-92-1	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: HA00106

Pace Project No.: 35851647

Sample: HA00106-34		Lab ID: 35851647034	Collected: 12/21/23 21:09	Received: 01/04/24 10:25	Matrix: Drinking Water			
Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
200.8 MET ICPMS Drinking Water		Analytical Method: EPA 200.8 Pace Analytical Services - Ormond Beach						
Lead	5.0	ug/L	1.0	1		01/09/24 16:28	7439-92-1	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: HA00106

Pace Project No.: 35851647

Sample: HA00106-35		Lab ID: 35851647035	Collected: 12/21/23 21:15	Received: 01/04/24 10:25	Matrix: Drinking Water			
Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
200.8 MET ICPMS Drinking Water		Analytical Method: EPA 200.8 Pace Analytical Services - Ormond Beach						
Lead	32.2	ug/L	1.0	1		01/09/24 16:29	7439-92-1	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: HA00106

Pace Project No.: 35851647

Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
Sample: HA00106-36								
Lab ID: 35851647036								
Collected: 12/21/23 21:18 Received: 01/04/24 10:25 Matrix: Drinking Water								
200.8 MET ICPMS Drinking Water								
Analytical Method: EPA 200.8								
Pace Analytical Services - Ormond Beach								
Lead	26.0	ug/L	1.0	1		01/09/24 16:31	7439-92-1	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full, without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: HA00106

Pace Project No.: 35851647

Sample: HA00106-37		Lab ID: 35851647037	Collected: 12/21/23 21:18	Received: 01/04/24 10:25	Matrix: Drinking Water			
Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
200.8 MET ICPMS Drinking Water		Analytical Method: EPA 200.8 Pace Analytical Services - Ormond Beach						
Lead	17.0	ug/L	1.0	1		01/09/24 16:32	7439-92-1	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: HA00106

Pace Project No.: 35851647

Sample: HA00106-38		Lab ID: 35851647038	Collected: 12/21/23 21:19	Received: 01/04/24 10:25	Matrix: Drinking Water			
Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
200.8 MET ICPMS Drinking Water		Analytical Method: EPA 200.8 Pace Analytical Services - Ormond Beach						
Lead	15.9	ug/L	1.0	1		01/09/24 16:33	7439-92-1	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: HA00106

Pace Project No.: 35851647

Sample: HA00106-39		Lab ID: 35851647039	Collected: 12/21/23 21:20	Received: 01/04/24 10:25	Matrix: Drinking Water			
Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
200.8 MET ICPMS Drinking Water		Analytical Method: EPA 200.8 Preparation Method: EPA 200.8 Pace Analytical Services - Ormond Beach						
Lead	9.1	ug/L	1.0	1	01/09/24 23:31	01/12/24 08:43	7439-92-1	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: HA00106

Pace Project No.: 35851647

Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
Sample: HA00106-40								
Lab ID: 35851647040								
Collected: 12/21/23 21:22 Received: 01/04/24 10:25 Matrix: Drinking Water								
200.8 MET ICPMS Drinking Water								
Analytical Method: EPA 200.8								
Pace Analytical Services - Ormond Beach								
Lead	25.6	ug/L	1.0	1		01/09/24 16:38	7439-92-1	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full, without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: HA00106

Pace Project No.: 35851647

Sample: HA00106-41		Lab ID: 35851647041	Collected: 12/21/23 21:24	Received: 01/04/24 10:25	Matrix: Drinking Water			
Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
200.8 MET ICPMS Drinking Water		Analytical Method: EPA 200.8 Pace Analytical Services - Ormond Beach						
Lead	ND	ug/L	1.0	1		01/09/24 16:45	7439-92-1	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: HA00106

Pace Project No.: 35851647

Sample: HA00106-42		Lab ID: 35851647042	Collected: 12/21/23 21:25	Received: 01/04/24 10:25	Matrix: Drinking Water			
Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
200.8 MET ICPMS Drinking Water		Analytical Method: EPA 200.8 Pace Analytical Services - Ormond Beach						
Lead	ND	ug/L	1.0	1		01/09/24 16:49	7439-92-1	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: HA00106

Pace Project No.: 35851647

Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
Sample: HA00106-43								
Lab ID: 35851647043								
Collected: 12/21/23 21:27 Received: 01/04/24 10:25 Matrix: Drinking Water								
200.8 MET ICPMS Drinking Water								
Analytical Method: EPA 200.8								
Pace Analytical Services - Ormond Beach								
Lead	1.9	ug/L	1.0	1		01/09/24 16:51	7439-92-1	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full, without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: HA00106

Pace Project No.: 35851647

Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
Sample: HA00106-44								
Lab ID: 35851647044								
Collected: 12/21/23 21:28 Received: 01/04/24 10:25 Matrix: Drinking Water								
200.8 MET ICPMS Drinking Water	Analytical Method: EPA 200.8 Pace Analytical Services - Ormond Beach							
Lead	25.6	ug/L	1.0	1		01/09/24 16:55	7439-92-1	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: HA00106

Pace Project No.: 35851647

Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
Sample: HA00106-45								
Lab ID: 35851647045								
Collected: 12/21/23 21:29 Received: 01/04/24 10:25 Matrix: Drinking Water								
200.8 MET ICPMS Drinking Water								
Analytical Method: EPA 200.8								
Pace Analytical Services - Ormond Beach								
Lead	34.9	ug/L	1.0	1		01/09/24 16:56	7439-92-1	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full, without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: HA00106

Pace Project No.: 35851647

Sample: HA00106-46		Lab ID: 35851647046	Collected: 12/21/23 21:35	Received: 01/04/24 10:25	Matrix: Drinking Water			
Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
200.8 MET ICPMS Drinking Water		Analytical Method: EPA 200.8 Pace Analytical Services - Ormond Beach						
Lead	ND	ug/L	1.0	1		01/09/24 16:58	7439-92-1	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: HA00106

Pace Project No.: 35851647

Sample: HA00106-47		Lab ID: 35851647047	Collected: 12/21/23 21:32	Received: 01/04/24 10:25	Matrix: Drinking Water			
Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
200.8 MET ICPMS Drinking Water		Analytical Method: EPA 200.8 Pace Analytical Services - Ormond Beach						
Lead	32.4	ug/L	1.0	1		01/09/24 16:59	7439-92-1	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: HA00106

Pace Project No.: 35851647

Sample: HA00106-48		Lab ID: 35851647048	Collected: 12/21/23 21:33	Received: 01/04/24 10:25	Matrix: Drinking Water			
Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
200.8 MET ICPMS Drinking Water		Analytical Method: EPA 200.8 Pace Analytical Services - Ormond Beach						
Lead	40.9	ug/L	1.0	1		01/09/24 17:01	7439-92-1	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: HA00106

Pace Project No.: 35851647

Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
Sample: HA00106-49								
Lab ID: 35851647049								
Collected: 12/21/23 21:36 Received: 01/04/24 10:25 Matrix: Drinking Water								
200.8 MET ICPMS Drinking Water	Analytical Method: EPA 200.8 Pace Analytical Services - Ormond Beach							
Lead	25.6	ug/L	1.0	1		01/09/24 17:02	7439-92-1	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: HA00106

Pace Project No.: 35851647

Sample: HA00106-50		Lab ID: 35851647050	Collected: 12/21/23 21:37	Received: 01/04/24 10:25	Matrix: Drinking Water			
Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
200.8 MET ICPMS Drinking Water		Analytical Method: EPA 200.8 Pace Analytical Services - Ormond Beach						
Lead	43.3	ug/L	1.0	1		01/09/24 17:03	7439-92-1	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: HA00106

Pace Project No.: 35851647

Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
Sample: HA00106-51								
Lab ID: 35851647051								
Collected: 12/21/23 21:39 Received: 01/04/24 10:25 Matrix: Drinking Water								
200.8 MET ICPMS Drinking Water								
Analytical Method: EPA 200.8								
Pace Analytical Services - Ormond Beach								
Lead	19.3	ug/L	1.0	1		01/09/24 17:05	7439-92-1	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full, without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: HA00106

Pace Project No.: 35851647

Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
Sample: HA00106-52								
Lab ID: 35851647052								
Collected: 12/21/23 21:41 Received: 01/04/24 10:25 Matrix: Drinking Water								
200.8 MET ICPMS Drinking Water								
Analytical Method: EPA 200.8								
Pace Analytical Services - Ormond Beach								
Lead	ND	ug/L	1.0	1		01/09/24 17:06	7439-92-1	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full, without the written consent of Pace Analytical Services, LLC.



ANALYTICAL RESULTS

Project: HA00106

Pace Project No.: 35851647

Sample: HA00106-53		Lab ID: 35851647053	Collected: 12/21/23 21:42	Received: 01/04/24 10:25	Matrix: Drinking Water			
Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
200.8 MET ICPMS Drinking Water		Analytical Method: EPA 200.8 Pace Analytical Services - Ormond Beach						
Lead	ND	ug/L	1.0	1		01/09/24 17:08	7439-92-1	

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



QUALITY CONTROL DATA

Project: HA00106

Pace Project No.: 35851647

QC Batch: 979048

Analysis Method: EPA 200.8

QC Batch Method: EPA 200.8

Analysis Description: 200.8 MET No Prep Drinking Water

Laboratory: Pace Analytical Services - Ormond Beach

Associated Lab Samples: 35851647001, 35851647002

METHOD BLANK: 5386382

Matrix: Water

Associated Lab Samples: 35851647001, 35851647002

Parameter	Units	Blank Result	Reporting Limit	Analyzed	Qualifiers
Lead	ug/L	ND	1.0	01/09/24 09:28	

LABORATORY CONTROL SAMPLE: 5386383

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Lead	ug/L	50	53.0	106	85-115	

MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 5386378 5386379

Parameter	Units	35851144001 Result	MS	MSD	MS	MSD	MS	MSD	% Rec	RPD	Qual
			Spike Conc.	Spike Conc.	Result	Result	% Rec	% Rec	Limits		
Lead	ug/L	0.22 U	50	50	53.9	54.4	108	109	70-130	1	

MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 5386380 5386381

Parameter	Units	35851646013 Result	MS	MSD	MS	MSD	MS	MSD	% Rec	RPD	Qual
			Spike Conc.	Spike Conc.	Result	Result	% Rec	% Rec	Limits		
Lead	ug/L	ND	50	50	53.3	53.6	106	107	70-130	0	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full, without the written consent of Pace Analytical Services, LLC.



QUALITY CONTROL DATA

Project: HA00106

Pace Project No.: 35851647

QC Batch:	979049	Analysis Method:	EPA 200.8
QC Batch Method:	EPA 200.8	Analysis Description:	200.8 MET No Prep Drinking Water
		Laboratory:	Pace Analytical Services - Ormond Beach
Associated Lab Samples:	35851647003, 35851647004, 35851647005, 35851647006, 35851647007, 35851647008, 35851647009, 35851647010, 35851647011, 35851647012, 35851647013, 35851647014, 35851647015, 35851647016, 35851647017, 35851647018, 35851647019, 35851647020, 35851647021, 35851647022		

METHOD BLANK:	5386388	Matrix:	Water
Associated Lab Samples:	35851647003, 35851647004, 35851647005, 35851647006, 35851647007, 35851647008, 35851647009, 35851647010, 35851647011, 35851647012, 35851647013, 35851647014, 35851647015, 35851647016, 35851647017, 35851647018, 35851647019, 35851647020, 35851647021, 35851647022		

Parameter	Units	Blank Result	Reporting Limit	Analyzed	Qualifiers
Lead	ug/L	ND	1.0	01/09/24 11:18	

LABORATORY CONTROL SAMPLE:	5386389					
Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Lead	ug/L	50	52.7	105	85-115	

MATRIX SPIKE & MATRIX SPIKE DUPLICATE:	5386384			5386385							
Parameter	Units	35851647003 Result	MS Spike Conc.	MSD Spike Conc.	MS Result	MSD Result	MS % Rec	MSD % Rec	% Rec Limits	RPD	Qual
Lead	ug/L	33.2	50	50	86.2	87.2	106	108	70-130	1	

MATRIX SPIKE & MATRIX SPIKE DUPLICATE:	5386386			5386387							
Parameter	Units	35851647022 Result	MS Spike Conc.	MSD Spike Conc.	MS Result	MSD Result	MS % Rec	MSD % Rec	% Rec Limits	RPD	Qual
Lead	ug/L	ND	50	50	53.8	54.0	107	107	70-130	0	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full, without the written consent of Pace Analytical Services, LLC.



QUALITY CONTROL DATA

Project: HA00106

Pace Project No.: 35851647

QC Batch: 979050

Analysis Method: EPA 200.8

QC Batch Method: EPA 200.8

Analysis Description: 200.8 MET No Prep Drinking Water

Laboratory: Pace Analytical Services - Ormond Beach

Associated Lab Samples: 35851647023

METHOD BLANK: 5386395

Matrix: Water

Associated Lab Samples: 35851647023

Parameter	Units	Blank Result	Reporting Limit	Analyzed	Qualifiers
Lead	ug/L	ND	1.0	01/09/24 10:31	

LABORATORY CONTROL SAMPLE: 5386396

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Lead	ug/L	50	51.8	104	85-115	

MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 5386391 5386392

Parameter	Units	35851646014		5386392		MS % Rec	MSD % Rec	% Rec Limits	RPD	Qual
		MS Spike Conc.	MSD Spike Conc.	MS Result	MSD Result					
Lead	ug/L	ND	50	50	53.8	53.6	107	107	70-130	0

MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 5386393 5386394

Parameter	Units	35851646032		5386394		MS % Rec	MSD % Rec	% Rec Limits	RPD	Qual
		MS Spike Conc.	MSD Spike Conc.	MS Result	MSD Result					
Lead	ug/L	ND	50	50	53.0	52.2	105	104	70-130	1

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full, without the written consent of Pace Analytical Services, LLC.



QUALITY CONTROL DATA

Project: HA00106

Pace Project No.: 35851647

QC Batch: 979105

Analysis Method: EPA 200.8

QC Batch Method: EPA 200.8

Analysis Description: 200.8 MET No Prep Drinking Water

Laboratory: Pace Analytical Services - Ormond Beach

Associated Lab Samples: 35851647024

METHOD BLANK: 5386850

Matrix: Water

Associated Lab Samples: 35851647024

Parameter	Units	Blank Result	Reporting Limit	Analyzed	Qualifiers
Lead	ug/L	ND	1.0	01/09/24 13:33	

LABORATORY CONTROL SAMPLE: 5386851

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Lead	ug/L	50	52.3	105	85-115	

MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 5386846 5386847

Parameter	Units	35851647024		5386847		MS % Rec	MSD % Rec	% Rec Limits	RPD	Qual
		MS Spike Conc.	MSD Spike Conc.	MS Result	MSD Result					
Lead	ug/L	ND	50	50	53.4	52.1	107	104	70-130	2

MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 5386848 5386849

Parameter	Units	35851680059		5386849		MS % Rec	MSD % Rec	% Rec Limits	RPD	Qual
		MS Spike Conc.	MSD Spike Conc.	MS Result	MSD Result					
Lead	ug/L	4.9	50	50	57.9	57.8	106	106	70-130	0

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full, without the written consent of Pace Analytical Services, LLC.



QUALITY CONTROL DATA

Project: HA00106

Pace Project No.: 35851647

QC Batch:	979212	Analysis Method:	EPA 200.8
QC Batch Method:	EPA 200.8	Analysis Description:	200.8 MET No Prep Drinking Water
		Laboratory:	Pace Analytical Services - Ormond Beach
Associated Lab Samples:	35851647025, 35851647026, 35851647027, 35851647028, 35851647029, 35851647030, 35851647031, 35851647032, 35851647033, 35851647034, 35851647035, 35851647036, 35851647037, 35851647038, 35851647040		

METHOD BLANK:	5387116	Matrix:	Water
Associated Lab Samples:	35851647025, 35851647026, 35851647027, 35851647028, 35851647029, 35851647030, 35851647031, 35851647032, 35851647033, 35851647034, 35851647035, 35851647036, 35851647037, 35851647038, 35851647040		

Parameter	Units	Blank Result	Reporting Limit	Analyzed	Qualifiers
Lead	ug/L	ND	1.0	01/09/24 16:42	

LABORATORY CONTROL SAMPLE:	5387117					
Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Lead	ug/L	50	53.4	107	85-115	

MATRIX SPIKE & MATRIX SPIKE DUPLICATE:	5387112			5387113							
Parameter	Units	35851646053 Result	MS Spike Conc.	MSD Spike Conc.	MS Result	MSD Result	MS % Rec	MSD % Rec	% Rec Limits	RPD	Qual
Lead	ug/L	ND	50	50	54.2	53.7	108	107	70-130	1	

MATRIX SPIKE & MATRIX SPIKE DUPLICATE:	5387114			5387115							
Parameter	Units	35851647040 Result	MS Spike Conc.	MSD Spike Conc.	MS Result	MSD Result	MS % Rec	MSD % Rec	% Rec Limits	RPD	Qual
Lead	ug/L	25.6	50	50	80.7	81.5	110	112	70-130	1	

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full, without the written consent of Pace Analytical Services, LLC.



QUALITY CONTROL DATA

Project: HA00106

Pace Project No.: 35851647

QC Batch:	979214	Analysis Method:	EPA 200.8
QC Batch Method:	EPA 200.8	Analysis Description:	200.8 MET No Prep Drinking Water
		Laboratory:	Pace Analytical Services - Ormond Beach
Associated Lab Samples:	35851647041, 35851647042, 35851647043, 35851647044, 35851647045, 35851647046, 35851647047, 35851647048, 35851647049, 35851647050, 35851647051, 35851647052, 35851647053		

METHOD BLANK:	5387122	Matrix:	Water
Associated Lab Samples:	35851647041, 35851647042, 35851647043, 35851647044, 35851647045, 35851647046, 35851647047, 35851647048, 35851647049, 35851647050, 35851647051, 35851647052, 35851647053		

Parameter	Units	Blank Result	Reporting Limit	Analyzed	Qualifiers
Lead	ug/L	ND	1.0	01/09/24 17:25	

LABORATORY CONTROL SAMPLE: 5387123						
Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Lead	ug/L	50	52.6	105	85-115	

MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 5387118											5387119	
Parameter	Units	35851647041 Result	MS Spike Conc.	MSD Spike Conc.	MS Result	MSD Result	MS % Rec	MSD % Rec	% Rec Limits	RPD	Qual	
Lead	ug/L	ND	50	50	54.6	54.5	108	108	70-130	0		

MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 5387120											5387121	
Parameter	Units	35851651024 Result	MS Spike Conc.	MSD Spike Conc.	MS Result	MSD Result	MS % Rec	MSD % Rec	% Rec Limits	RPD	Qual	
Lead	ug/L	ND	50	50	53.1	53.6	106	107	70-130	1		

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full, without the written consent of Pace Analytical Services, LLC.



QUALITY CONTROL DATA

Project: HA00106

Pace Project No.: 35851647

QC Batch: 979454

Analysis Method: EPA 200.8

QC Batch Method: EPA 200.8

Analysis Description: 200.8 MET Drinking Water

Laboratory: Pace Analytical Services - Ormond Beach

Associated Lab Samples: 35851647039

METHOD BLANK: 5388411

Matrix: Water

Associated Lab Samples: 35851647039

Parameter	Units	Blank Result	Reporting Limit	Analyzed	Qualifiers
Lead	ug/L	ND	1.0	01/12/24 08:37	

LABORATORY CONTROL SAMPLE: 5388412

Parameter	Units	Spike Conc.	LCS Result	LCS % Rec	% Rec Limits	Qualifiers
Lead	ug/L	50	53.5	107	85-115	

MATRIX SPIKE & MATRIX SPIKE DUPLICATE: 5388413 5388414

Parameter	Units	35851677001		5388413		5388414		% Rec Limits	RPD	Qual	
		MS Spike Conc.	MSD Spike Conc.	MS Result	MSD Result	MS % Rec	MSD % Rec				
Lead	ug/L	0.00051	1 mg/L	50	50	44.9	44.7	89	88	70-130	1

Results presented on this page are in the units indicated by the "Units" column except where an alternate unit is presented to the right of the result.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full, without the written consent of Pace Analytical Services, LLC.



QUALIFIERS

Project: HA00106

Pace Project No.: 35851647

DEFINITIONS

DF - Dilution Factor, if reported, represents the factor applied to the reported data due to dilution of the sample aliquot.

ND - Not Detected at or above adjusted reporting limit.

TNTC - Too Numerous To Count

MDL - Adjusted Method Detection Limit.

PQL - Practical Quantitation Limit.

RL - Reporting Limit - The lowest concentration value that meets project requirements for quantitative data with known precision and bias for a specific analyte in a specific matrix.

S - Surrogate

1,2-Diphenylhydrazine decomposes to and cannot be separated from Azobenzene using Method 8270. The result for each analyte is a combined concentration.

Consistent with EPA guidelines, unrounded data are displayed and have been used to calculate % recovery and RPD values.

LCS(D) - Laboratory Control Sample (Duplicate)

MS(D) - Matrix Spike (Duplicate)

DUP - Sample Duplicate

RPD - Relative Percent Difference

NC - Not Calculable.

SG - Silica Gel - Clean-Up

U - Indicates the compound was analyzed for, but not detected.

N-Nitrosodiphenylamine decomposes and cannot be separated from Diphenylamine using Method 8270. The result reported for each analyte is a combined concentration.

Reported results are not rounded until the final step prior to reporting. Therefore, calculated parameters that are typically reported as "Total" may vary slightly from the sum of the reported component parameters.

Pace Analytical is TNI accredited. Contact your Pace PM for the current list of accredited analytes.

TNI - The NELAC Institute.

ANALYTE QUALIFIERS

I The reported value is between the laboratory method detection limit and the laboratory practical quantitation limit.

U Compound was analyzed for but not detected.

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



QUALITY CONTROL DATA CROSS REFERENCE TABLE

Project: HA00106

Pace Project No.: 35851647

Lab ID	Sample ID	QC Batch Method	QC Batch	Analytical Method	Analytical Batch
35851647039	HA00106-39	EPA 200.8	979454	EPA 200.8	979478
35851647001	HA00106-01	EPA 200.8	979048		
35851647002	HA00106-02	EPA 200.8	979048		
35851647003	HA00106-03	EPA 200.8	979049		
35851647004	HA00106-04	EPA 200.8	979049		
35851647005	HA00106-05	EPA 200.8	979049		
35851647006	HA00106-06	EPA 200.8	979049		
35851647007	HA00106-07	EPA 200.8	979049		
35851647008	HA00106-08	EPA 200.8	979049		
35851647009	HA00106-09	EPA 200.8	979049		
35851647010	HA00106-10	EPA 200.8	979049		
35851647011	HA00106-11	EPA 200.8	979049		
35851647012	HA00106-12	EPA 200.8	979049		
35851647013	HA00106-13	EPA 200.8	979049		
35851647014	HA00106-14	EPA 200.8	979049		
35851647015	HA00106-15	EPA 200.8	979049		
35851647016	HA00106-16	EPA 200.8	979049		
35851647017	HA00106-17	EPA 200.8	979049		
35851647018	HA00106-18	EPA 200.8	979049		
35851647019	HA00106-19	EPA 200.8	979049		
35851647020	HA00106-20	EPA 200.8	979049		
35851647021	HA00106-21	EPA 200.8	979049		
35851647022	HA00106-22	EPA 200.8	979049		
35851647023	HA00106-23	EPA 200.8	979050		
35851647024	HA00106-24	EPA 200.8	979105		
35851647025	HA00106-25	EPA 200.8	979212		
35851647026	HA00106-26	EPA 200.8	979212		
35851647027	HA00106-27	EPA 200.8	979212		
35851647028	HA00106-28	EPA 200.8	979212		
35851647029	HA00106-29	EPA 200.8	979212		
35851647030	HA00106-30	EPA 200.8	979212		
35851647031	HA00106-31	EPA 200.8	979212		
35851647032	HA00106-32	EPA 200.8	979212		
35851647033	HA00106-33	EPA 200.8	979212		
35851647034	HA00106-34	EPA 200.8	979212		
35851647035	HA00106-35	EPA 200.8	979212		
35851647036	HA00106-36	EPA 200.8	979212		
35851647037	HA00106-37	EPA 200.8	979212		
35851647038	HA00106-38	EPA 200.8	979212		
35851647040	HA00106-40	EPA 200.8	979212		
35851647041	HA00106-41	EPA 200.8	979214		
35851647042	HA00106-42	EPA 200.8	979214		
35851647043	HA00106-43	EPA 200.8	979214		
35851647044	HA00106-44	EPA 200.8	979214		
35851647045	HA00106-45	EPA 200.8	979214		
35851647046	HA00106-46	EPA 200.8	979214		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, LLC.



QUALITY CONTROL DATA CROSS REFERENCE TABLE

Project: HA00106
 Pace Project No.: 35851647

Lab ID	Sample ID	QC Batch Method	QC Batch	Analytical Method	Analytical Batch
35851647047	HA00106-47	EPA 200.8	979214		
35851647048	HA00106-48	EPA 200.8	979214		
35851647049	HA00106-49	EPA 200.8	979214		
35851647050	HA00106-50	EPA 200.8	979214		
35851647051	HA00106-51	EPA 200.8	979214		
35851647052	HA00106-52	EPA 200.8	979214		
35851647053	HA00106-53	EPA 200.8	979214		

REPORT OF LABORATORY ANALYSIS

This report shall not be reproduced, except in full,
 without the written consent of Pace Analytical Services, LLC.

WU#: 35851647



35851647

SUBCONTRACT ORDER
Transfer Chain of Custody

Pace Analytical Services, LLC

HA00106

SENDING LABORATORY

PDC Laboratories, Inc.
2231 W Altorfer Dr
Peoria, IL 61615
(800) 752-6651

RECEIVING LABORATORY

Pace Analytical - Ormond Beach
8 East Tower Circle
Ormond Beach, FL 32174
(386) 676-4842

Sample: HA00106-01
Name: BKMS - 1

Sampled: 12/21/23 19:06
Matrix: Drinking Water
Preservative: HNO₃, pH <2

Analysis	Due	Expires	Comments
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 19:06	
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 19:06	

Sample: HA00106-02
Name: BKMS - 2

Sampled: 12/21/23 19:09
Matrix: Drinking Water
Preservative: HNO₃, pH <2

Analysis	Due	Expires	Comments
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 19:09	
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 19:09	

Sample: HA00106-03
Name: BKMS - 3

Sampled: 12/21/23 19:10
Matrix: Drinking Water
Preservative: HNO₃, pH <2

Analysis	Due	Expires	Comments
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 19:10	
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 19:10	

Sample: HA00106-04
Name: BKMS - 4

Sampled: 12/21/23 19:12
Matrix: Drinking Water
Preservative: HNO₃, pH <2

Analysis	Due	Expires	Comments
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 19:12	
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 19:12	

SUBCONTRACT ORDER
Transfer Chain of Custody
Pace Analytical Services, LLC
HA00106

SENDING LABORATORY

PDC Laboratories, Inc.
 2231 W Altorfer Dr
 Peoria, IL 61615
 (800) 752-6651

RECEIVING LABORATORY

Pace Analytical - Ormond Beach
 8 East Tower Circle
 Ormond Beach, FL 32174
 (386) 676-4842

Sample: HA00106-05
Name: BKMS - 5

Sampled: 12/21/23 19:13
Matrix: Drinking Water
Preservative: HNO₃, pH <2

Analysis	Due	Expires	Comments
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 19:13	
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 19:13	

Sample: HA00106-06
Name: BKMS - 6

Sampled: 12/21/23 19:17
Matrix: Drinking Water
Preservative: HNO₃, pH <2

Analysis	Due	Expires	Comments
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 19:17	
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 19:17	

Sample: HA00106-07
Name: BKMS - 7

Sampled: 12/21/23 19:18
Matrix: Drinking Water
Preservative: HNO₃, pH <2

Analysis	Due	Expires	Comments
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 19:18	
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 19:18	

Sample: HA00106-08
Name: BKMS - 8

Sampled: 12/21/23 00:00
Matrix: Drinking Water
Preservative: HNO₃, pH <2

Analysis	Due	Expires	Comments
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 00:00	
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 00:00	

SUBCONTRACT ORDER
Transfer Chain of Custody
Pace Analytical Services, LLC
HA00106

SENDING LABORATORY

PDC Laboratories, Inc.
 2231 W Altorfer Dr
 Peoria, IL 61615
 (800) 752-6651

RECEIVING LABORATORY

Pace Analytical - Ormond Beach
 8 East Tower Circle
 Ormond Beach, FL 32174
 (386) 676-4842

Sample: HA00106-09
Name: BKMS - 9

Sampled: 12/21/23 19:27
Matrix: Drinking Water
Preservative: HNO3, pH <2

Analysis	Due	Expires	Comments
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 19:27	
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 19:27	

Sample: HA00106-10
Name: BKMS - 10

Sampled: 12/21/23 19:29
Matrix: Drinking Water
Preservative: HNO3, pH <2

Analysis	Due	Expires	Comments
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 19:29	
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 19:29	

Sample: HA00106-11
Name: BKMS - 11

Sampled: 12/21/23 19:31
Matrix: Drinking Water
Preservative: HNO3, pH <2

Analysis	Due	Expires	Comments
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 19:31	
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 19:31	

Sample: HA00106-12
Name: BKMS - 12

Sampled: 12/21/23 19:32
Matrix: Drinking Water
Preservative: HNO3, pH <2

Analysis	Due	Expires	Comments
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 19:32	
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 19:32	

SUBCONTRACT ORDER
Transfer Chain of Custody
Pace Analytical Services, LLC
HA00106

SENDING LABORATORY

PDC Laboratories, Inc.
 2231 W Altorfer Dr
 Peoria, IL 61615
 (800) 752-6651

RECEIVING LABORATORY

Pace Analytical - Ormond Beach
 8 East Tower Circle
 Ormond Beach, FL 32174
 (386) 676-4842

Sample: HA00106-13
Name: BKMS - 13

Sampled: 12/21/23 19:34
Matrix: Drinking Water
Preservative: HNO₃, pH <2

Analysis	Due	Expires	Comments
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 19:34	
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 19:34	

Sample: HA00106-14
Name: BKMS - 14

Sampled: 12/21/23 00:00
Matrix: Drinking Water
Preservative: HNO₃, pH <2

Analysis	Due	Expires	Comments
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 00:00	
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 00:00	

Sample: HA00106-15
Name: BKMS - 15

Sampled: 12/21/23 19:38
Matrix: Drinking Water
Preservative: HNO₃, pH <2

Analysis	Due	Expires	Comments
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 19:38	
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 19:38	

Sample: HA00106-16
Name: BKMS - 16

Sampled: 12/21/23 19:39
Matrix: Drinking Water
Preservative: HNO₃, pH <2

Analysis	Due	Expires	Comments
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 19:39	
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 19:39	

**SUBCONTRACT ORDER
Transfer Chain of Custody**

Pace Analytical Services, LLC

HA00106

SENDING LABORATORY

PDC Laboratories, Inc.
2231 W Altorfer Dr
Peoria, IL 61615
(800) 752-6651

RECEIVING LABORATORY

Pace Analytical - Ormond Beach
8 East Tower Circle
Ormond Beach, FL 32174
(386) 676-4842

Sample: HA00106-17
Name: BKMS - 17

Sampled: 12/21/23 19:41
Matrix: Drinking Water
Preservative: HNO₃, pH <2

Analysis	Due	Expires	Comments
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 19:41	
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 19:41	

Sample: HA00106-18
Name: BKMS - 18

Sampled: 12/21/23 19:44
Matrix: Drinking Water
Preservative: HNO₃, pH <2

Analysis	Due	Expires	Comments
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 19:44	
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 19:44	

Sample: HA00106-19
Name: BKMS - 19

Sampled: 12/21/23 19:45
Matrix: Drinking Water
Preservative: HNO₃, pH <2

Analysis	Due	Expires	Comments
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 19:45	
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 19:45	

Sample: HA00106-20
Name: BKMS - 20

Sampled: 12/21/23 20:50
Matrix: Drinking Water
Preservative: HNO₃, pH <2

Analysis	Due	Expires	Comments
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 20:50	
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 20:50	

**SUBCONTRACT ORDER
Transfer Chain of Custody**

Pace Analytical Services, LLC

HA00106

SENDING LABORATORY

PDC Laboratories, Inc.
2231 W Altorfer Dr
Peoria, IL 61615
(800) 752-6651

RECEIVING LABORATORY

Pace Analytical - Ormond Beach
8 East Tower Circle
Ormond Beach, FL 32174
(386) 676-4842

Sample: HA00106-21
Name: BKMS - 21

Sampled: 12/21/23 19:49
Matrix: Drinking Water
Preservative: HNO₃, pH <2

Analysis	Due	Expires	Comments
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 19:49	
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 19:49	

Sample: HA00106-22
Name: BKMS - 22

Sampled: 12/21/23 19:50
Matrix: Drinking Water
Preservative: HNO₃, pH <2

Analysis	Due	Expires	Comments
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 19:50	
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 19:50	

Sample: HA00106-23
Name: BKMS - 23

Sampled: 12/21/23 19:52
Matrix: Drinking Water
Preservative: HNO₃, pH <2

Analysis	Due	Expires	Comments
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 19:52	
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 19:52	

Sample: HA00106-24
Name: BKMS - 24

Sampled: 12/21/23 19:55
Matrix: Drinking Water
Preservative: HNO₃, pH <2

Analysis	Due	Expires	Comments
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 19:55	
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 19:55	

**SUBCONTRACT ORDER
Transfer Chain of Custody**

Pace Analytical Services, LLC

HA00106

SENDING LABORATORY

PDC Laboratories, Inc.
2231 W Altorfer Dr
Peoria, IL 61615
(800) 752-6651

RECEIVING LABORATORY

Pace Analytical - Ormond Beach
8 East Tower Circle
Ormond Beach, FL 32174
(386) 676-4842

Sample: HA00106-25
Name: BKMS - 25

Sampled: 12/21/23 19:56
Matrix: Drinking Water
Preservative: HNO₃, pH <2

Analysis	Due	Expires	Comments
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 19:56	
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 19:56	

Sample: HA00106-26
Name: BKMS - 26

Sampled: 12/21/23 19:59
Matrix: Drinking Water
Preservative: HNO₃, pH <2

Analysis	Due	Expires	Comments
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 19:59	
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 19:59	

Sample: HA00106-27
Name: BKMS - 27

Sampled: 12/21/23 20:00
Matrix: Drinking Water
Preservative: HNO₃, pH <2

Analysis	Due	Expires	Comments
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 20:00	
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 20:00	

Sample: HA00106-28
Name: BKMS - 28

Sampled: 12/21/23 20:01
Matrix: Drinking Water
Preservative: HNO₃, pH <2

Analysis	Due	Expires	Comments
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 20:01	
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 20:01	

**SUBCONTRACT ORDER
Transfer Chain of Custody**

Pace Analytical Services, LLC

HA00106

SENDING LABORATORY

PDC Laboratories, Inc.
2231 W Altorfer Dr
Peoria, IL 61615
(800) 752-6651

RECEIVING LABORATORY

Pace Analytical - Ormond Beach
8 East Tower Circle
Ormond Beach, FL 32174
(386) 676-4842

Sample: HA00106-29

Name: BKMS - 29

Sampled: 12/21/23 20:02

Matrix: Drinking Water

Preservative: HNO₃, pH <2

Analysis	Due	Expires	Comments
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 20:02	
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 20:02	

Sample: HA00106-30

Name: BKMS - 30

Sampled: 12/21/23 20:04

Matrix: Drinking Water

Preservative: HNO₃, pH <2

Analysis	Due	Expires	Comments
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 20:04	
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 20:04	

Sample: HA00106-31

Name: BKMS - 31

Sampled: 12/21/23 20:05

Matrix: Drinking Water

Preservative: HNO₃, pH <2

Analysis	Due	Expires	Comments
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 20:05	
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 20:05	

Sample: HA00106-32

Name: BKMS - 32

Sampled: 12/21/23 20:07

Matrix: Drinking Water

Preservative: HNO₃, pH <2

Analysis	Due	Expires	Comments
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 20:07	
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 20:07	

SUBCONTRACT ORDER
Transfer Chain of Custody
Pace Analytical Services, LLC
HA00106

SENDING LABORATORY

PDC Laboratories, Inc.
 2231 W Altorfer Dr
 Peoria, IL 61615
 (800) 752-6651

RECEIVING LABORATORY

Pace Analytical - Ormond Beach
 8 East Tower Circle
 Ormond Beach, FL 32174
 (386) 676-4842

Sample: HA00106-33
Name: BKMS - 33

Sampled: 12/21/23 20:08
Matrix: Drinking Water
Preservative: HNO3, pH <2

Analysis	Due	Expires	Comments
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 20:08	
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 20:08	

Sample: HA00106-34
Name: BKMS - 34

Sampled: 12/21/23 20:09
Matrix: Drinking Water
Preservative: HNO3, pH <2

Analysis	Due	Expires	Comments
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 20:09	
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 20:09	

Sample: HA00106-35
Name: BKMS - 35

Sampled: 12/21/23 20:15
Matrix: Drinking Water
Preservative: HNO3, pH <2

Analysis	Due	Expires	Comments
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 20:15	
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 20:15	

Sample: HA00106-36
Name: BKMS - 36

Sampled: 12/21/23 20:18
Matrix: Drinking Water
Preservative: HNO3, pH <2

Analysis	Due	Expires	Comments
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 20:18	
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 20:18	

SUBCONTRACT ORDER
Transfer Chain of Custody
Pace Analytical Services, LLC
HA00106

SENDING LABORATORY

PDC Laboratories, Inc.
 2231 W Altorfer Dr
 Peoria, IL 61615
 (800) 752-6651

RECEIVING LABORATORY

Pace Analytical - Ormond Beach
 8 East Tower Circle
 Ormond Beach, FL 32174
 (386) 676-4842

Sample: HA00106-37
Name: BKMS - 37

Sampled: 12/21/23 20:18
Matrix: Drinking Water
Preservative: HNO3, pH <2

Analysis	Due	Expires	Comments
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 20:18	
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 20:18	

Sample: HA00106-38
Name: BKMS - 38

Sampled: 12/21/23 20:19
Matrix: Drinking Water
Preservative: HNO3, pH <2

Analysis	Due	Expires	Comments
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 20:19	
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 20:19	

Sample: HA00106-39
Name: BKMS - 39

Sampled: 12/21/23 20:20
Matrix: Drinking Water
Preservative: HNO3, pH <2

Analysis	Due	Expires	Comments
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 20:20	
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 20:20	

Sample: HA00106-40
Name: BKMS - 40

Sampled: 12/21/23 20:22
Matrix: Drinking Water
Preservative: HNO3, pH <2

Analysis	Due	Expires	Comments
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 20:22	
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 20:22	

SUBCONTRACT ORDER
Transfer Chain of Custody
Pace Analytical Services, LLC
HA00106

SENDING LABORATORY

PDC Laboratories, Inc.
 2231 W Altorfer Dr
 Peoria, IL 61615
 (800) 752-6651

RECEIVING LABORATORY

Pace Analytical - Ormond Beach
 8 East Tower Circle
 Ormond Beach, FL 32174
 (386) 676-4842

Sample: HA00106-41
Name: BKMS - 41

Sampled: 12/21/23 20:24
Matrix: Drinking Water
Preservative: HNO₃, pH <2

Analysis	Due	Expires	Comments
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 20:24	
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 20:24	

Sample: HA00106-42
Name: BKMS - 42

Sampled: 12/21/23 20:25
Matrix: Drinking Water
Preservative: HNO₃, pH <2

Analysis	Due	Expires	Comments
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 20:25	
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 20:25	

Sample: HA00106-43
Name: BKMS - 43

Sampled: 12/21/23 20:27
Matrix: Drinking Water
Preservative: HNO₃, pH <2

Analysis	Due	Expires	Comments
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 20:27	
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 20:27	

Sample: HA00106-44
Name: BKMS - 44

Sampled: 12/21/23 20:28
Matrix: Drinking Water
Preservative: HNO₃, pH <2

Analysis	Due	Expires	Comments
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 20:28	
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 20:28	

**SUBCONTRACT ORDER
Transfer Chain of Custody**

Pace Analytical Services, LLC

HA00106

SENDING LABORATORY

PDC Laboratories, Inc.
2231 W Altorfer Dr
Peoria, IL 61615
(800) 752-6651

RECEIVING LABORATORY

Pace Analytical - Ormond Beach
8 East Tower Circle
Ormond Beach, FL 32174
(386) 676-4842

Sample: HA00106-45
Name: BKMS - 45

Sampled: 12/21/23 20:29
Matrix: Drinking Water
Preservative: HNO3, pH <2

Analysis	Due	Expires	Comments
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 20:29	
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 20:29	

Sample: HA00106-46
Name: BKMS - 46

Sampled: 12/21/23 20:35
Matrix: Drinking Water
Preservative: HNO3, pH <2

Analysis	Due	Expires	Comments
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 20:35	
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 20:35	

Sample: HA00106-47
Name: BKMS - 47

Sampled: 12/21/23 20:32
Matrix: Drinking Water
Preservative: HNO3, pH <2

Analysis	Due	Expires	Comments
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 20:32	
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 20:32	

Sample: HA00106-48
Name: BKMS - 48

Sampled: 12/21/23 20:33
Matrix: Drinking Water
Preservative: HNO3, pH <2

Analysis	Due	Expires	Comments
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 20:33	
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 20:33	

**SUBCONTRACT ORDER
Transfer Chain of Custody**

Pace Analytical Services, LLC

HA00106

SENDING LABORATORY

PDC Laboratories, Inc.
2231 W Altorfer Dr
Peoria, IL 61615
(800) 752-6651

RECEIVING LABORATORY

Pace Analytical - Ormond Beach
8 East Tower Circle
Ormond Beach, FL 32174
(386) 676-4842

Sample: HA00106-49
Name: BKMS - 49

Sampled: 12/21/23 20:36
Matrix: Drinking Water
Preservative: HNO3, pH <2

Analysis	Due	Expires	Comments
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 20:36	
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 20:36	

Sample: HA00106-50
Name: BKMS - 50

Sampled: 12/21/23 20:37
Matrix: Drinking Water
Preservative: HNO3, pH <2

Analysis	Due	Expires	Comments
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 20:37	
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 20:37	

Sample: HA00106-51
Name: BKMS - 51

Sampled: 12/21/23 20:39
Matrix: Drinking Water
Preservative: HNO3, pH <2

Analysis	Due	Expires	Comments
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 20:39	
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 20:39	

Sample: HA00106-52
Name: BKMS - 52

Sampled: 12/21/23 20:41
Matrix: Drinking Water
Preservative: HNO3, pH <2

Analysis	Due	Expires	Comments
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 20:41	
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 20:41	

**SUBCONTRACT ORDER
Transfer Chain of Custody**

Pace Analytical Services, LLC

HA00106

SENDING LABORATORY

PDC Laboratories, Inc.
2231 W Altorfer Dr
Peoria, IL 61615
(800) 752-6651

RECEIVING LABORATORY

Pace Analytical - Ormond Beach
8 East Tower Circle
Ormond Beach, FL 32174
(386) 676-4842

Sample: HA00106-53
Name: BKMS - 53

Sampled: 12/21/23 20:42
Matrix: Drinking Water
Preservative: HNO3, pH <2

Analysis	Due	Expires	Comments
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 20:42	
01-Pb 200.8 DW Schools	01/15/24 16:00	06/18/24 20:42	

Please email results to Chenise Lambert-Sykes at Chenise.Lambert-Sykes@pacelabs.com

Date Shipped: _____ Total # of Containers: 53 Sample Origin (State): _____ PO #: _____

Turn-Around Time Requested NORMAL RUSH

Date Results Needed: 1/14/24

<u>[Signature]</u>	<u>1/3/24 1359</u>	<u>ZAS/Pace</u>	<u>1/4/23 1025</u>	Sample Temperature Upon Receipt	_____ °C
Relinquished By	Date/Time	Received By	Date/Time	Sample(s) Received on Ice	Y or N
				Proper Bottles Received in Good Condition	Y or N
				Bottles Filled with Adequate Volume	Y or N
				Samples Received Within Hold Time	Y or N
				Date/Time Taken From Sample Bottle	Y or N

Pace

Sample Condition Upon Receipt Form (SCUR)

Project #
Project Manager:
Client:

WO#: 35851647
PM: BTS Due Date: 01/11/24
CLIENT: PACHAZ

Date and Initials of person:
Examining contents: KAMI/JRS
Label:
Deliver: NPI
pH:
Initials: ZRB

Thermometer Used: T-409 Date: 1/4/24 Time: 1027

State of Origin:	<input type="checkbox"/> For WV projects, all containers verified to 56 °C	
Cooler #1 Temp. °C	13.7 (Visual) -0.1 (Correction Factor)	13.6 (Actual)
Cooler #2 Temp. °C	13.5 (Visual)	13.4 (Actual)
Cooler #3 Temp. °C	14.8 (Visual)	14.7 (Actual)
Cooler #4 Temp. °C	15.3 (Visual)	15.2 (Actual)
Cooler #5 Temp. °C	16.0 (Visual)	15.9 (Actual)
Cooler #6 Temp. °C	15.7 (Visual)	15.6 (Actual)
Recheck for OOT °C	14.4 (Visual)	14.3 (Actual)

- Samples on ice, cooling process has begun.
 - Samples on ice, cooling process has begun.
 - Samples on ice, cooling process has begun.
 - Samples on ice, cooling process has begun.
 - Samples on ice, cooling process has begun.
 - Samples on ice, cooling process has begun.
- Time: _____ Initials: _____

Courier: Fed Ex UPS USPS Client Commercial Pace Other

Shipping Method: Standard Overnight First Overnight Priority Overnight Ground International Priority Other

Billing: Recipient Sender Third Party Credit Card Unknown

Tracking # 7003 7810 9807

Custody Seal Present: Yes No Seal properly placed and intact: Yes No

Packing Material: Bubble Wrap Bubble Bags None Other

Ice: Wet Blue Dry None Melted

Samples shorted to lab: Yes No (If yes, complete the following)

Shorted Date: _____

Bottle Quantity / Type: _____

Shorted Time: _____

Chain of Custody:	Present: <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No Filled Out: <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A Sampler Name: <input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A
	Relinquished To Pace: <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A Sampling Date(s): <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A Sampling Time(s): <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A
Samples Arrived within Hold Time	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A Comments:
Rush Turnaround Requested on COC	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A Comments:
Sufficient Volume	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A Comments:
Correct Containers Used	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A Comments:
Containers Intact	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A Comments:
Sample Labels Match COC (Sample ID, Date/Time of Collection)	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A Comments:
Containers needing acid / base preservation have been checked	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A
Containers needing preservation are found to be in compliance with A recommendation:	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A
Exceptions: Vials, Microbiology, O&G, PFAS	
Headspace in Volatile Vials? (>6mm):	
Blank Present:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A
Comments / Resolutions (use back for additional comments):	

Preservation Information

Preservative: _____ Date: _____

Lot / Trace: _____ Time: _____

Amount added (mL): _____ Initials: _____



Sample Condition Upon Receipt Form (SCUR)

Date and Initials of person: _____

Examining contents: _____

Label: _____

Deliver: Not

pH: _____

Initials: ZAB

Project # _____
 Project Manager: _____
 Client: _____

1025

Thermometer Used: T-409

Date: 1/14/24

Time: 1027

State of Origin: _____

For WV projects, all containers verified to ≤6 °C

Cooler #1 Temp. °C	<u>14.9</u> (Visual)	<u>-0.1</u> (Correction Factor)	<u>14.9</u> (Actual)
Cooler #2 Temp. °C	<u>15.9</u> (Visual)		<u>15.8</u> (Actual)
Cooler #3 Temp. °C	<u>13.7</u> (Visual)		<u>13.6</u> (Actual)
Cooler #4 Temp. °C	<u>14.2</u> (Visual)		<u>14.1</u> (Actual)
Cooler #5 Temp. °C	<u>14.8</u> (Visual)		<u>14.7</u> (Actual)
Cooler #6 Temp. °C	<u>15.1</u> (Visual)		<u>15.0</u> (Actual)
Recheck for OOT °C	<u>16.2</u> (Visual)		<u>16.1</u> (Actual)

- Samples on ice, cooling process has begun.
- Samples on ice, cooling process has begun.
- Samples on ice, cooling process has begun.
- Samples on ice, cooling process has begun.
- Samples on ice, cooling process has begun.
- Samples on ice, cooling process has begun.

Time: _____ Initials: _____

Courier: Fed Ex UPS USPS Client Commercial Pace Other: _____

Shipping Method: Standard Overnight First Overnight Priority Overnight Ground International Priority Other: _____

Billing: Recipient Sender Third Party Credit Card Unknown

Tracking # _____

Custody Seal Present: Yes No Seal properly placed and intact: Yes No

Ice: Wet Blue Dry None Melted

Packing Material: Bubble Wrap Bubble Bags None Other: _____

Samples shorted to lab: Yes No (If yes, complete the following)

Shorted Date: _____

Shorted Time: _____

Bottle Quantity / Type: _____

Chain of Custody:	Present: <input type="checkbox"/> Yes <input type="checkbox"/> No Filled Out: <input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A Sampler Name: <input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A										
	Relinquished To Pace: <input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A Sampling Date(s): <input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A Sampling Time(s): <input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A										
Samples Arrived within Hold Time	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	Comments: _____									
Rush Turnaround Requested on COC	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	Comments: _____									
Sufficient Volume	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	Comments: _____									
Correct Containers Used	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	Comments: _____									
Containers Intact	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	Comments: _____									
Sample Labels Match COC (Sample ID, Date/Time of Collection)	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	Comments: _____									
All containers needing acid / base preservation have been checked.	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	<table border="1" style="width: 100%;"> <tr> <th colspan="2">Preservation Information</th> </tr> <tr> <td>Preservative: _____</td> <td>Date: _____</td> </tr> <tr> <td>Lot / Trace: _____</td> <td>Time: _____</td> </tr> <tr> <td>Amount added (mL): _____</td> <td>Initials: _____</td> </tr> </table>		Preservation Information		Preservative: _____	Date: _____	Lot / Trace: _____	Time: _____	Amount added (mL): _____	Initials: _____
Preservation Information											
Preservative: _____	Date: _____										
Lot / Trace: _____	Time: _____										
Amount added (mL): _____	Initials: _____										
All containers needing preservation are found to be in compliance with EPA recommendation: <small>Exceptions: Vials, Microbiology, O&G, PFAS</small>	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A										
Headspace in Volatile Vials? (>6mm):	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A										
Trip Blank Present:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A										

Comments / Resolutions (use back for additional comments): _____



Sample Condition Upon Receipt Form (SCUR)

Project #
 Project Manager:
 Client:

1025

Date and Initials of person:

Examining contents: _____

Label: _____

Deliver: NA

pH: _____

Initials: ZNB

Thermometer Used: T-409

Date: 1/14/24

Time: 1027

State of Origin: _____ For WV projects, all containers verified to ≤6 °C

Cooler #1 Temp. °C	<u>16.4</u> (Visual)	<u>-0.1</u> (Correction Factor)	<u>16.3</u> (Actual)
Cooler #2 Temp. °C	<u>17.2</u> (Visual)		<u>17.1</u> (Actual)
Cooler #3 Temp. °C	<u>15.6</u> (Visual)		<u>15.5</u> (Actual)
Cooler #4 Temp. °C	<u>14.5</u> (Visual)		<u>14.4</u> (Actual)
Cooler #5 Temp. °C	<u>15.8</u> (Visual)		<u>15.7</u> (Actual)
Cooler #6 Temp. °C	<u>16.3</u> (Visual)		<u>16.2</u> (Actual)

- Samples on ice, cooling process has begun.
- Samples on ice, cooling process has begun.
- Samples on ice, cooling process has begun.
- Samples on ice, cooling process has begun.
- Samples on ice, cooling process has begun.
- Samples on ice, cooling process has begun.

Recheck for OOT °C _____ (Visual) _____ (Correction Factor) _____ (Actual)

Time: _____ Initials: _____

Courier: Fed Ex UPS USPS Client Commercial Pace Other: _____

Shipping Method: Standard Overnight First Overnight Priority Overnight Ground International Priority Other: _____

Billing: Recipient Sender Third Party Credit Card Unknown

Tracking # _____

Custody Seal Present: Yes No Seal properly placed and intact: Yes No

Ice: Wet Blue Dry None Melted

Packing Material: Bubble Wrap Bubble Bags None Other: _____

Samples shorted to lab: Yes No (if yes, complete the following)

Shorted Date: _____

Shorted Time: _____

Bottle Quantity / Type: _____

Chain of Custody:	Present: <input type="checkbox"/> Yes <input type="checkbox"/> No Filled Out: <input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A Sampler Name: <input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A								
	Relinquished To Pace: <input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A Sampling Date(s): <input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A Sampling Time(s): <input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A								
Samples Arrived within Hold Time.	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A Comments: _____								
Rush Turnaround Requested on COC.	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A Comments: _____								
Sufficient Volume.	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A Comments: _____								
Correct Containers Used.	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A Comments: _____								
Containers Intact.	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A Comments: _____								
Sample Labels Match COC (Sample ID, Date/Time of Collection).	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A Comments: _____								
All containers needing acid / base preservation have been checked.	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A								
All containers needing preservation are found to be in compliance with EPA recommendation.	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A								
Exceptions: Vials, Microbiology, O&G, PFAS									
Headspace in Volatile Vials? (>6mm):	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A								
Trip Blank Present:	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A								
<table border="1"> <tr> <th colspan="2">Preservation Information</th> </tr> <tr> <td>Preservative: _____</td> <td>Date: _____</td> </tr> <tr> <td>Lot / Trace: _____</td> <td>Time: _____</td> </tr> <tr> <td>Amount added (mL): _____</td> <td>Initials: _____</td> </tr> </table>		Preservation Information		Preservative: _____	Date: _____	Lot / Trace: _____	Time: _____	Amount added (mL): _____	Initials: _____
Preservation Information									
Preservative: _____	Date: _____								
Lot / Trace: _____	Time: _____								
Amount added (mL): _____	Initials: _____								

Comments / Resolutions (use back for additional comments): _____

REGULATORY PROGRAM (CIRCLE):	NPDES
MORBCA	RCRA
CCDD	TACO: RES OR IND/COMM

CHAIN OF CUSTODY RECORD
 STATE WHERE SAMPLE COLLECTED MO

ALL HIGHLIGHTED AREAS MUST BE COMPLETED BY CLIENT (PLEASE PRINT)

1 CLIENT SCI Engineering	PROJECT NUMBER 2016-0860.ZT	PROJECT LOCATION Buerkle	PURCHASE ORDER #	3 ANALYSIS REQUESTED + + DW Pb Turb Check	4 (FOR LAB USE ONLY) LOGIN # HA00106 LOGGED BY: SAB CLIENT: SCI Engineering PROJECT: Drinking Water Lead PROJ. MGR.: Chenise Lambert-Sykes CUSTODY SEAL #: _____	
	ADDRESS 130 Point West Blvd	PHONE NUMBER (314) 581-7570	E-MAIL ggrissom@sciengineering.com			DATE SHIPPED
	CITY STATE ZIP St. Charles, MO 63301	SAMPLER (PLEASE PRINT) Dan Uelander	SAMPLER'S SIGNATURE <i>[Signature]</i>			MATRIX TYPES: WW-WASTEWATER DW-DRINKING WATER GW-GROUND WATER WWSL-SLUDGE NAS-NON AQUEOUS SOLID LCHT-LEACHATE OIL-OIL SO-SOIL SOL-SOLID
CONTACT PERSON Glen Grissom						

2 SAMPLE DESCRIPTION (UNIQUE DESCRIPTION AS IT WILL APPEAR ON THE ANALYTICAL REPORT)	DATE COLLECTED	TIME COLLECTED	SAMPLE TYPE		MATRIX TYPE	BOTTLE COUNT	PRES CODE CLIENT PROVIDED	DW	Pb	Turb	Check	REMARKS
			GRAB	COMP								
BKMS-1	12-21-23	1906	X		DW	1	6	X	X			
BKMS-2		1909						X	X			
BKMS-3		1910						X	X			
BKMS-4		1912						X	X			
BKMS-5		1913						X	X			
BKMS-6		1917						X	X			
BKMS-7		1918						X	X			
BKMS-8		1923						X	X			
BKMS-9		1927						X	X			
BKMS-10		1929						X	X			
BKMS-11		1931						X	X			

CHEMICAL PRESERVATION CODES: 1-HCL 2-H2SO4 3-HNO3 4-NAOH 5-NA2S2O3 6-UNPRESERVED 7-OTHER

5 TURNAROUND TIME REQUESTED (PLEASE CIRCLE) <u>NORMAL</u> RUSH (RUSH TAT IS SUBJECT TO PACE LABS APPROVAL AND SURCHARGE)	DATE RESULTS NEEDED	6 I understand that by initialing this box I give the lab permission to proceed with analysis, even though it may not meet all sample conformance requirements as defined in the receiving facility's Sample Acceptance Policy and the data will be qualified. Qualified data may NOT be acceptable to report to all regulatory authorities.
RUSH RESULTS VIA (PLEASE CIRCLE) EMAIL PHONE	PROCEED WITH ANALYSIS AND QUALIFY RESULTS: (INITIALS) _____	
EMAIL IF DIFFERENT FROM ABOVE: _____	PHONE # IF DIFFERENT FROM ABOVE: _____	

7 RELINQUISHED BY: (SIGNATURE) <i>[Signature]</i>	DATE 12/29/23	RECEIVED BY: (SIGNATURE) <i>[Signature]</i>	DATE 12/29/23	8 COMMENTS: (FOR LAB USE ONLY) SAMPLE TEMPERATURE UPON RECEIPT 22.4 °C IR 5 CHILL PROCESS STARTED PRIOR TO RECEIPT Y OR N SAMPLE(S) RECEIVED ON ICE Y OR N SAMPLE ACCEPTANCE NONCONFORMANT REPORT IS NEEDED Y OR N DATE AND TIME TAKEN FROM SAMPLE BOTTLE _____
	TIME 4:00pm		TIME 1640	
	RELINQUISHED BY: (SIGNATURE) <i>[Signature]</i>	DATE 1/2/24	RECEIVED BY: (SIGNATURE) <i>[Signature]</i>	
RELINQUISHED BY: (SIGNATURE) <i>[Signature]</i>	TIME 8:05		TIME 1020	
	DATE 1-2-24	RECEIVED BY: (SIGNATURE) <i>[Signature]</i>	DATE 1/2/24	
	TIME 1535		TIME 1535	

Page 104 of 108

REGULATORY PROGRAM (CIRCLE):	NPDES
MORBCA	RCRA
CCDD	TACO: RES OR IND/COMM

CHAIN OF CUSTODY RECORD
 STATE WHERE SAMPLE COLLECTED MO

ALL HIGHLIGHTED AREAS MUST BE COMPLETED BY CLIENT (PLEASE PRINT)

1 CLIENT SCI Engineering	PROJECT NUMBER 2016-0860-AT	PROJECT LOCATION Buerkle	PURCHASE ORDER #	3 ANALYSIS REQUESTED + +	4 (FOR LAB USE ONLY) LOGIN # HA0010C LOGGED BY: SFB CLIENT: SCI Engineering PROJECT: Drinking Water Lead PROJ. MGR.: Chenise Lambert-Sykes CUSTODY SEAL #: _____
	ADDRESS 130 Point West Blvd	PHONE NUMBER (314) 581-7570	E-MAIL ggrissom@sciengineering.com		
CITY STATE ZIP St. Charles, MO 63301	SAMPLER (PLEASE PRINT) Dan Vreluber	MATRIX TYPES: WW- WASTEWATER DW- DRINKING WATER GW- GROUND WATER WWSL- SLUDGE NAS- NON AQUEOUS SOLID LCHL- LEACHATE OIL-OIL SO-SOIL SOL-SOLID		DW Pb Turb Check	REMARKS
CONTACT PERSON Glen Grissom	SAMPLER'S SIGNATURE				

2 SAMPLE DESCRIPTION (UNIQUE DESCRIPTION AS IT WILL APPEAR ON THE ANALYTICAL REPORT)	DATE COLLECTED	TIME COLLECTED	SAMPLE TYPE		MATRIX TYPE	BOTTLE COUNT	PRES CODE CLIENT PROVIDED	DW	Pb	Turb	Check	REMARKS
			GRAB	COMP								
BKMS-12	12-21-23	1932	X		DW	1	6	X	X			
BKMS-13		1934						X	X			
BKMS-14		1936						X	X			
BKMS-15		1938						X	X			
BKMS-16		1939						X	X			
BKMS-17		1941						X	X			
BKMS-18		1944						X	X			
BKMS-19		1945						X	X			
BKMS-20		2050						X	X			
BKMS-21		1949						X	X			
BKMS-22		1950						X	X			

CHEMICAL PRESERVATION CODES: 1-HCL 2-H2SO4 3-HNO3 4-NAOH 5-NA2S2O3 6-UNPRESERVED 7-OTHER

5 TURNAROUND TIME REQUESTED (PLEASE CIRCLE) (RUSH TAT IS SUBJECT TO PACE LABS APPROVAL AND SURCHARGE) NORMAL RUSH	DATE RESULTS NEEDED	6 I understand that by initialing this box I give the lab permission to proceed with analysis, even though it may not meet all sample conformance requirements as defined in the receiving facility's Sample Acceptance Policy and the data will be qualified. Qualified data may NOT be acceptable to report to all regulatory authorities.
RUSH RESULTS VIA (PLEASE CIRCLE) EMAIL PHONE	PROCEED WITH ANALYSIS AND QUALIFY RESULTS: (INITIALS)	
EMAIL IF DIFFERENT FROM ABOVE: PHONE # IF DIFFERENT FROM ABOVE:		

7 RELINQUISHED BY: (SIGNATURE) Dan Vreluber	DATE 12-21-23	RECEIVED BY: (SIGNATURE) Dan Campbell	DATE 12/29/23	8 COMMENTS: (FOR LAB USE ONLY) SAMPLE TEMPERATURE UPON RECEIPT 22.4 °C IR 5 CHILL PROCESS STARTED PRIOR TO RECEIPT Y OR N SAMPLE(S) RECEIVED ON ICE Y OR N SAMPLE ACCEPTANCE NONCONFORMANT REPORT IS NEEDED Y OR N DATE AND TIME TAKEN FROM SAMPLE BOTTLE
	TIME		TIME	
	DATE 1-2-24	RECEIVED BY: (SIGNATURE) Denny M	DATE 1-2-24	
RELINQUISHED BY: (SIGNATURE) Chenise Lambert-Sykes	DATE 8:05		TIME 1020	
RELINQUISHED BY: (SIGNATURE) Denny M	DATE 1-2-24	RECEIVED BY: (SIGNATURE) Glen Grissom	DATE 1-2-24	
	TIME 1535		TIME 1535	

Page 105 of 108

REGULATORY PROGRAM (CIRCLE):	NPDES
MORBCA	RCRA
CCDD	TACO: RES OR IND/COMM

CHAIN OF CUSTODY RECORD

STATE WHERE SAMPLE COLLECTED MO

ALL HIGHLIGHTED AREAS MUST BE COMPLETED BY CLIENT (PLEASE PRINT)

1 CLIENT SCI Engineering	PROJECT NUMBER <u>2016-0860-AT</u>	PROJECT LOCATION <u>Buerkle</u>	PURCHASE ORDER #	3 ANALYSIS REQUESTED <input type="checkbox"/> <input type="checkbox"/>	4 (FOR LAB USE ONLY) LOGIN # <u>HAC0106</u> LOGGED BY: <u>SAB</u> CLIENT: <u>SCI Engineering</u> PROJECT: <u>Drinking Water Lead</u> PROJ. MGR.: <u>Chenise Lambert-Sykes</u> CUSTODY SEAL #:
	ADDRESS <u>130 Point West Blvd</u>	PHONE NUMBER <u>(314) 581-7570</u>	E-MAIL <u>ggrissom@sciengineering.com</u>		
CITY STATE ZIP <u>St. Charles, MO 63301</u>	SAMPLER (PLEASE PRINT) <u>Dan Voelker</u>	MATRIX TYPES: WW- WASTEWATER DW- DRINKING WATER GW- GROUND WATER WWSL- SLUDGE NAS- NON AQUEOUS SOLID LCHL- LEACHATE OIL-OIL SO-SOIL SOL-SOLID			
CONTACT PERSON <u>Glen Grissom</u>	SAMPLER'S SIGNATURE <u>Dan Voelker</u>				

2 SAMPLE DESCRIPTION (UNIQUE DESCRIPTION AS IT WILL APPEAR ON THE ANALYTICAL REPORT)	DATE COLLECTED	TIME COLLECTED	SAMPLE TYPE		MATRIX TYPE	BOTTLE COUNT	PRES CODE CLIENT PROVIDED	DW Pb	Turb Check	REMARKS
			GRAB	COMP						
<u>BKMS-23</u>	<u>12-21-23</u>	<u>1952</u>	<u>X</u>		<u>DW</u>	<u>1</u>	<u>6</u>	<u>X</u>	<u>X</u>	
<u>BKMS-24</u>	<u> </u>	<u>1955</u>	<u> </u>		<u> </u>	<u> </u>	<u> </u>	<u>X</u>	<u>X</u>	
<u>BKMS-25</u>	<u> </u>	<u>1956</u>	<u> </u>		<u> </u>	<u> </u>	<u> </u>	<u>X</u>	<u>X</u>	
<u>BKMS-26</u>	<u> </u>	<u>1959</u>	<u> </u>		<u> </u>	<u> </u>	<u> </u>	<u>X</u>	<u>X</u>	
<u>BKMS-27</u>	<u> </u>	<u>2000</u>	<u> </u>		<u> </u>	<u> </u>	<u> </u>	<u>X</u>	<u>X</u>	
<u>BKMS-28</u>	<u> </u>	<u>2001</u>	<u> </u>		<u> </u>	<u> </u>	<u> </u>	<u>X</u>	<u>X</u>	
<u>BKMS-29</u>	<u> </u>	<u>2002</u>	<u> </u>		<u> </u>	<u> </u>	<u> </u>	<u>X</u>	<u>X</u>	
<u>BKMS-30</u>	<u> </u>	<u>2004</u>	<u> </u>		<u> </u>	<u> </u>	<u> </u>	<u>X</u>	<u>X</u>	
<u>BKMS-31</u>	<u> </u>	<u>2005</u>	<u> </u>		<u> </u>	<u> </u>	<u> </u>	<u>X</u>	<u>X</u>	
<u>BKMS-32</u>	<u> </u>	<u>2007</u>	<u> </u>		<u> </u>	<u> </u>	<u> </u>	<u>X</u>	<u>X</u>	
<u>BKMS-33</u>	<u> </u>	<u>2008</u>	<u> </u>		<u> </u>	<u> </u>	<u> </u>	<u>X</u>	<u>X</u>	

CHEMICAL PRESERVATION CODES: 1-HCL 2-H2SO4 3-HNO3 4-NAOH 5-NA2S2O3 6-UNPRESERVED 7-OTHER

5 TURNAROUND TIME REQUESTED (PLEASE CIRCLE) (RUSH TAT IS SUBJECT TO PACE LABS APPROVAL AND SURCHARGE) <u>NORMAL</u> RUSH	DATE RESULTS NEEDED	6 I understand that by initialing this box I give the lab permission to proceed with analysis, even though it may not meet all sample performance requirements as defined in the receiving facility's Sample Acceptance Policy and the data will be qualified. Qualified data may NOT be acceptable to report to all regulatory authorities. PROCEED WITH ANALYSIS AND QUALIFY RESULTS: (INITIALS) _____
RUSH RESULTS VIA (PLEASE CIRCLE) EMAIL PHONE		
EMAIL IF DIFFERENT FROM ABOVE: PHONE # IF DIFFERENT FROM ABOVE:		

7 RELINQUISHED BY: (SIGNATURE) <u>Dan Voelker</u>	DATE	RECEIVED BY: (SIGNATURE)	DATE	8 COMMENTS: (FOR LAB USE ONLY) SAMPLE TEMPERATURE UPON RECEIPT <u>IR 5</u> <u>22.4</u> °C CHILL PROCESS STARTED PRIOR TO RECEIPT Y OR N <input type="checkbox"/> SAMPLE(S) RECEIVED ON ICE Y OR N <input type="checkbox"/> SAMPLE ACCEPTANCE NONCONFORMANT REPORT IS NEEDED Y OR N <input type="checkbox"/> DATE AND TIME TAKEN FROM SAMPLE BOTTLE
	TIME	<u>Dan Campbell</u>	TIME	
	DATE	RECEIVED BY: (SIGNATURE)	DATE	
RELINQUISHED BY: (SIGNATURE) <u>Chenise Lambert-Sykes</u>	DATE <u>1/2/24</u>	RECEIVED BY: (SIGNATURE) <u>Chenise Lambert-Sykes</u>	DATE <u>1-2-24</u>	
TIME <u>8:05</u>	TIME	RECEIVED BY: (SIGNATURE)	TIME <u>1020</u>	
RELINQUISHED BY: (SIGNATURE) <u>Chenise Lambert-Sykes</u>	DATE <u>1-2-24</u>	RECEIVED BY: (SIGNATURE) <u>Chenise Lambert-Sykes</u>	DATE <u>1/2/24</u>	
TIME <u>1535</u>	TIME	RECEIVED BY: (SIGNATURE)	TIME <u>1535</u>	

REGULATORY PROGRAM (CIRCLE):	NPDES
MORBCA	RCRA
CCDD	TACO: RES OR IND/COMM

CHAIN OF CUSTODY RECORD
 STATE WHERE SAMPLE COLLECTED MO

ALL HIGHLIGHTED AREAS MUST BE COMPLETED BY CLIENT (PLEASE PRINT)

1 CLIENT SCI Engineering ADDRESS 130 Point West Blvd CITY STATE ZIP St. Charles, MO 63301 CONTACT PERSON Glen Grissom	PROJECT NUMBER 2016-0860-AT	PROJECT LOCATION Buertle	PURCHASE ORDER #	3 ANALYSIS REQUESTED DW Pb Turb Check	4 (FOR LAB USE ONLY) LOGIN # <u>HAD0106</u> LOGGED BY: <u>SAB</u> CLIENT: <u>SCI Engineering</u> PROJECT: <u>Drinking Water Lead</u> PROJ. MGR.: <u>Chenise Lambert-Sykes</u> CUSTODY SEAL #: _____
	PHONE NUMBER (314) 581-7570	E-MAIL ggrissom@sciengineering.com	DATE SHIPPED		
	SAMPLER (PLEASE PRINT) Dan Vrelwker	MATRIX TYPES: WW- WASTEWATER DW- DRINKING WATER GW- GROUND WATER WWSL- SLUDGE NAS- NON AQUEOUS SOLID LCHL- LEACHATE OIL- OIL SO- SOIL SOL- SOLID			
	SAMPLER'S SIGNATURE 				

2 SAMPLE DESCRIPTION (UNIQUE DESCRIPTION AS IT WILL APPEAR ON THE ANALYTICAL REPORT)	DATE COLLECTED	TIME COLLECTED	SAMPLE TYPE		MATRIX TYPE	BOTTLE COUNT	PRES CODE CLIENT PROVIDED	DW Pb	Turb Check	REMARKS
			GRAB	COMP						
BKMS-34	12-21-23	2009	X		DW	1	6	X	X	
BKMS-35		2015						X	X	
BKMS-36		2018						X	X	
BKMS-37		2018						X	X	
BKMS-38		2019						X	X	
BKMS-39		2020						X	X	
BKMS-40		2022						X	X	
BKMS-41		2024						X	X	
BKMS-42		2025						X	X	
BKMS-43		2027						X	X	
BKMS-44		2028						X	X	

CHEMICAL PRESERVATION CODES: 1 - HCL 2 - H2SO4 3 - HNO3 4 - NAOH 5 - NA2S2O3 6 - UNPRESERVED 7 - OTHER

5 TURNAROUND TIME REQUESTED (PLEASE CIRCLE) (RUSH TAT IS SUBJECT TO PACE LABS APPROVAL AND SURCHARGE) NORMAL <input checked="" type="radio"/> RUSH <input type="radio"/> RUSH RESULTS VIA (PLEASE CIRCLE) EMAIL <input type="checkbox"/> PHONE <input type="checkbox"/> EMAIL IF DIFFERENT FROM ABOVE: _____ PHONE # IF DIFFERENT FROM ABOVE: _____	6 I understand that by initialing this box I give the lab permission to proceed with analysis, even though it may not meet all sample conformance requirements as defined in the receiving facility's Sample Acceptance Policy and the data will be qualified. Qualified data may NOT be acceptable to report to all regulatory authorities. PROCEED WITH ANALYSIS AND QUALIFY RESULTS: (INITIALS) _____
--	--

7 RELINQUISHED BY: (SIGNATURE) RECEIVED BY: (SIGNATURE) DATE 1/2/24 TIME 8:05 RECEIVED BY: (SIGNATURE) DATE 1-2-24 TIME 1535 RECEIVED BY: (SIGNATURE) 	8 COMMENTS: (FOR LAB USE ONLY) SAMPLE TEMPERATURE UPON RECEIPT <u>22.4</u> °C CHILL PROCESS STARTED PRIOR TO RECEIPT Y OR N <input checked="" type="checkbox"/> SAMPLE(S) RECEIVED ON ICE Y OR N <input checked="" type="checkbox"/> SAMPLE ACCEPTANCE NONCONFORMANT REPORT IS NEEDED Y OR N <input checked="" type="checkbox"/> DATE AND TIME TAKEN FROM SAMPLE BOTTLE _____
	RECEIVED BY: (SIGNATURE) DATE 1/2/24 TIME 1640 RECEIVED BY: (SIGNATURE) DATE 1-2-24 TIME 1620
	RECEIVED BY: (SIGNATURE) DATE 1/2/24 TIME 1535

courier

REGULATORY PROGRAM (CIRCLE):	NPDES
MORBCA	RCRA
CCDD	TACO: RES or IND/COMM

CHAIN OF CUSTODY RECORD
STATE WHERE SAMPLE COLLECTED MO

ALL HIGHLIGHTED AREAS MUST BE COMPLETED BY CLIENT (PLEASE PRINT)

1 CLIENT SCI Engineering	PROJECT NUMBER <u>2016-0860-AT</u>	PROJECT LOCATION <u>Buerkle</u>	PURCHASE ORDER #	3 ANALYSIS REQUESTED	4 (FOR LAB USE ONLY)	
	ADDRESS <u>130 Point West Blvd</u>	PHONE NUMBER <u>(314) 581-7570</u>	E-MAIL <u>ggrissom@sciengineering.com</u>			DATE SHIPPED
	CITY STATE ZIP <u>St. Charles, MO 63301</u>	SAMPLER (PLEASE PRINT) <u>Dan Vrelwicker</u>	MATRIX TYPES: WW- WASTEWATER DW- DRINKING WATER GW- GROUND WATER WWSL- SLUDGE NAS- NON AQUEOUS SOLID LCL- LEACHATE OIL-OIL SO-SOIL SOL-SOLID			LOG IN # <u>HAD0106</u> LOGGED BY: <u>STB</u> CLIENT: <u>SCI Engineering</u> PROJECT: <u>Drinking Water Lead</u> PROJ. MGR.: <u>Chenise Lambert-Sykes</u> CUSTODY SEAL #:
CONTACT PERSON <u>Glen Grissom</u>	SAMPLER'S SIGNATURE <u>[Signature]</u>					

2 SAMPLE DESCRIPTION (UNIQUE DESCRIPTION AS IT WILL APPEAR ON THE ANALYTICAL REPORT)	DATE COLLECTED	TIME COLLECTED	SAMPLE TYPE		MATRIX TYPE	BOTTLE COUNT	PRES CODE CLIENT PROVIDED	DW Pb	Turb Check	REMARKS
			GRAB	COMP						
BKMS-45	12-21-23	2029	X		DW	1	6	X	X	
BKMS-46		2035						X	X	
BKMS-47		2032						X	X	
BKMS-48		2033						X	X	
BKMS-49		2036						X	X	
BKMS-50		2037						X	X	
BKMS-51		2039						X	X	
BKMS-52		2041						X	X	
BKMS-53		2042						X	X	

CHEMICAL PRESERVATION CODES:	1 - HCL	2 - H2SO4	3 - HNO3	4 - NAOH	5 - NA2S2O3	6 - UNPRESERVED	7 - OTHER
------------------------------	---------	-----------	----------	----------	-------------	-----------------	-----------

5 TURNAROUND TIME REQUESTED (PLEASE CIRCLE) (RUSH TAT IS SUBJECT TO PACE LABS APPROVAL AND SURCHARGE)	<input checked="" type="radio"/> NORMAL <input type="radio"/> RUSH	DATE RESULTS NEEDED	6 I understand that by initialing this box I give the lab permission to proceed with analysis, even though it may not meet all sample conformance requirements as defined in the receiving facility's Sample Acceptance Policy and the data will be qualified. Qualified data may NOT be acceptable to report to all regulatory authorities.
RUSH RESULTS VIA (PLEASE CIRCLE) EMAIL PHONE			PROCEED WITH ANALYSIS AND QUALIFY RESULTS: (INITIALS) _____
EMAIL IF DIFFERENT FROM ABOVE: PHONE # IF DIFFERENT FROM ABOVE:			

7 RELINQUISHED BY: (SIGNATURE)	DATE	RECEIVED BY: (SIGNATURE)	DATE	8 COMMENTS: (FOR LAB USE ONLY)
	TIME		TIME	
	DATE	RECEIVED BY: (SIGNATURE)	DATE	
	TIME		TIME	
RELINQUISHED BY: (SIGNATURE)	DATE	RECEIVED BY: (SIGNATURE)	DATE	SAMPLE TEMPERATURE UPON RECEIPT <u>IR 5</u> <u>22.4</u> °C CHILL PROCESS STARTED PRIOR TO RECEIPT Y OR N SAMPLE(S) RECEIVED ON ICE Y OR N SAMPLE ACCEPTANCE NONCONFORMANT REPORT IS NEEDED Y OR N DATE AND TIME TAKEN FROM SAMPLE BOTTLE _____
RELINQUISHED BY: (SIGNATURE)	DATE	RECEIVED BY: (SIGNATURE)	DATE	
RELINQUISHED BY: (SIGNATURE)	DATE	RECEIVED BY: (SIGNATURE)	DATE	
RELINQUISHED BY: (SIGNATURE)	DATE	RECEIVED BY: (SIGNATURE)	DATE	

count