



SCI ENGINEERING, INC.

EARTH • SCIENCE • SOLUTIONS

GEOTECHNICAL
ENVIRONMENTAL
NATURAL RESOURCES
CULTURAL RESOURCES
CONSTRUCTION SERVICES

April 2, 2024

Michael Gegg
Mehlville School District
3120 Lemay Ferry Road
St. Louis, Missouri 63125

RE: Lead in Drinking Water Report
Washington Middle School
5165 Ambs Road
St. Louis, Missouri
SCI No. 2016-0860.2T

Dear Michael Gegg:

INTRODUCTION

SCI Engineering, Inc. (SCI) is pleased to submit this report summarizing lead in drinking water sampling activities performed on January 15, 2024. The purpose of the sampling activities was to screen for elevated levels of lead in the drinking water at potable water sources throughout the above-referenced structure.

The drinking water survey is intended to satisfy the requirements for the “Get the Lead Out of School Drinking Water Act” (GTLOSDWA), Section 160.077 administered by the Missouri Department of Health and Senior Services. Potable water sources to be tested were identified by the school district prior to SCI’s field activities.

LIMITATIONS

SCI’s sampling activities were limited to locations identified by the school district. If any additional potable water sources need testing, please contact SCI, and we will make arrangements for sampling these fixtures. Potable water sources that were not sampled will need a sign placed near each fixture informing students and faculty it is not to be used as a drinking water source.

During the course of performing the drinking water sampling of the structure, SCI was unable to sample four fixtures because they were out of order. These fixtures included the left drinking fountains in the boy’s and girl’s locker room, the 2nd floor left drinking fountain by the bathrooms, and the sink in the southwest corner of Room 311. If these fixtures are made operational, they should be sampled or labeled non-potable. SCI was able to sample all other locations identified by the school district.

DRINKING WATER SURVEY

SCI collected “first draw” samples which consisted of collecting a water sample from each fixture or sample location after it remained stagnant for at least eight hours. Prior to sampling, SCI first mobilized

to the site to flush the identified potable water fixtures throughout the structure. Once each fixture was flushed, a sign was placed on the fixture indicating it should not be used. SCI then revisited the site, after a minimum of eight hours, to collect water samples from the fixtures.

SCI collected 47 drinking water samples (WMS-1 through WMS-6 and WMS-8 through WMS-48) from various water fixtures located throughout the structure and submitted them for analytical testing. The dish washer sprayer (WMS-7) was flushed during SCI's first site visit. However, per GTLOSDWA, this fixture does not need to be sampled. Therefore, during SCI's second site visit, this fixture was skipped, resulting in sample identification up to WMS-48. The drinking water samples were analyzed for total lead by U.S. EPA Method 200.8. SCI collected a minimum of 250 milliliters of water from each location. Sampled water was containerized in laboratory-provided sample containers and shipped to the lab using standard chain-of-custody procedures. Figures depicting the locations of the sampled water fixtures are enclosed.

The drinking water samples were analyzed for lead in accordance with the GTLOSDWA, Section 160.077, which establishes an action level (AL) of 5 parts per billion (ppb). The drinking water samples which exceeded the AL are identified in Table 1, below. SCI collected samples from the science room lab sinks, however, SCI was then informed that the school district did not need these tested and signs will be put up indicating these sinks are non-potable. Therefore, any exceedances from the science room lab sinks are not included in Table 1 below. A copy of the analytical test results and chain-of-custody for all samples is enclosed.

Table 1 – Lead in Drinking Water Results

Sample Number	Sample Location	Sample Description	Result (ppb)
WMS-39	Room 311	Right Sink	11.2
WMS-40	Room 311	Middle Sink	8.04
WMS-41	Room 311	Front Sink	39.4
WMS-43	Room 307	Sink	17.9

CONCLUSION AND RECOMMENDATIONS

As can be seen in Table 1, above, four drinking water samples, not including the science room lab sinks, exceeded the AL. SCI recommends any fixture which exceeds the AL be taken out of service until remediated and follow up testing indicates results less than the AL. Alternatively, if a water fixture is determined not to be a potable drinking water source, signage may be installed indicating the purpose and/or restrictions of the fixture.

According to GTLOSDWA, any water fixtures which exceed the AL shall be remediated prior to August 1, 2024, or the first day on which students will be present in the building, whichever is later. Any replacement fixture shall be lead free, as defined in 40 CFR 143.12.

REPORTING

Within seven business days after receiving this report, the school district shall contact parents and staff via written notification which shall include the following:

- The test results and a summary that explains such results;
- A description of any remedial steps taken;
- A description of general health effects of lead contamination and community specific resources; and
- If there is not enough water to meet the drinking water needs of the students, teachers and staff, bottled water shall be provided.

Additionally, within two weeks of receiving this report, the results and any lead remediation plans must be made available on the school's website.

This report, and subsequent annual testing reports, must be submitted to the Missouri Department of Health and Senior Services, Healthy Drinking Water Unit, PO Box 570, Jefferson City, MO 65102-0570.

FUTURE TESTING

After the fixtures identified in Table 1, above, have been remediated, at least 25 percent of the remediated fixtures must be sampled annually until all remediated sources have been tested. However, SCI recommends all fixtures be tested once they have been remediated. Once all fixtures have been tested and are below the action level, the school shall test the potable drinking water fixtures once every five years.

SCI appreciates the opportunity to be of service to you on this project, and we look forward to working with you in the future. Please contact us if you have any questions or comments regarding the information provided.

Respectfully,

SCI ENGINEERING, INC.



Brian L. Lieb
Project Scientist




Jessica B. Keeven, CHMM
Senior Scientist

BLL/JBK/bms

Enclosure

Lead Drinking Water Sampling Plan
Lead Testing Results

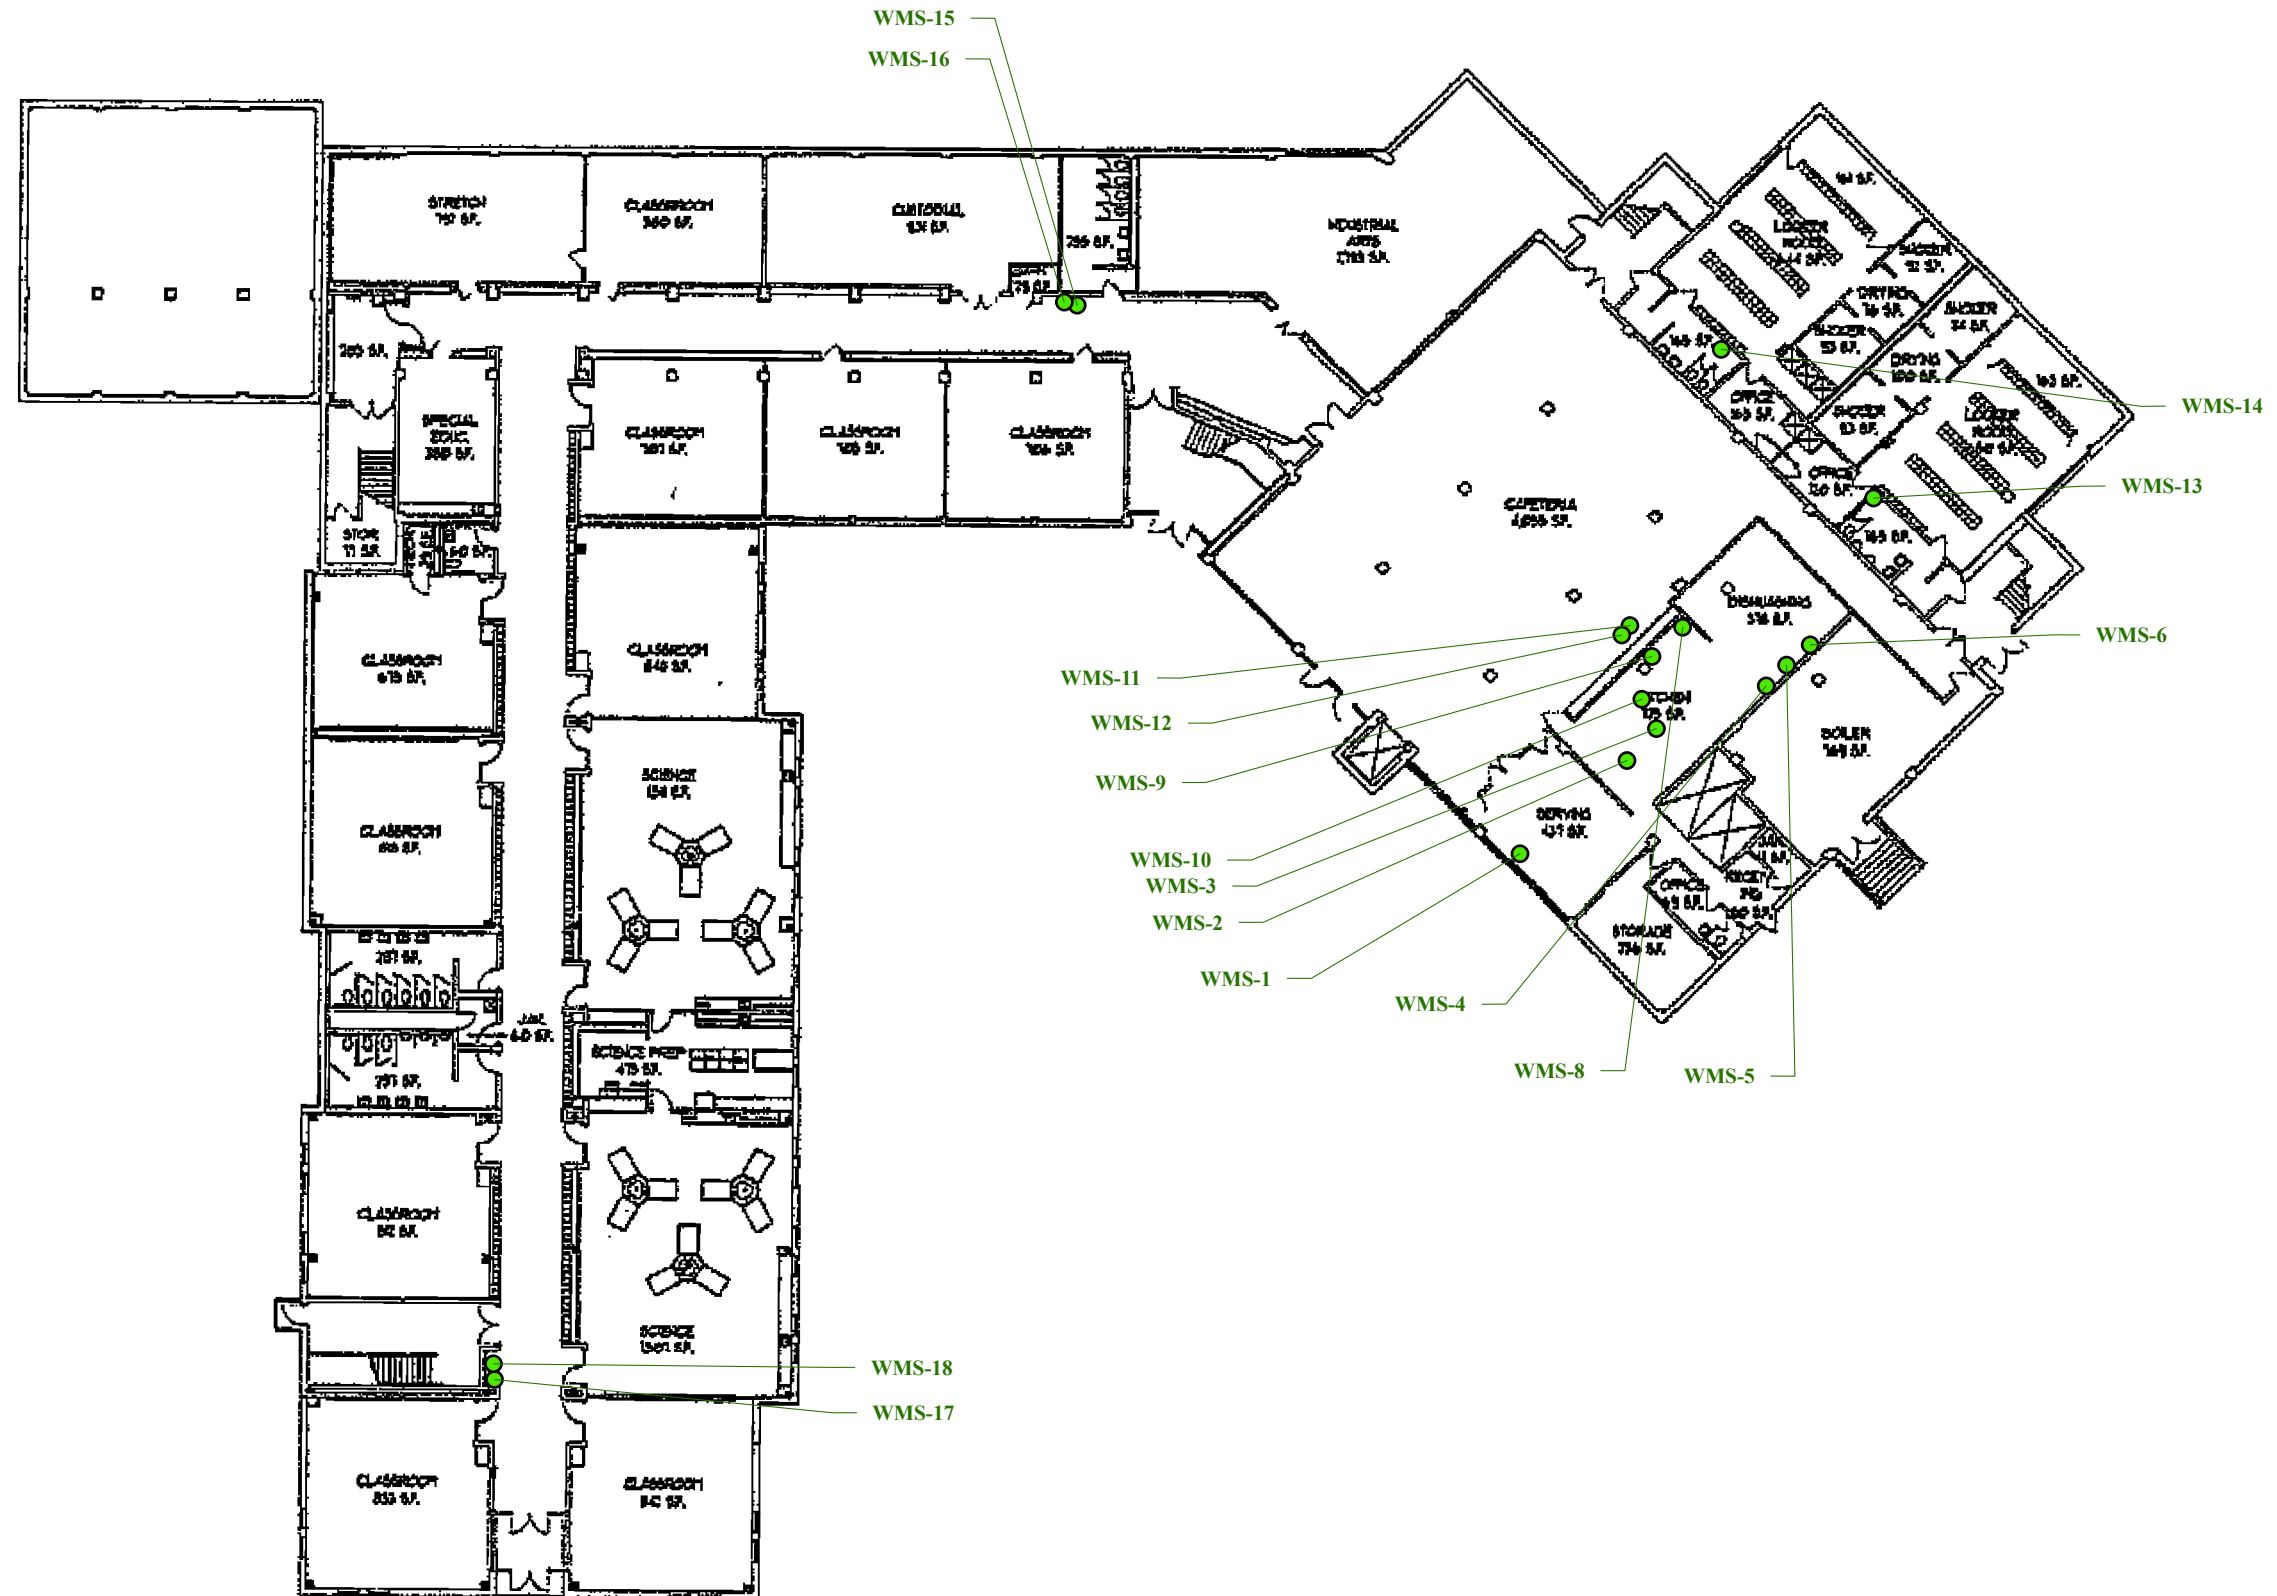


GENERAL NOTES/LEGEND

● RESULTS LESS THAN THE ACTION LEVEL OF 5 PARTS PER BILLION


FLOOR PLANS PROVIDED BY MEHLVILLE SCHOOL DISTRICT. DIMENSIONS AND LOCATIONS ARE APPROXIMATE; ACTUAL MAY VARY. DRAWING SHALL NOT BE USED OUTSIDE THE CONTEXT OF THE REPORT FOR WHICH IT WAS GENERATED.

PROJECT NAME
 MEHLVILLE SCHOOL DISTRICT
 WASHINGTON MIDDLE SCHOOL - 1ST FLOOR
 ST. LOUIS, MISSOURI

LEAD DRINKING WATER SAMPLING PLAN



JOB NUMBER	2016-0860.2T
FIGURE DATE	02/27/2024
DRAWN BY	JTM
CHECKED BY	BLL
FIGURE	1






GENERAL NOTES/LEGEND

- RESULTS GREATER THAN THE ACTION LEVEL OF 5 PARTS PER BILLION
- RESULTS LESS THAN THE ACTION LEVEL OF 5 PARTS PER BILLION

FLOOR PLANS PROVIDED BY MEHLVILLE SCHOOL DISTRICT.
 DIMENSIONS AND LOCATIONS ARE APPROXIMATE; ACTUAL MAY VARY. DRAWING SHALL NOT BE USED OUTSIDE THE CONTEXT OF THE REPORT FOR WHICH IT WAS GENERATED.

PROJECT NAME
 MEHLVILLE SCHOOL DISTRICT
 WASHINGTON MIDDLE SCHOOL - 2ND FLOOR
 ST. LOUIS, MISSOURI

LEAD DRINKING WATER SAMPLING PLAN




JOB NUMBER
2016-0860.2T

FIGURE DATE
03/07/2024

DRAWN BY
JTM

CHECKED BY
BLL

FIGURE
2





Pace Analytical Services, LLC

2231 W. Altorfer Drive

Peoria, IL 61615

(800)752-6651

February 05, 2024

Glenn Grissom
SCI Engineering
130 Point W. Blvd.
St. Chariles, MO 63301

RE: Drinking Water Lead - 2016-0860.2T WMS

Dear Glenn Grissom:

Please find enclosed the analytical results for the **47** sample(s) the laboratory received on **1/18/24 3:00 pm** and logged in under work order **HA02829**. All testing is performed according to our current TNI accreditations unless otherwise noted. This report cannot be reproduced, except in full, without the written permission of Pace Analytical Services, LLC.

If you have any questions regarding your report, please contact your project manager. Quality and timely data is of the utmost importance to us.

Pace Analytical Services appreciates the opportunity to provide you with analytical expertise . We are always trying to improve our customer service and we welcome you to contact the General Manager, Lisa Grant, with any feedback you have about your experience with our laboratory at 309-683-1764 or lisa.grant@pacelabs.com.

A handwritten signature in black ink, appearing to read "Chenise Lambert-Sykes".

Chenise Lambert-Sykes
Project Manager
(314)432-0550
Chenise.Lambert-Sykes@pacelabs.com



SAMPLE RECEIPT CHECK LIST

Items not applicable will be marked as in compliance

Work Order HA02829

YES	Samples received within temperature compliance when applicable
YES	COC present upon sample receipt
YES	COC completed & legible
YES	Sampler name & signature present
YES	Unique sample IDs assigned
YES	Sample collection location recorded
YES	Date & time collected recorded on COC
YES	Relinquished by client signature on COC
YES	COC & labels match
YES	Sample labels are legible
YES	Appropriate bottle(s) received
YES	Sufficient sample volume received
YES	Sample containers received undamaged
NO	Zero headspace, <6 mm present in VOA vials
NO	Trip blank(s) received
YES	All non-field analyses received within holding times
NO	Short hold time analysis
YES	Current PDC COC submitted
NO	Case narrative provided



ANALYTICAL RESULTS

Sample: HA02829-01
Name: WMS-1
Matrix: Drinking Water - Grab

Sampled: 01/15/24 17:11
Received: 01/18/24 15:00

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, 1.50, ug/L, 02/01/24 10:29, 1, 1.00, 02/01/24 16:41, BRS, EPA 200.8 REV 5.4

Sample: HA02829-02
Name: WMS-2
Matrix: Drinking Water - Grab

Sampled: 01/15/24 17:12
Received: 01/18/24 15:00

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, 1.55, ug/L, 02/01/24 10:29, 1, 1.00, 02/01/24 16:42, BRS, EPA 200.8 REV 5.4

Sample: HA02829-03
Name: WMS-3
Matrix: Drinking Water - Grab

Sampled: 01/15/24 17:14
Received: 01/18/24 15:00

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, 1.13, ug/L, 02/01/24 10:29, 1, 1.00, 02/01/24 16:44, BRS, EPA 200.8 REV 5.4

Sample: HA02829-04
Name: WMS-4
Matrix: Drinking Water - Grab

Sampled: 01/15/24 17:15
Received: 01/18/24 15:00

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, 3.18, ug/L, 02/01/24 10:29, 1, 1.00, 02/01/24 16:45, BRS, EPA 200.8 REV 5.4



ANALYTICAL RESULTS

Sample: HA02829-05
Name: WMS-5
Matrix: Drinking Water - Grab

Sampled: 01/15/24 17:15
Received: 01/18/24 15:00

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
Total Metals - PIA									
Lead	3.85	ug/L		02/01/24 10:29	1	1.00	02/01/24 16:47	BRS	EPA 200.8 REV 5.4

Sample: HA02829-06
Name: WMS-6
Matrix: Drinking Water - Grab

Sampled: 01/15/24 17:17
Received: 01/18/24 15:00

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
Total Metals - PIA									
Lead	2.55	ug/L		02/01/24 10:29	1	1.00	02/01/24 16:48	BRS	EPA 200.8 REV 5.4

Sample: HA02829-07
Name: WMS-8
Matrix: Drinking Water - Grab

Sampled: 01/15/24 17:21
Received: 01/18/24 15:00

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
Total Metals - PIA									
Lead	< 1.00	ug/L		02/01/24 10:29	1	1.00	02/01/24 16:49	BRS	EPA 200.8 REV 5.4

Sample: HA02829-08
Name: WMS-9
Matrix: Drinking Water - Grab

Sampled: 01/15/24 17:23
Received: 01/18/24 15:00

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
Total Metals - PIA									
Lead	< 1.00	ug/L		02/01/24 10:29	1	1.00	02/01/24 16:56	BRS	EPA 200.8 REV 5.4



ANALYTICAL RESULTS

Sample: HA02829-09
Name: WMS-10
Matrix: Drinking Water - Grab

Sampled: 01/15/24 17:25
Received: 01/18/24 15:00

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, 3.69, ug/L, 02/01/24 10:29, 1, 1.00, 02/01/24 16:58, BRS, EPA 200.8 REV 5.4

Sample: HA02829-10
Name: WMS-11
Matrix: Drinking Water - Grab

Sampled: 01/15/24 17:27
Received: 01/18/24 15:00

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, < 1.00, ug/L, 02/01/24 10:29, 1, 1.00, 02/01/24 16:59, BRS, EPA 200.8 REV 5.4

Sample: HA02829-11
Name: WMS-12
Matrix: Drinking Water - Grab

Sampled: 01/15/24 17:28
Received: 01/18/24 15:00

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, < 1.00, ug/L, 02/01/24 10:29, 1, 1.00, 02/01/24 17:01, BRS, EPA 200.8 REV 5.4

Sample: HA02829-12
Name: WMS-13
Matrix: Drinking Water - Grab

Sampled: 01/15/24 17:30
Received: 01/18/24 15:00

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, 1.08, ug/L, 02/01/24 10:29, 1, 1.00, 02/01/24 17:02, BRS, EPA 200.8 REV 5.4



ANALYTICAL RESULTS

Sample: HA02829-13
Name: WMS-14
Matrix: Drinking Water - Grab

Sampled: 01/15/24 17:32
Received: 01/18/24 15:00

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, < 1.00, ug/L, 02/01/24 10:29, 1, 1.00, 02/01/24 17:03, BRS, EPA 200.8 REV 5.4

Sample: HA02829-14
Name: WMS-15
Matrix: Drinking Water - Grab

Sampled: 01/15/24 17:35
Received: 01/18/24 15:00

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, < 1.00, ug/L, 02/01/24 10:29, 1, 1.00, 02/01/24 17:05, BRS, EPA 200.8 REV 5.4

Sample: HA02829-15
Name: WMS-16
Matrix: Drinking Water - Grab

Sampled: 01/15/24 17:36
Received: 01/18/24 15:00

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, < 1.00, ug/L, 02/01/24 10:29, 1, 1.00, 02/01/24 17:06, BRS, EPA 200.8 REV 5.4

Sample: HA02829-16
Name: WMS-17
Matrix: Drinking Water - Grab

Sampled: 01/15/24 17:39
Received: 01/18/24 15:00

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, < 1.00, ug/L, 02/01/24 10:29, 1, 1.00, 02/01/24 17:10, BRS, EPA 200.8 REV 5.4



ANALYTICAL RESULTS

Sample: HA02829-17
Name: WMS-18
Matrix: Drinking Water - Grab

Sampled: 01/15/24 17:40

Received: 01/18/24 15:00

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Total Metals - PIA

Table row for Lead: < 1.00 ug/L, 02/01/24 10:29, 1, 1.00, 02/01/24 17:12, BRS, EPA 200.8 REV 5.4

Sample: HA02829-18
Name: WMS-19
Matrix: Drinking Water - Grab

Sampled: 01/15/24 17:45

Received: 01/18/24 15:00

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Total Metals - PIA

Table row for Lead: < 1.00 ug/L, 02/01/24 10:29, 1, 1.00, 02/01/24 17:16, BRS, EPA 200.8 REV 5.4

Sample: HA02829-19
Name: WMS-20
Matrix: Drinking Water - Grab

Sampled: 01/15/24 17:46

Received: 01/18/24 15:00

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Total Metals - PIA

Table row for Lead: < 1.00 ug/L, 02/01/24 10:29, 1, 1.00, 02/01/24 17:17, BRS, EPA 200.8 REV 5.4

Sample: HA02829-20
Name: WMS-21
Matrix: Drinking Water - Grab

Sampled: 01/15/24 17:49

Received: 01/18/24 15:00

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Total Metals - PIA

Table row for Lead: < 1.00 ug/L, 02/01/24 10:29, 1, 1.00, 02/01/24 17:19, BRS, EPA 200.8 REV 5.4



ANALYTICAL RESULTS

Sample: HA02829-21
Name: WMS-22
Matrix: Drinking Water - Grab

Sampled: 01/15/24 17:51
Received: 01/18/24 15:00

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, < 1.00, ug/L, 02/01/24 10:29, 1, 1.00, 02/01/24 17:20, BRS, EPA 200.8 REV 5.4

Sample: HA02829-22
Name: WMS-23
Matrix: Drinking Water - Grab

Sampled: 01/15/24 17:54
Received: 01/18/24 15:00

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, < 1.00, ug/L, 02/01/24 10:29, 1, 1.00, 02/01/24 17:22, BRS, EPA 200.8 REV 5.4

Sample: HA02829-23
Name: WMS-24
Matrix: Drinking Water - Grab

Sampled: 01/15/24 17:55
Received: 01/18/24 15:00

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, < 1.00, ug/L, 02/01/24 10:29, 1, 1.00, 02/01/24 17:23, BRS, EPA 200.8 REV 5.4

Sample: HA02829-24
Name: WMS-25
Matrix: Drinking Water - Grab

Sampled: 01/15/24 17:56
Received: 01/18/24 15:00

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, 1.38, ug/L, 02/01/24 10:29, 1, 1.00, 02/01/24 17:27, BRS, EPA 200.8 REV 5.4



ANALYTICAL RESULTS

Sample: HA02829-25
Name: WMS-26
Matrix: Drinking Water - Grab

Sampled: 01/15/24 17:57
Received: 01/18/24 15:00

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
Total Metals - PIA									
Lead	< 1.00	ug/L		02/01/24 10:29	1	1.00	02/01/24 17:29	BRS	EPA 200.8 REV 5.4

Sample: HA02829-26
Name: WMS-27
Matrix: Drinking Water - Grab

Sampled: 01/15/24 17:59
Received: 01/18/24 15:00

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
Total Metals - PIA									
Lead	< 1.00	ug/L		02/01/24 10:29	1	1.00	02/01/24 17:30	BRS	EPA 200.8 REV 5.4

Sample: HA02829-27
Name: WMS-28
Matrix: Drinking Water - Grab

Sampled: 01/15/24 18:00
Received: 01/18/24 15:00

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
Total Metals - PIA									
Lead	< 1.00	ug/L		02/01/24 10:29	1	1.00	02/01/24 17:31	BRS	EPA 200.8 REV 5.4

Sample: HA02829-28
Name: WMS-29
Matrix: Drinking Water - Grab

Sampled: 01/15/24 18:05
Received: 01/18/24 15:00

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
Total Metals - PIA									
Lead	< 1.00	ug/L		02/01/24 10:29	1	1.00	02/01/24 17:36	BRS	EPA 200.8 REV 5.4



ANALYTICAL RESULTS

Sample: HA02829-29
Name: WMS-30
Matrix: Drinking Water - Grab

Sampled: 01/15/24 18:07
Received: 01/18/24 15:00

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, < 1.00, ug/L, 02/01/24 10:29, 1, 1.00, 02/01/24 17:37, BRS, EPA 200.8 REV 5.4

Sample: HA02829-30
Name: WMS-31
Matrix: Drinking Water - Grab

Sampled: 01/15/24 18:09
Received: 01/18/24 15:00

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, < 1.00, ug/L, 02/01/24 10:29, 1, 1.00, 02/01/24 17:38, BRS, EPA 200.8 REV 5.4

Sample: HA02829-31
Name: WMS-32
Matrix: Drinking Water - Grab

Sampled: 01/15/24 18:10
Received: 01/18/24 15:00

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, < 1.00, ug/L, 02/01/24 10:29, 1, 1.00, 02/01/24 17:40, BRS, EPA 200.8 REV 5.4

Sample: HA02829-32
Name: WMS-33
Matrix: Drinking Water - Grab

Sampled: 01/15/24 18:11
Received: 01/18/24 15:00

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, 3.63, ug/L, 02/01/24 10:29, 1, 1.00, 02/01/24 17:44, BRS, EPA 200.8 REV 5.4



ANALYTICAL RESULTS

Sample: HA02829-33
Name: WMS-34
Matrix: Drinking Water - Grab

Sampled: 01/15/24 18:13

Received: 01/18/24 15:00

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Total Metals - PIA

Table row for Lead: 15.4 ug/L, 02/01/24 10:29, 1, 1.00, 02/01/24 17:45, BRS, EPA 200.8 REV 5.4

Sample: HA02829-34
Name: WMS-35
Matrix: Drinking Water - Grab

Sampled: 01/15/24 18:15

Received: 01/18/24 15:00

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Total Metals - PIA

Table row for Lead: 11.1 ug/L, 02/01/24 10:29, 1, 1.00, 02/01/24 17:47, BRS, EPA 200.8 REV 5.4

Sample: HA02829-35
Name: WMS-36
Matrix: Drinking Water - Grab

Sampled: 01/15/24 18:16

Received: 01/18/24 15:00

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Total Metals - PIA

Table row for Lead: 7.00 ug/L, 02/01/24 10:29, 1, 1.00, 02/01/24 17:48, BRS, EPA 200.8 REV 5.4

Sample: HA02829-36
Name: WMS-37
Matrix: Drinking Water - Grab

Sampled: 01/15/24 18:17

Received: 01/18/24 15:00

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Total Metals - PIA

Table row for Lead: 10.4 ug/L, 02/01/24 10:29, 1, 1.00, 02/01/24 17:50, BRS, EPA 200.8 REV 5.4



ANALYTICAL RESULTS

Sample: HA02829-37
Name: WMS-38
Matrix: Drinking Water - Grab

Sampled: 01/15/24 18:18
Received: 01/18/24 15:00

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, 15.0, ug/L, 02/01/24 10:29, 1, 1.00, 02/01/24 17:51, BRS, EPA 200.8 REV 5.4

Sample: HA02829-38
Name: WMS-39
Matrix: Drinking Water - Grab

Sampled: 01/15/24 18:21
Received: 01/18/24 15:00

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, 11.2, ug/L, 02/01/24 10:29, 1, 1.00, 02/01/24 17:55, BRS, EPA 200.8 REV 5.4

Sample: HA02829-39
Name: WMS-40
Matrix: Drinking Water - Grab

Sampled: 01/15/24 18:22
Received: 01/18/24 15:00

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, 8.04, ug/L, 02/01/24 10:29, 1, 1.00, 02/01/24 17:57, BRS, EPA 200.8 REV 5.4

Sample: HA02829-40
Name: WMS-41
Matrix: Drinking Water - Grab

Sampled: 01/15/24 18:23
Received: 01/18/24 15:00

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, 39.4, ug/L, 02/01/24 10:29, 1, 1.00, 02/01/24 18:01, BRS, EPA 200.8 REV 5.4



ANALYTICAL RESULTS

Sample: HA02829-41
Name: WMS-42
Matrix: Drinking Water - Grab

Sampled: 01/15/24 18:25

Received: 01/18/24 15:00

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Total Metals - PIA

Table row for Lead: 2.92 ug/L, 02/01/24 10:29, 1, 1.00, 02/01/24 18:02, BRS, EPA 200.8 REV 5.4

Sample: HA02829-42
Name: WMS-43
Matrix: Drinking Water - Grab

Sampled: 01/15/24 18:27

Received: 01/18/24 15:00

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Total Metals - PIA

Table row for Lead: 17.9 ug/L, 02/01/24 10:29, 1, 1.00, 02/01/24 18:04, BRS, EPA 200.8 REV 5.4

Sample: HA02829-43
Name: WMS-44
Matrix: Drinking Water - Grab

Sampled: 01/15/24 18:29

Received: 01/18/24 15:00

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Total Metals - PIA

Table row for Lead: 1.19 ug/L, 02/01/24 10:29, 1, 1.00, 02/01/24 18:05, BRS, EPA 200.8 REV 5.4

Sample: HA02829-44
Name: WMS-45
Matrix: Drinking Water - Grab

Sampled: 01/15/24 18:30

Received: 01/18/24 15:00

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Total Metals - PIA

Table row for Lead: < 1.00 ug/L, 02/01/24 10:29, 1, 1.00, 02/01/24 18:06, BRS, EPA 200.8 REV 5.4



ANALYTICAL RESULTS

Sample: HA02829-45
Name: WMS-46
Matrix: Drinking Water - Grab

Sampled: 01/15/24 18:32
Received: 01/18/24 15:00

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
Total Metals - PIA									
Lead	1.02	ug/L		02/01/24 10:29	1	1.00	02/01/24 18:08	BRS	EPA 200.8 REV 5.4

Sample: HA02829-46
Name: WMS-47
Matrix: Drinking Water - Grab

Sampled: 01/15/24 18:33
Received: 01/18/24 15:00

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
Total Metals - PIA									
Lead	1.32	ug/L		02/01/24 10:29	1	1.00	02/01/24 18:09	BRS	EPA 200.8 REV 5.4

Sample: HA02829-47
Name: WMS-48
Matrix: Drinking Water - Grab

Sampled: 01/15/24 18:35
Received: 01/18/24 15:00

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
Total Metals - PIA									
Lead	< 1.00	ug/L		02/01/24 10:29	1	1.00	02/01/24 18:11	BRS	EPA 200.8 REV 5.4



QC SAMPLE RESULTS

Parameter	Result	Unit	Qual	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit
Batch B424395 - DW 200.8 no prep - EPA 200.8 REV 5.4									
Blank (B424395-BLK1)				Prepared & Analyzed: 02/01/24					
Lead	< 1.00	ug/L							
LCS (B424395-BS1)				Prepared & Analyzed: 02/01/24					
Lead	52.1	ug/L		50.00		104	85-115		
Matrix Spike (B424395-MS1)				Sample: HA02805-01 Prepared & Analyzed: 02/01/24					
Lead	50.0	ug/L		50.00	ND	100	70-130		
Matrix Spike (B424395-MS2)				Sample: HA02805-07 Prepared & Analyzed: 02/01/24					
Lead	50.5	ug/L		50.00	ND	101	70-130		
Matrix Spike (B424395-MS3)				Sample: HA02805-17 Prepared & Analyzed: 02/01/24					
Lead	49.7	ug/L		50.00	ND	99	70-130		
Matrix Spike (B424395-MS4)				Sample: HA02805-27 Prepared & Analyzed: 02/01/24					
Lead	50.6	ug/L		50.00	ND	101	70-130		
Matrix Spike (B424395-MS5)				Sample: HA02805-37 Prepared & Analyzed: 02/01/24					
Lead	50.0	ug/L		50.00	ND	100	70-130		
Matrix Spike (B424395-MS6)				Sample: HA02825-08 Prepared & Analyzed: 02/01/24					
Lead	50.7	ug/L		50.00	ND	101	70-130		
Matrix Spike (B424395-MS7)				Sample: HA02825-18 Prepared & Analyzed: 02/01/24					
Lead	49.8	ug/L		50.00	ND	100	70-130		
Matrix Spike (B424395-MS8)				Sample: HA02825-28 Prepared & Analyzed: 02/01/24					
Lead	53.5	ug/L		50.00	2.65	102	70-130		
Matrix Spike (B424395-MS9)				Sample: HA02825-38 Prepared & Analyzed: 02/01/24					
Lead	56.4	ug/L		50.00	4.79	103	70-130		
Matrix Spike (B424395-MSA)				Sample: HA02825-48 Prepared & Analyzed: 02/01/24					
Lead	50.7	ug/L		50.00	0.201	101	70-130		
Matrix Spike (B424395-MSB)				Sample: HA02829-07 Prepared & Analyzed: 02/01/24					
Lead	52.7	ug/L		50.00	0.280	105	70-130		
Matrix Spike (B424395-MSC)				Sample: HA02829-17 Prepared & Analyzed: 02/01/24					
Lead	51.4	ug/L		50.00	0.646	102	70-130		
Matrix Spike (B424395-MSD)				Sample: HA02829-27 Prepared & Analyzed: 02/01/24					
Lead	51.8	ug/L		50.00	0.184	103	70-130		
Matrix Spike Dup (B424395-MSD1)				Sample: HA02805-01 Prepared & Analyzed: 02/01/24					
Lead	50.9	ug/L		50.00	ND	102	70-130	2	20
Matrix Spike Dup (B424395-MSD2)				Sample: HA02805-07 Prepared & Analyzed: 02/01/24					
Lead	50.9	ug/L		50.00	ND	102	70-130	0.8	20
Matrix Spike Dup (B424395-MSD3)				Sample: HA02805-17 Prepared & Analyzed: 02/01/24					
Lead	51.0	ug/L		50.00	ND	102	70-130	2	20
Matrix Spike Dup (B424395-MSD4)				Sample: HA02805-27 Prepared & Analyzed: 02/01/24					
Lead	49.4	ug/L		50.00	ND	99	70-130	2	20
Matrix Spike Dup (B424395-MSD5)				Sample: HA02805-37 Prepared & Analyzed: 02/01/24					
Lead	50.8	ug/L		50.00	ND	102	70-130	2	20
Matrix Spike Dup (B424395-MSD6)				Sample: HA02825-08 Prepared & Analyzed: 02/01/24					
Lead	50.7	ug/L		50.00	ND	101	70-130	0.03	20
Matrix Spike Dup (B424395-MSD7)				Sample: HA02825-18 Prepared & Analyzed: 02/01/24					
Lead	49.4	ug/L		50.00	ND	99	70-130	0.9	20



QC SAMPLE RESULTS

Parameter	Result	Unit	Qual	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit
Matrix Spike Dup (B424395-MSD8)	Sample: HA02825-28			Prepared & Analyzed: 02/01/24					
Lead	54.1	ug/L		50.00	2.65	103	70-130	1	20
Matrix Spike Dup (B424395-MSD9)	Sample: HA02825-38			Prepared & Analyzed: 02/01/24					
Lead	55.7	ug/L		50.00	4.79	102	70-130	1	20
Matrix Spike Dup (B424395-MSDA)	Sample: HA02825-48			Prepared & Analyzed: 02/01/24					
Lead	51.6	ug/L		50.00	0.201	103	70-130	2	20
Matrix Spike Dup (B424395-MSDB)	Sample: HA02829-07			Prepared & Analyzed: 02/01/24					
Lead	53.3	ug/L		50.00	0.280	106	70-130	1	20
Matrix Spike Dup (B424395-MSDC)	Sample: HA02829-17			Prepared & Analyzed: 02/01/24					
Lead	52.3	ug/L		50.00	0.646	103	70-130	2	20
Matrix Spike Dup (B424395-MSDD)	Sample: HA02829-27			Prepared & Analyzed: 02/01/24					
Lead	51.3	ug/L		50.00	0.184	102	70-130	0.8	20
Matrix Spike Dup (B424395-MSDE)	Sample: HA02829-37			Prepared & Analyzed: 02/01/24					
Lead	68.6	ug/L		50.00	15.0	107	70-130	0.9	20
Matrix Spike Dup (B424395-MSDF)	Sample: HA02829-47			Prepared & Analyzed: 02/01/24					
Lead	52.6	ug/L		50.00	0.304	105	70-130	3	20
Matrix Spike (B424395-MSE)	Sample: HA02829-37			Prepared & Analyzed: 02/01/24					
Lead	67.9	ug/L		50.00	15.0	106	70-130		
Matrix Spike (B424395-MSF)	Sample: HA02829-47			Prepared & Analyzed: 02/01/24					
Lead	50.9	ug/L		50.00	0.304	101	70-130		



NOTES

Specifications regarding method revisions, method modifications, and calculations used for analysis are available upon request. Please contact your project manager.

* Not a TNI accredited analyte

Certifications

CHI - McHenry, IL - 4314-A W. Crystal Lake Road, McHenry, IL 60050

TNI Accreditation for Drinking Water and Wastewater Fields of Testing through IL EPA Accreditation No. 100279

Illinois Department of Public Health Bacterial Analysis in Drinking Water Approved Laboratory Registry No. 17556

PIA - Peoria, IL - 2231 W. Altorfer Drive, Peoria, IL 61615

TNI Accreditation for Drinking Water, Wastewater, Solid and Hazardous Material Fields of Testing through IL EPA Accreditation No. 100230

Illinois Department of Public Health Bacterial Analysis in Drinking Water Approved Laboratory Registry No. 17553

Drinking Water Certifications/Accreditations: Iowa (240); Kansas (E-10338); Missouri (870)

Wastewater Certifications/Accreditations: Arkansas (88-0677); Iowa (240); Kansas (E-10338)

Solid and Hazardous Material Certifications/Accreditations: Arkansas (88-0677); Iowa (240); Kansas (E-10338)

SPMO - Springfield, MO - 1805 W Sunset Street, Springfield, MO 65807

USEPA DMR-QA Program

STL - Hazelwood, MO - 944 Anglum Rd, Hazelwood, MO 63042

TNI Accreditation for Wastewater, Solid and Hazardous Material Fields of Testing through KS KDHE Certification No. E-10389

TNI Accreditation for Wastewater, Solid and Hazardous Material Fields of Testing through IL EPA Accreditation No. - 200080

Illinois Department of Public Health Bacterial Analysis in Drinking Water Approved Laboratory, Registry No. 171050

Missouri Department of Natural Resources - Certificate of Approval for Microbiological Laboratory Service - No. 1050



Certified by: Chenise Lambert-Sykes, Project Manager

REGULATORY PROGRAM (CIRCLE):	NPDES
MORBCA	RCRA
CCDD	TACO: RES OR IND/COMM

CHAIN OF CUSTODY RECORD
 STATE WHERE SAMPLE COLLECTED MO

ALL HIGHLIGHTED AREAS MUST BE COMPLETED BY CLIENT (PLEASE PRINT)

1 CLIENT SCI Engineering ADDRESS: 130 Point West Blvd CITY STATE ZIP: St. Charles, MO 63301 CONTACT PERSON: Glen Grissom		PROJECT NUMBER: 2016-0860.2T PHONE NUMBER: (314) 581-7570 PROJECT LOCATION: WMS E-MAIL: ggrissom@sciengineering.com PURCHASE ORDER #:		DATE SHIPPED:		3 ANALYSIS REQUESTED DW Pb Turb Check		4 (FOR LAB USE ONLY) LOGIN # <u>HA00824</u> LOGGED BY: SCI Engineering CLIENT: SCI Engineering PROJECT: Drinking Water Lead PROJ. MGR.: Chenise Lambert-Sykes CUSTODY SEAL #:	
2 SAMPLE DESCRIPTION (UNIQUE DESCRIPTION AS IT WILL APPEAR ON THE ANALYTICAL REPORT)		DATE COLLECTED TIME COLLECTED SAMPLE TYPE MATRIX TYPE BOTTLE COUNT PRES CODE CLIENT PROVIDED		DATE SHIPPED		REMARKS			
WMS-1	1/15/23	1711	X	DW	1	6	X		
WMS-2	1/15/23	1712	X	DW	1	6	X		
WMS-3	1/15/23	1714	X	DW	1	6	X		
WMS-4	1/15/23	1715	X	DW	1	6	X		
WMS-5	1/15/23	1715	X	DW	1	6	X		
WMS-6	1/15/23	1717	X	DW	1	6	X		
WMS-8	1/15/23	1721	X	DW	1	6	X		
WMS-9	1/15/23	1723	X	DW	1	6	X		
WMS-10	1/15/23	1725	X	DW	1	6	X		
WMS-11	1/15/23	1727	X	DW	1	6	X		
WMS-12	1/15/23	1728	X	DW	1	6	X		

5 TURNAROUND TIME REQUESTED (PLEASE CIRCLE) (RUSH IS SUBJECT TO PACE LABS APPROVAL AND SURCHARGE)
 RUSH RESULTS VIA (PLEASE CIRCLE) EMAIL PHONE PHONE # IF DIFFERENT FROM ABOVE: PHONE # IF DIFFERENT FROM ABOVE:

6 UNDERSTAND THAT BY INITIATING THIS BOX I GIVE THE LAB PERMISSION TO PROCEED WITH ANALYSIS, EVEN THOUGH IT MAY NOT MEET ALL SAMPLE CONFORMANCE REQUIREMENTS AS DEFINED IN THE RECEIVING FACILITY'S SAMPLE ACCEPTANCE POLICY AND THE DATA WILL BE QUALIFIED. QUALIFIED DATA MAY NOT BE ACCEPTABLE TO REPORT TO ALL REGULATORY AUTHORITIES. PROCEED WITH ANALYSIS AND QUALIFY RESULTS: (INITIALS)

7 RELINQUISHED BY: (SIGNATURE) DATE TIME RECEIVED BY: (SIGNATURE) DATE TIME
 RELINQUISHED BY: (SIGNATURE) DATE TIME RECEIVED BY: (SIGNATURE) DATE TIME

8 COMMENT(S): (FOR LAB USE ONLY) SAMPLE TEMPERATURE UPON RECEIPT: 20.0 °C
 CHILL PROCESS STARTED PRIOR TO RECEIPT SAMPLE(S) RECEIVED ON ICE SAMPLE ACCEPTANCE NONCONFORMANT REPORT IS NEEDED DATE AND TIME TAKEN FROM SAMPLE BOTTLE

REGULATORY PROGRAM (CIRCLE):	NPDES
MORBCA	RCRA
CCDD	TACO: RES OR IND/COMM

CHAIN OF CUSTODY RECORD
 STATE WHERE SAMPLE COLLECTED MO








ALL HIGHLIGHTED AREAS MUST BE COMPLETED BY CLIENT (PLEASE PRINT)

1 CLIENT SCI Engineering ADDRESS: 130 Point West Blvd CITY: St. Charles, MO 63301 STATE: MO ZIP: 63301 CONTACT PERSON: Glen Grissom		PROJECT NUMBER: 2016-0860.2T PHONE NUMBER: (314) 581-7570 PROJECT LOCATION: WMS E-MAIL: ggrissom@sciengineering.com	PURCHASE ORDER # DATE SHIPPED	3 ANALYSIS REQUESTED + DW Pb + Turb Check	4 (FOR LAB USE ONLY) LOGIN # LOGGED BY: CLIENT: SCI Engineering PROJECT: Drinking Water Lead PROJ. MGR.: Cherie Lambert-Sykes CUSTODY SEAL #:
2 SAMPLE DESCRIPTION (UNIQUE DESCRIPTION AS IT WILL APPEAR ON THE ANALYTICAL REPORT) WMS-24 WMS-25 WMS-26 WMS-27 WMS-28 WMS-29 WMS-30 WMS-31 WMS-32 WMS-33 WMS-34		DATE COLLECTED TIME COLLECTED SAMPLE TYPE GRAB MATRIX TYPE BOTTLE COUNT PRES CODE PROVIDED	MATRIX TYPES: WW - WASTEWATER DW - DRINKING WATER GW - GROUND WATER NS - NON AQUEOUS SOLID LF - LITTELEACHATE SO - SOIL SO-SOIL	DW Pb Turb Check	REMARKS
5 TURNAROUND TIME REQUESTED (PLEASE CIRCLE) (RUSH THAT IS SUBJECT TO PACE LABS APPROVAL AND SURCHARGE) RUSH RESULTS VIA (PLEASE CIRCLE) EMAIL PHONE PHONE EMAIL IF DIFFERENT FROM ABOVE: PHONE # IF DIFFERENT FROM ABOVE:		1 - HCL 2 - H2SO4 3 - HNO3 4 - NAOH 5 - NA2S2O3 6 - UNPRESERVED 7 - OTHER	NORMAL RUSH DATE RESULTS NEEDED	6 I understand that by initiating this box I give the lab permission to proceed with analysis, even though it may not meet all sample confirmation requirements as defined in the receiving facility's Sample Acceptance Policy and the data will be qualified. Qualified data may NOT be acceptable to report to all regulatory authorities.	8 COMMENTS: (FOR LAB USE ONLY) SAMPLE TEMPERATURE UPON RECEIPT: 20.0 °C CHILL PROCESS STARTED PRIOR TO RECEIPT SAMPLE(S) RECEIVED ON ICE SAMPLE ACCEPTANCE NONCONFORMANT REPORT IS NEEDED DATE AND TIME TAKEN FROM SAMPLE:
7 RELINQUISHED BY: (SIGNATURE) DATE: 1/16/24 TIME: 12:18 RECEIVED BY: (SIGNATURE) DATE: 1/18/24 TIME: 15:00		RECEIVED BY: (SIGNATURE) DATE: 1/18/24 TIME: 15:00			
RELINQUISHED BY: (SIGNATURE) DATE: 1/18/24 TIME: 15:00		RECEIVED BY: (SIGNATURE) DATE: 1/18/24 TIME: 15:00			

REGULATORY PROGRAM (CIRCLE):	NPDES
MORBCA	RCRA
CCDD	TACO: RES OR IND/COMM

CHAIN OF CUSTODY RECORD
 STATE WHERE SAMPLE COLLECTED MO

ALL HIGHLIGHTED AREAS MUST BE COMPLETED BY CLIENT (PLEASE PRINT)

1 CLIENT SCI Engineering		PROJECT NUMBER 2016-0860.21	PROJECT LOCATION WMS	PURCHASE ORDER #	3 ANALYSIS REQUESTED			
ADDRESS 130 Point West Blvd		PHONE NUMBER (314) 581-7570	E-MAIL ggrissom@sciengineering.com	DATE SHIPPED	4 (FOR LAB USE ONLY) LOGIN # _____ LOGGED BY: _____ CLIENT: SCI Engineering PROJECT: Drinking Water Lead PROJ. MGR.: Charise Lambert-Sykes CUSTODY SEAL #: _____			
CITY St. Charles, MO 63301		SAMPLER (PLEASE PRINT) Ethan Boyer		MATRIX TYPES: WW- WASTEWATER DW- DRINKING WATER GW- GROUND WATER MS- NON AQUEOUS SOLID LG- LEACHATE OIL- OIL SOL- SOLID				
CONTACT PERSON Glen Grissom		SAMPLE ERIS SIGNATURE 		REMARKS				
2 (UNIQUE DESCRIPTION AS IT WILL APPEAR ON THE ANALYTICAL REPORT)		DATE COLLECTED	TIME COLLECTED	SAMPLE TYPE GRAB	MATRIX TYPE	BOTTLE COUNT	PRES CODE CLIENT PROVIDED	DW Pb Turb Check
WMS-35		1/15/23	1815	X	DW	1	6	X
WMS-36		1/15/23	1816	X	DW	1	6	X
WMS-37		1/15/23	1817	X	DW	1	6	X
WMS-38		1/15/23	1818	X	DW	1	6	X
WMS-39		1/15/23	1821	X	DW	1	6	X
WMS-40		1/15/23	1822	X	DW	1	6	X
WMS-41		1/15/23	1823	X	DW	1	6	X
WMS-42		1/15/23	1825	X	DW	1	6	X
WMS-43		1/15/23	1827	X	DW	1	6	X
WMS-44		1/15/23	1829	X	DW	1	6	X
WMS-45		1/15/23	1830	X	DW	1	6	X
CHEMICAL PRESERVATION CODES: 1-HCL 2-H2SO4 3-HNO3 4-NAOH 5-NA2S2O3 6-UNPRESERVED 7-OTHER								
5 TURNAROUND TIME REQUESTED (PLEASE CIRCLE) (RUSH IS SUBJECT TO PACE LABS APPROVAL AND SURCHARGE) RUSH RESULTS VIA (PLEASE CIRCLE) EMAIL PHONE PHONE EMAIL IF DIFFERENT FROM ABOVE: PHONE # IF DIFFERENT FROM ABOVE:		NORMAL RUSH		DATE RESULTS NEEDED		6 I understand that by initiating this box I give the lab permission to proceed with analysis, even though it may not meet all sample conformance requirements as defined in the receiving facility's Sample Acceptance Policy and the data will be qualified. Qualified data may NOT be acceptable to report to all regulatory authorities. PROCEED WITH ANALYSIS AND QUALIFY RESULTS: (INITIALS) _____		
7 RELINQUISHED BY: (SIGNATURE) 		DATE 1/16/24	RECEIVED BY: (SIGNATURE) 		8 COMMENTS: (FOR LAB USE ONLY)			
RELINQUISHED BY: (SIGNATURE) 		DATE 1/18/24	RECEIVED BY: (SIGNATURE) 		SAMPLE TEMPERATURE UPON RECEIPT CHILL PROCESS STARTED PRIOR TO RECEIPT SAMPLE(S) RECEIVED ON ICE SAMPLE ACCEPTANCE NONCONFORMANT REPORT IS NEEDED DATE AND TIME TAKEN FROM SAMPLE <u>20.0</u> °C Y OR M Y OR M Y OR M			
RELINQUISHED BY: (SIGNATURE) 		DATE 1/18/24	RECEIVED BY: (SIGNATURE) 		SAMPLE TEMPERATURE UPON RECEIPT CHILL PROCESS STARTED PRIOR TO RECEIPT SAMPLE(S) RECEIVED ON ICE SAMPLE ACCEPTANCE NONCONFORMANT REPORT IS NEEDED DATE AND TIME TAKEN FROM SAMPLE <u>15:00</u> °C Y OR M Y OR M Y OR M			



Pace Analytical Services
www.pacelabs.com

REGULATORY PROGRAM (CIRCLE):	NPDES
MORBCA	RCRA
CCDD	TACO: RES OR IND/COMM

5/15

CHAIN OF CUSTODY RECORD
STATE WHERE SAMPLE COLLECTED MO

ALL HIGHLIGHTED AREAS MUST BE COMPLETED BY CLIENT (PLEASE PRINT)

1 CLIENT SCI Engineering ADDRESS: 130 Point West Blvd CITY: St. Charles, MO 63301 CONTACT PERSON: Glen Grissom		PROJECT NUMBER: 2016-0860.2T PHONE NUMBER: (314) 581-7570 PROJECT LOCATION: WMS E-MAIL: ggrissom@sciengineering.com DATE SHIPPED:		PURCHASE ORDER #: MATRIX TYPES: WW: WASTEWATER GW: GROUND WATER WWL: SLUDGE WWS: NON AQUEOUS SOLID OIL-OIL: OIL SO: SOIL SO: SOIL		3 ANALYSIS REQUESTED + DW Pb + Turb Check		4 (FOR LAB USE ONLY) LOGIN #: LOGGED BY: SCI Engineering CLIENT: SCI Engineering PROJECT: Drinking Water Lead PROJ. MGR.: Chemise Lambert-Sykes CUSTODY SEAL #:	
2 SAMPLE DESCRIPTION (UNIQUE DESCRIPTION AS IT WILL APPEAR ON THE ANALYTICAL REPORT) WMS-46 WMS-47 WMS-48		DATE COLLECTED: 1/15/23 TIME COLLECTED: 1832 DATE COLLECTED: 1/15/23 TIME COLLECTED: 1833 DATE COLLECTED: 1/15/23 TIME COLLECTED: 1835		SAMPLE TYPE: GRAB MATRIX TYPE: DW MATRIX TYPE: DW MATRIX TYPE: DW		BOTTLE COUNT: 1 BOTTLE COUNT: 1 BOTTLE COUNT: 1		PRES CODE: 6 PRES CODE: 6 PRES CODE: 6	
CHEMICAL PRESERVATION CODES: 1 - HCL, 2 - H2SO4, 3 - HNO3, 4 - NaOH, 5 - Na2S2O3, 6 - UNPRESERVED, 7 - OTHER									
5 TURNAROUND TIME REQUESTED (PLEASE CIRCLE) (RUSH THAT IS SUBJECT TO PACE LABS APPROVAL AND SURCHARGE) RUSH RESULTS VIA (PLEASE CIRCLE) EMAIL PHONE EMAIL IF DIFFERENT FROM ABOVE: PHONE # IF DIFFERENT FROM ABOVE:					6 I understand that by initiating this box I give the lab permission to proceed with analysis, even though it may not meet all sample conformance requirements as defined in the receiving facility's Sample Acceptance Policy and the data will be qualified. Qualified data may NOT be acceptable to report to all regulatory authorities. PROCEED WITH ANALYSIS AND QUALIFY RESULTS: (INITIALS)				
7 RELINQUISHED BY: (SIGNATURE) [Signature]		DATE: 1/16/24 TIME: 1818		RECEIVED BY: (SIGNATURE) [Signature]		DATE: 1-18-24 TIME: 1500		8 COMMENTS: (FOR LAB USE ONLY) SAMPLE TEMPERATURE UPON RECEIPT: 20.0 °C CHILL PROCESS STARTED PRIOR TO RECEIPT SAMPLE(S) RECEIVED ON ICE SAMPLE ACCEPTANCE NONCONFORMANT REPORT IS NEEDED DATE AND TIME TAKEN FROM SAMPLE BOTTLE:	
RELINQUISHED BY: (SIGNATURE) [Signature]		DATE: 1-18-24 TIME: 1500		RECEIVED BY: (SIGNATURE) [Signature]		DATE: 1-18-24 TIME: 1500		Y OR N Y OR N Y OR N	