



SCI ENGINEERING, INC.

EARTH • SCIENCE • SOLUTIONS

GEOTECHNICAL
ENVIRONMENTAL
NATURAL RESOURCES
CULTURAL RESOURCES
CONSTRUCTION SERVICES

April 2, 2024

Michael Gegg
Mehlville School District
3120 Lemay Ferry Road
St. Louis, Missouri 63125

RE: Lead in Drinking Water Report
Point Elementary School
6790 Telegraph Road
St. Louis, Missouri
SCI No. 2016-0860.2T

Dear Michael Gegg:

INTRODUCTION

SCI Engineering, Inc. (SCI) is pleased to submit this report summarizing lead in drinking water sampling activities performed on December 29, 2023. The purpose of the sampling activities was to screen for elevated levels of lead in the drinking water at potable water sources throughout the above-referenced structure.

The drinking water survey is intended to satisfy the requirements for the “Get the Lead Out of School Drinking Water Act” (GTLOSDWA), Section 160.077 administered by the Missouri Department of Health and Senior Services. Potable water sources to be tested were identified by the school district prior to SCI’s field activities.

LIMITATIONS

SCI’s sampling activities were limited to locations identified by the school district. If any additional potable water sources need testing, please contact SCI, and we will make arrangements for sampling these fixtures. Potable water sources that were not sampled will need a sign placed near each fixture informing students and faculty it is not to be used as a drinking water source.

During the course of performing the drinking water sampling of the structure, SCI was unable to sample five fixtures because they were out of order. These fixtures included the wall faucet in the kitchen, the water fountains in Rooms 26, 24, and 22, and the spray nozzle in Room 21. If these fixtures are made operational, they should be sampled or labeled non-potable. SCI was able to sample all other locations identified by the school district.

DRINKING WATER SURVEY

SCI collected “first draw” samples which consisted of collecting a water sample from each fixture or sample location after it remained stagnant for at least eight hours. Prior to sampling, SCI first mobilized

to the site to flush the identified potable water fixtures throughout the structure. Once each fixture was flushed, a sign was placed on the fixture indicating it should not be used. SCI then revisited the site, after a minimum of eight hours, to collect water samples from the fixtures.

SCI collected 60 drinking water samples (PES-1 through PES-60) from various water fixtures located throughout the structure and submitted them for analytical testing. The drinking water samples were analyzed for total lead by U.S. EPA Method 200.8. SCI collected a minimum of 250 milliliters of water from each location. Sampled water was containerized in laboratory-provided sample containers and shipped to the lab using standard chain-of-custody procedures. A figure depicting the locations of the sampled water fixtures is enclosed.

The drinking water samples were analyzed for lead in accordance with the GTLOSDWA, Section 160.077, which establishes an action level (AL) of 5 parts per billion (ppb). The drinking water samples which exceeded the AL are identified in Table 1, below. A copy of the analytical test results and chain-of-custody for all samples is enclosed.

Table 1 – Lead in Drinking Water Results

Sample Number	Sample Location	Sample Description	Result (ppb)
PES-2	Kitchen	Double Basin Sink, Right Faucet	6.42
PES-4	Kitchen	Combi-Oven	15.6
PES-5	Kitchen	Handwash Sink	9.03
PES-8	Kitchen	Triple Basin Sink, Left Faucet	9.70
PES-10	Library Office	Sink	12.9
PES-25	Room 24	Sink Faucet	12.5
PES-26	Room 23	Water Fountain	17.6
PES-27	Room 22	Sink Faucet	24.3
PES-28	Room 22	Sink Spray Nozzle	166
PES-29	Room 21	Sink Faucet	8.69
PES-30	Room 20	Sink Faucet	14.0
PES-34	Room 19	Sink Spray Nozzle	722
PES-35	Room 18	Sink Faucet	8.21
PES-41	Room 15A	Sink Faucet	13.4
PES-43	Room 14	Sink Faucet	8.22
PES-44	Room 13	Sink Faucet	7.04
PES-45	Room 13	Sink Spray Nozzle	13.1
PES-48	Room 12	Sink Faucet	8.49
PES-49	Room 12	Sink Spray Nozzle	63.1
PES-50	Room 11	Sink Faucet	8.44

Table 1 – Lead in Drinking Water Results (Continued)

PES-52	Room 10	Sink Faucet	6.71
PES-53	Room 10	Sink Spray Nozzle	23.6
PES-54	Room 9	Sink Faucet	51.2
PES-55	Room 9	Sink Spray Nozzle	9.69
PES-56	Room 8	Sink Faucet	10.2
PES-60	Room 6	Sink Faucet	15.8

CONCLUSION AND RECOMMENDATIONS

As can be seen in Table 1, above, twenty-six drinking water samples exceeded the AL. SCI recommends any fixture which exceeds the AL be taken out of service until remediated and follow up testing indicates results less than the AL. Alternatively, if a water fixture is determined not to be a potable drinking water source, signage may be installed indicating the purpose and/or restrictions of the fixture.

According to GTLOSDWA, any water fixtures which exceed the AL shall be remediated prior to August 1, 2024, or the first day on which students will be present in the building, whichever is later. Any replacement fixture shall be lead free, as defined in 40 CFR 143.12.

REPORTING

Within seven business days after receiving this report, the school district shall contact parents and staff via written notification which shall include the following:

- The test results and a summary that explains such results;
- A description of any remedial steps taken;
- A description of general health effects of lead contamination and community specific resources; and
- If there is not enough water to meet the drinking water needs of the students, teachers and staff, bottled water shall be provided.

Additionally, within two weeks of receiving this report, the results and any lead remediation plans must be made available on the school's website.

This report, and subsequent annual testing reports, must be submitted to the Missouri Department of Health and Senior Services, Healthy Drinking Water Unit, PO Box 570, Jefferson City, MO 65102-0570.

FUTURE TESTING

After the fixtures identified in Table 1, above, have been remediated, at least 25 percent of the remediated fixtures must be sampled annually until all remediated sources have been tested.

However, SCI recommends all fixtures be tested once they have been remediated. Once all fixtures have been tested and are below the action level, the school shall test the potable drinking water fixtures once every five years.

SCI appreciates the opportunity to be of service to you on this project, and we look forward to working with you in the future. Please contact us if you have any questions or comments regarding the information provided.

Respectfully,

SCI ENGINEERING, INC.



Brian L. Lieb
Project Scientist



Jessica B. Keeven, CHMM
Senior Scientist

BLL/JBK/rah

Enclosure

Lead Drinking Water Sampling Plan
Lead Testing Results



GENERAL NOTES/LEGEND

- RESULTS GREATER THAN THE ACTION LEVEL OF 5 PARTS PER BILLION
- RESULTS LESS THAN THE ACTION LEVEL OF 5 PARTS PER BILLION

FLOOR PLANS PROVIDED BY MEHLVILLE SCHOOL DISTRICT. DIMENSIONS AND LOCATIONS ARE APPROXIMATE; ACTUAL MAY VARY. DRAWING SHALL NOT BE USED OUTSIDE THE CONTEXT OF THE REPORT FOR WHICH IT WAS GENERATED.

PROJECT NAME
MEHLVILLE SCHOOL DISTRICT
POINT ELEMENTARY SCHOOL
ST. LOUIS, MISSOURI

LEAD DRINKING WATER SAMPLING PLAN





JOB NUMBER
2016-0860.2T

FIGURE DATE
02/27/2024

DRAWN BY
JTM

CHECKED BY
BLL

FIGURE
1

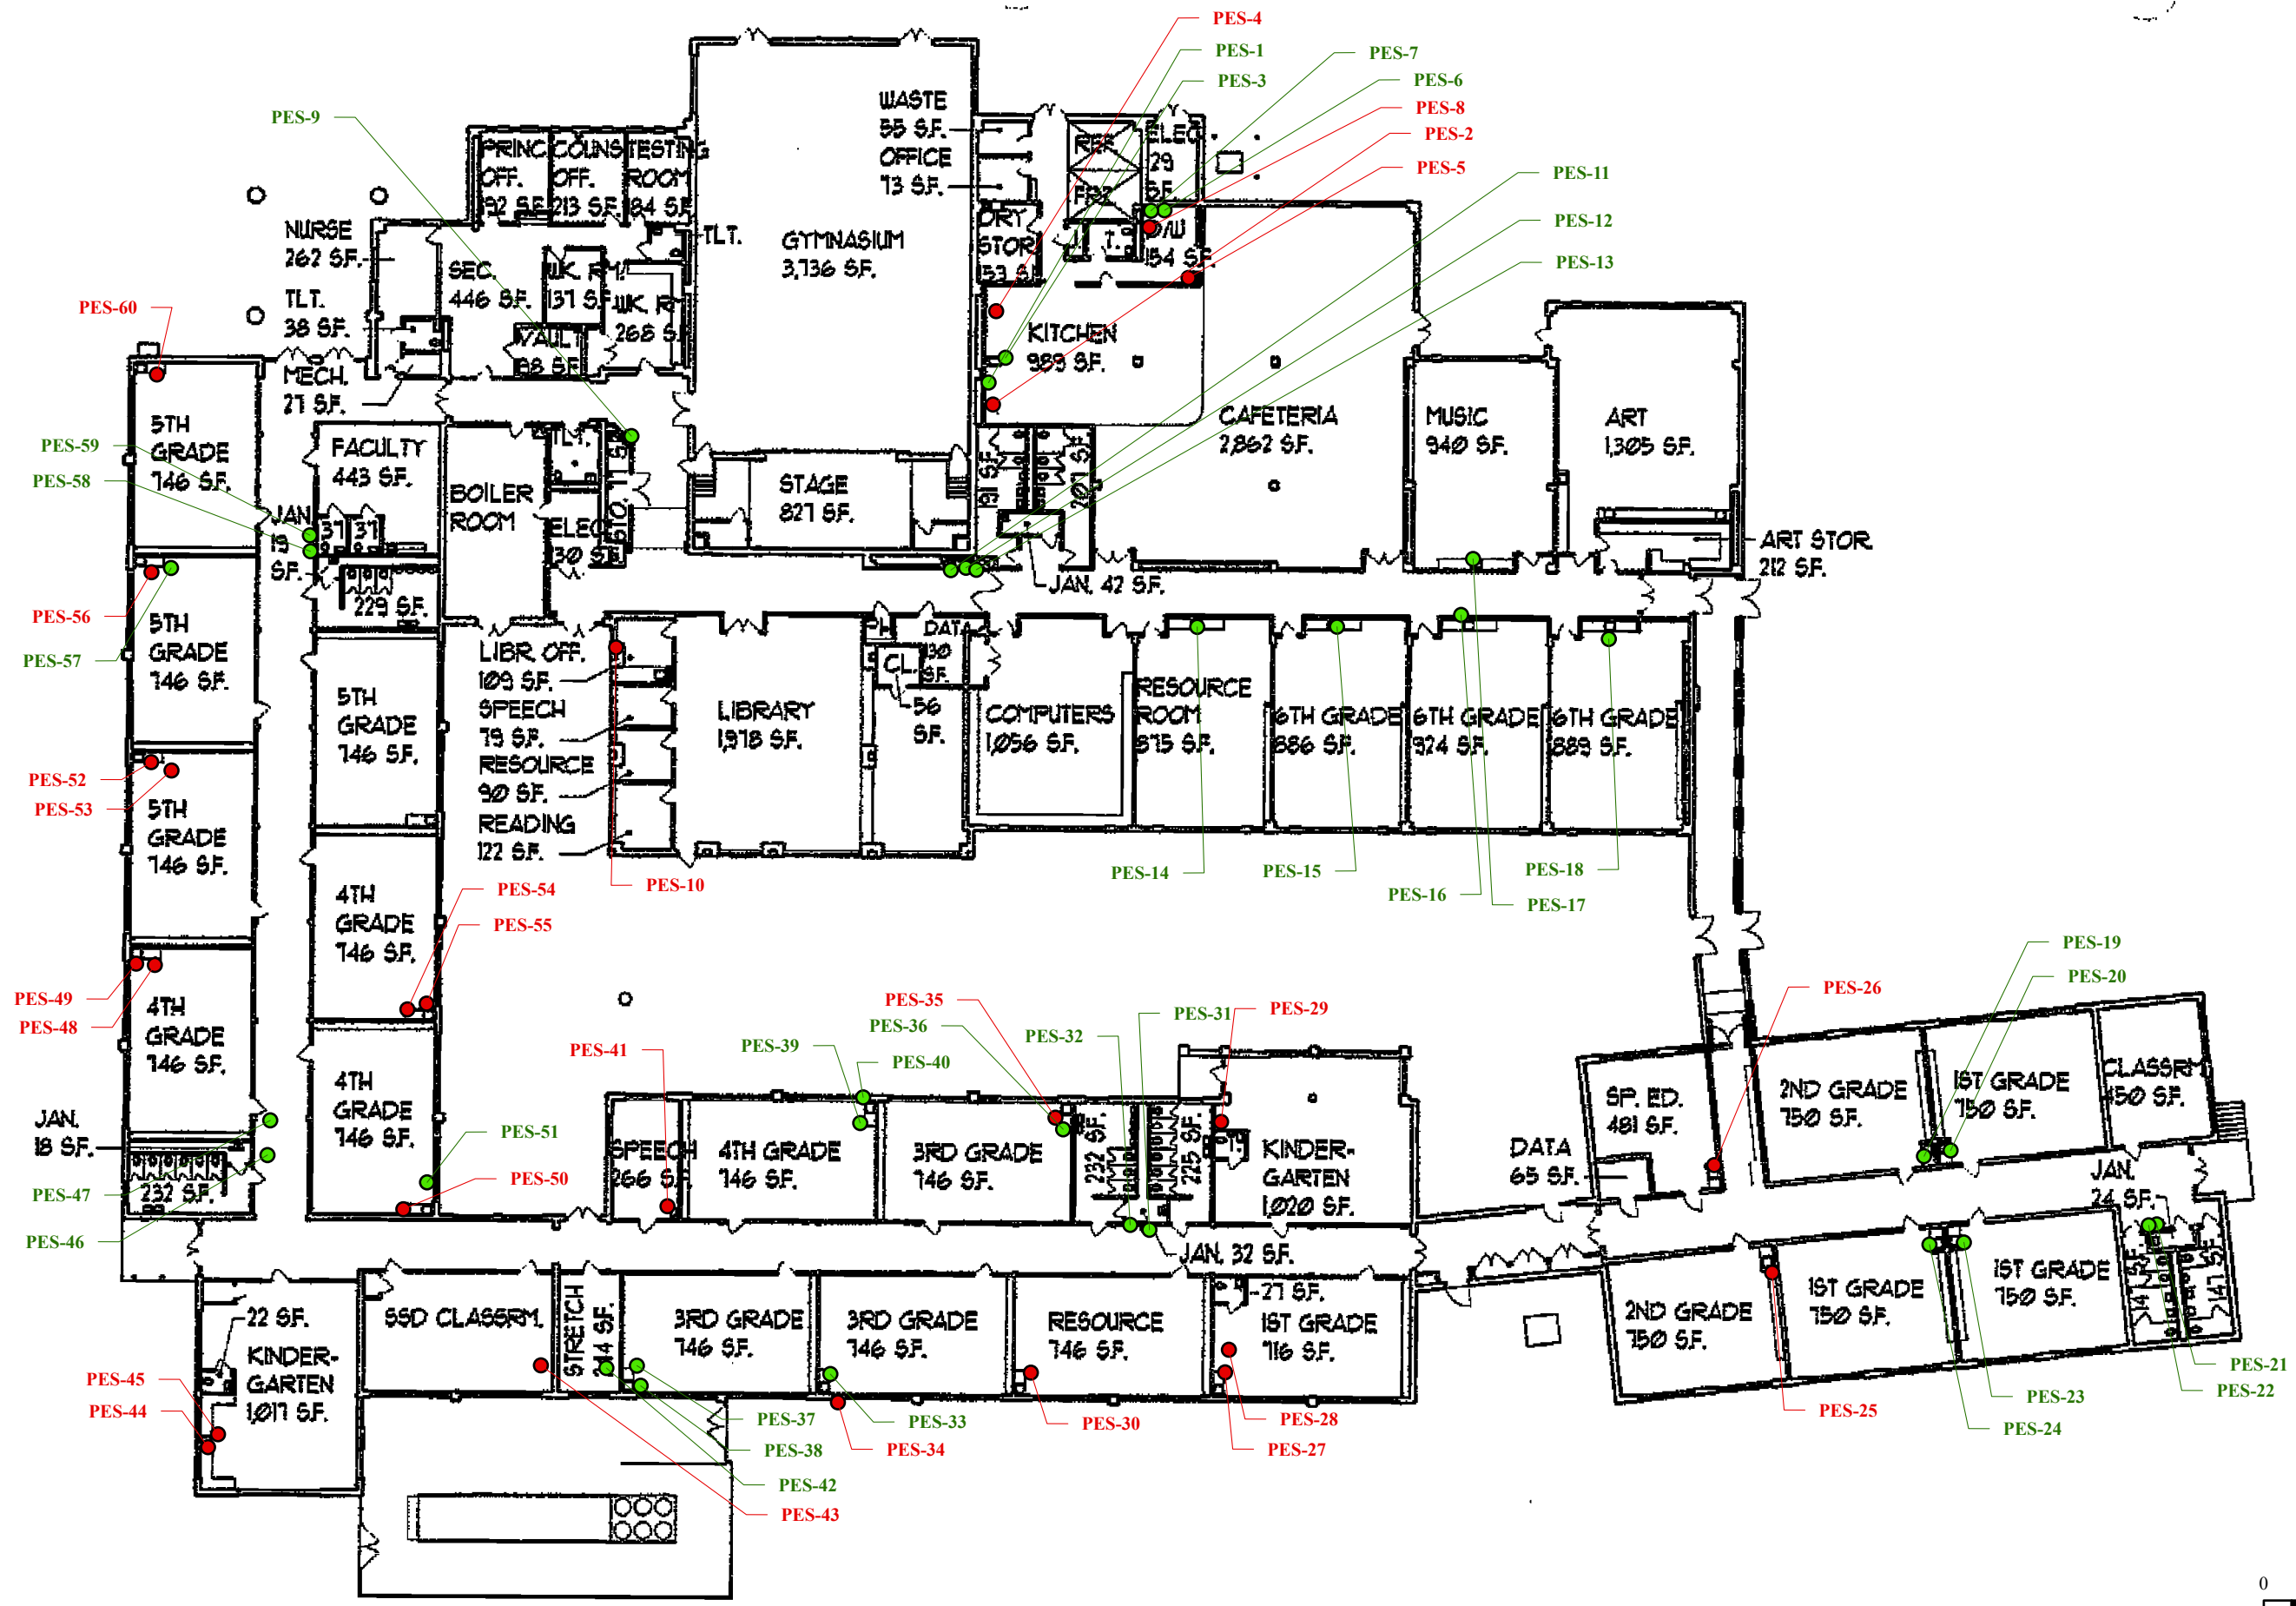



Pace Analytical Services, LLC

2231 W. Altorfer Drive

Peoria, IL 61615

(800)752-6651

January 20, 2024

Glenn Grissom
SCI Engineering
130 Point W. Blvd.
St. Chariles, MO 63301

RE: 2016-0860.2T POINT ELEM

Dear Glenn Grissom:

Please find enclosed the analytical results for the **60** sample(s) the laboratory received on **1/4/24 4:30 pm** and logged in under work order **HA00541**. All testing is performed according to our current TNI accreditations unless otherwise noted. This report cannot be reproduced, except in full, without the written permission of Pace Analytical Services, LLC.

If you have any questions regarding your report, please contact your project manager. Quality and timely data is of the utmost importance to us.

Pace Analytical Services appreciates the opportunity to provide you with analytical expertise. We are always trying to improve our customer service and we welcome you to contact the General Manager, Lisa Grant, with any feedback you have about your experience with our laboratory at 309-683-1764 or lisa.grant@pacelabs.com.

A handwritten signature in black ink, appearing to read "Chenise Lambert-Sykes".

Chenise Lambert-Sykes
Project Manager
(314)432-0550
Chenise.Lambert-Sykes@pacelabs.com



SAMPLE RECEIPT CHECK LIST

Items not applicable will be marked as in compliance

Work Order HA00541

YES	Samples received within temperature compliance when applicable
YES	COC present upon sample receipt
YES	COC completed & legible
YES	Sampler name & signature present
YES	Unique sample IDs assigned
YES	Sample collection location recorded
YES	Date & time collected recorded on COC
YES	Relinquished by client signature on COC
YES	COC & labels match
YES	Sample labels are legible
YES	Appropriate bottle(s) received
YES	Sufficient sample volume received
YES	Sample containers received undamaged
NO	Zero headspace, <6 mm present in VOA vials
NO	Trip blank(s) received
YES	All non-field analyses received within holding times
NO	Short hold time analysis
YES	Current PDC COC submitted
NO	Case narrative provided



ANALYTICAL RESULTS

Sample: HA00541-01
Name: PES - 1
Matrix: Drinking Water - Grab

Sampled: 12/29/23 17:59
Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Total Metals - PIA

Table row for Lead: 3.38 ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 15:12, BRS, EPA 200.8 REV 5.4

Sample: HA00541-02
Name: PES - 2
Matrix: Drinking Water - Grab

Sampled: 12/29/23 18:00
Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Total Metals - PIA

Table row for Lead: 6.42 ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 15:13, BRS, EPA 200.8 REV 5.4

Sample: HA00541-03
Name: PES - 3
Matrix: Drinking Water - Grab

Sampled: 12/29/23 18:01
Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Total Metals - PIA

Table row for Lead: < 1.00 ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 15:18, BRS, EPA 200.8 REV 5.4

Sample: HA00541-04
Name: PES - 4
Matrix: Drinking Water - Grab

Sampled: 12/29/23 18:02
Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Total Metals - PIA

Table row for Lead: 15.6 ug/L, 01/15/24 12:04, 1, 1.00, 01/15/24 18:23, BRS, EPA 200.8 REV 5.4



ANALYTICAL RESULTS

Sample: HA00541-05
Name: PES - 5
Matrix: Drinking Water - Grab

Sampled: 12/29/23 18:05
Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, 9.03, ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 15:19, BRS, EPA 200.8 REV 5.4

Sample: HA00541-06
Name: PES - 6
Matrix: Drinking Water - Grab

Sampled: 12/29/23 18:05
Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, 4.85, ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 15:21, BRS, EPA 200.8 REV 5.4

Sample: HA00541-07
Name: PES - 7
Matrix: Drinking Water - Grab

Sampled: 12/29/23 18:07
Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, 1.89, ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 15:22, BRS, EPA 200.8 REV 5.4

Sample: HA00541-08
Name: PES - 8
Matrix: Drinking Water - Grab

Sampled: 12/29/23 18:08
Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, 9.70, ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 15:27, BRS, EPA 200.8 REV 5.4



ANALYTICAL RESULTS

Sample: HA00541-09
Name: PES - 9
Matrix: Drinking Water - Grab

Sampled: 12/29/23 18:11
Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, < 1.00, ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 15:29, BRS, EPA 200.8 REV 5.4

Sample: HA00541-10
Name: PES - 10
Matrix: Drinking Water - Grab

Sampled: 12/29/23 18:13
Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, 12.9, ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 15:30, BRS, EPA 200.8 REV 5.4

Sample: HA00541-11
Name: PES - 11
Matrix: Drinking Water - Grab

Sampled: 12/29/23 18:15
Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, < 1.00, ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 15:32, BRS, EPA 200.8 REV 5.4

Sample: HA00541-12
Name: PES - 12
Matrix: Drinking Water - Grab

Sampled: 12/29/23 18:16
Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, < 1.00, ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 15:36, BRS, EPA 200.8 REV 5.4



ANALYTICAL RESULTS

Sample: HA00541-13
Name: PES - 13
Matrix: Drinking Water - Grab

Sampled: 12/29/23 18:17
Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, < 1.00, ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 15:38, BRS, EPA 200.8 REV 5.4

Sample: HA00541-14
Name: PES - 14
Matrix: Drinking Water - Grab

Sampled: 12/29/23 18:18
Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, < 1.00, ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 15:39, BRS, EPA 200.8 REV 5.4

Sample: HA00541-15
Name: PES - 15
Matrix: Drinking Water - Grab

Sampled: 12/29/23 18:20
Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, < 1.00, ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 15:41, BRS, EPA 200.8 REV 5.4

Sample: HA00541-16
Name: PES - 16
Matrix: Drinking Water - Grab

Sampled: 12/29/23 18:22
Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, < 1.00, ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 15:43, BRS, EPA 200.8 REV 5.4



ANALYTICAL RESULTS

Sample: HA00541-17
Name: PES - 17
Matrix: Drinking Water - Grab

Sampled: 12/29/23 18:25
Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, < 1.00, ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 15:44, BRS, EPA 200.8 REV 5.4

Sample: HA00541-18
Name: PES - 18
Matrix: Drinking Water - Grab

Sampled: 12/29/23 18:27
Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, < 1.00, ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 15:49, BRS, EPA 200.8 REV 5.4

Sample: HA00541-19
Name: PES - 19
Matrix: Drinking Water - Grab

Sampled: 12/29/23 18:30
Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, 2.37, ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 15:50, BRS, EPA 200.8 REV 5.4

Sample: HA00541-20
Name: PES - 20
Matrix: Drinking Water - Grab

Sampled: 12/29/23 18:32
Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, 3.77, ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 15:55, BRS, EPA 200.8 REV 5.4



ANALYTICAL RESULTS

Sample: HA00541-21
Name: PES - 21
Matrix: Drinking Water - Grab

Sampled: 12/29/23 18:34

Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Total Metals - PIA

Table row for Lead: < 1.00 ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 15:57, BRS, EPA 200.8 REV 5.4

Sample: HA00541-22
Name: PES - 22
Matrix: Drinking Water - Grab

Sampled: 12/29/23 18:35

Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Total Metals - PIA

Table row for Lead: < 1.00 ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 15:58, BRS, EPA 200.8 REV 5.4

Sample: HA00541-23
Name: PES - 23
Matrix: Drinking Water - Grab

Sampled: 12/29/23 18:36

Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Total Metals - PIA

Table row for Lead: 3.57 ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 16:00, BRS, EPA 200.8 REV 5.4

Sample: HA00541-24
Name: PES - 24
Matrix: Drinking Water - Grab

Sampled: 12/29/23 18:38

Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Total Metals - PIA

Table row for Lead: 4.36 ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 16:01, BRS, EPA 200.8 REV 5.4



ANALYTICAL RESULTS

Sample: HA00541-25
Name: PES - 25
Matrix: Drinking Water - Grab

Sampled: 12/29/23 18:39
Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, 12.5, ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 16:03, BRS, EPA 200.8 REV 5.4

Sample: HA00541-26
Name: PES - 26
Matrix: Drinking Water - Grab

Sampled: 12/29/23 18:40
Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, 17.6, ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 16:04, BRS, EPA 200.8 REV 5.4

Sample: HA00541-27
Name: PES - 27
Matrix: Drinking Water - Grab

Sampled: 12/29/23 18:42
Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, 24.3, ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 16:06, BRS, EPA 200.8 REV 5.4

Sample: HA00541-28
Name: PES - 28
Matrix: Drinking Water - Grab

Sampled: 12/29/23 18:42
Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, 166, ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 16:14, BRS, EPA 200.8 REV 5.4



ANALYTICAL RESULTS

Sample: HA00541-29
Name: PES - 29
Matrix: Drinking Water - Grab

Sampled: 12/29/23 18:47
Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, 8.69, ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 16:15, BRS, EPA 200.8 REV 5.4

Sample: HA00541-30
Name: PES - 30
Matrix: Drinking Water - Grab

Sampled: 12/29/23 18:49
Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, 14.0, ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 16:17, BRS, EPA 200.8 REV 5.4

Sample: HA00541-31
Name: PES - 31
Matrix: Drinking Water - Grab

Sampled: 12/29/23 18:50
Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, < 1.00, ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 16:18, BRS, EPA 200.8 REV 5.4

Sample: HA00541-32
Name: PES - 32
Matrix: Drinking Water - Grab

Sampled: 12/29/23 18:52
Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, < 1.00, ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 16:20, BRS, EPA 200.8 REV 5.4



ANALYTICAL RESULTS

Sample: HA00541-33
Name: PES - 33
Matrix: Drinking Water - Grab

Sampled: 12/29/23 18:53
Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, 4.68, ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 16:21, BRS, EPA 200.8 REV 5.4

Sample: HA00541-34
Name: PES - 34
Matrix: Drinking Water - Grab

Sampled: 12/29/23 18:53
Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, 722, ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 16:23, BRS, EPA 200.8 REV 5.4

Sample: HA00541-35
Name: PES - 35
Matrix: Drinking Water - Grab

Sampled: 12/29/23 18:56
Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, 8.21, ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 16:24, BRS, EPA 200.8 REV 5.4

Sample: HA00541-36
Name: PES - 36
Matrix: Drinking Water - Grab

Sampled: 12/29/23 18:56
Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, 1.32, ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 16:26, BRS, EPA 200.8 REV 5.4



ANALYTICAL RESULTS

Sample: HA00541-37
Name: PES - 37
Matrix: Drinking Water - Grab

Sampled: 12/29/23 19:02
Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, 1.22, ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 16:27, BRS, EPA 200.8 REV 5.4

Sample: HA00541-38
Name: PES - 38
Matrix: Drinking Water - Grab

Sampled: 12/29/23 19:02
Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, < 1.00, ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 16:35, BRS, EPA 200.8 REV 5.4

Sample: HA00541-39
Name: PES - 39
Matrix: Drinking Water - Grab

Sampled: 12/29/23 19:05
Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, 3.74, ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 16:37, BRS, EPA 200.8 REV 5.4

Sample: HA00541-40
Name: PES - 40
Matrix: Drinking Water - Grab

Sampled: 12/29/23 19:05
Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, 4.98, ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 16:38, BRS, EPA 200.8 REV 5.4



ANALYTICAL RESULTS

Sample: HA00541-41
Name: PES - 41
Matrix: Drinking Water - Grab

Sampled: 12/29/23 19:07

Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Total Metals - PIA

Table row for Lead: 13.4 ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 16:40, BRS, EPA 200.8 REV 5.4

Sample: HA00541-42
Name: PES - 42
Matrix: Drinking Water - Grab

Sampled: 12/29/23 19:09

Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Total Metals - PIA

Table row for Lead: < 1.00 ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 16:41, BRS, EPA 200.8 REV 5.4

Sample: HA00541-43
Name: PES - 43
Matrix: Drinking Water - Grab

Sampled: 12/29/23 19:10

Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Total Metals - PIA

Table row for Lead: 8.22 ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 16:43, BRS, EPA 200.8 REV 5.4

Sample: HA00541-44
Name: PES - 44
Matrix: Drinking Water - Grab

Sampled: 12/29/23 19:13

Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Total Metals - PIA

Table row for Lead: 7.04 ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 16:44, BRS, EPA 200.8 REV 5.4



ANALYTICAL RESULTS

Sample: HA00541-45
Name: PES - 45
Matrix: Drinking Water - Grab

Sampled: 12/29/23 19:13

Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Total Metals - PIA

Table row for Lead: 13.1 ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 16:46, BRS, EPA 200.8 REV 5.4

Sample: HA00541-46
Name: PES - 46
Matrix: Drinking Water - Grab

Sampled: 12/29/23 19:16

Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Total Metals - PIA

Table row for Lead: < 1.00 ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 16:51, BRS, EPA 200.8 REV 5.4

Sample: HA00541-47
Name: PES - 47
Matrix: Drinking Water - Grab

Sampled: 12/29/23 19:17

Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Total Metals - PIA

Table row for Lead: < 1.00 ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 16:52, BRS, EPA 200.8 REV 5.4

Sample: HA00541-48
Name: PES - 48
Matrix: Drinking Water - Grab

Sampled: 12/29/23 19:19

Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Total Metals - PIA

Table row for Lead: 8.49 ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 16:57, BRS, EPA 200.8 REV 5.4



ANALYTICAL RESULTS

Sample: HA00541-49
Name: PES - 49
Matrix: Drinking Water - Grab

Sampled: 12/29/23 19:19

Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Total Metals - PIA

Table row for Lead: 63.1 ug/L, 01/15/24 12:04, 1, 1.00, 01/15/24 18:24, BRS, EPA 200.8 REV 5.4

Sample: HA00541-50
Name: PES - 50
Matrix: Drinking Water - Grab

Sampled: 12/29/23 19:21

Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Total Metals - PIA

Table row for Lead: 8.44 ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 16:59, BRS, EPA 200.8 REV 5.4

Sample: HA00541-51
Name: PES - 51
Matrix: Drinking Water - Grab

Sampled: 12/29/23 19:21

Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Total Metals - PIA

Table row for Lead: 4.06 ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 17:00, BRS, EPA 200.8 REV 5.4

Sample: HA00541-52
Name: PES - 52
Matrix: Drinking Water - Grab

Sampled: 12/29/23 19:24

Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Total Metals - PIA

Table row for Lead: 6.71 ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 17:02, BRS, EPA 200.8 REV 5.4



ANALYTICAL RESULTS

Sample: HA00541-53
Name: PES - 53
Matrix: Drinking Water - Grab

Sampled: 12/29/23 19:24
Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, 23.6, ug/L, 01/15/24 12:04, 1, 1.00, 01/15/24 18:29, BRS, EPA 200.8 REV 5.4

Sample: HA00541-54
Name: PES - 54
Matrix: Drinking Water - Grab

Sampled: 12/29/23 19:27
Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, 51.2, ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 17:03, BRS, EPA 200.8 REV 5.4

Sample: HA00541-55
Name: PES - 55
Matrix: Drinking Water - Grab

Sampled: 12/29/23 19:27
Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, 9.69, ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 17:05, BRS, EPA 200.8 REV 5.4

Sample: HA00541-56
Name: PES - 56
Matrix: Drinking Water - Grab

Sampled: 12/29/23 19:29
Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, 10.2, ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 17:09, BRS, EPA 200.8 REV 5.4



ANALYTICAL RESULTS

Sample: HA00541-57
Name: PES - 57
Matrix: Drinking Water - Grab

Sampled: 12/29/23 19:29

Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Total Metals - PIA

Table row for Lead: 2.09 ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 17:11, BRS, EPA 200.8 REV 5.4

Sample: HA00541-58
Name: PES - 58
Matrix: Drinking Water - Grab

Sampled: 12/29/23 19:32

Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Total Metals - PIA

Table row for Lead: < 1.00 ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 17:13, BRS, EPA 200.8 REV 5.4

Sample: HA00541-59
Name: PES - 59
Matrix: Drinking Water - Grab

Sampled: 12/29/23 19:32

Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Total Metals - PIA

Table row for Lead: < 1.00 ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 17:14, BRS, EPA 200.8 REV 5.4

Sample: HA00541-60
Name: PES - 60
Matrix: Drinking Water - Grab

Sampled: 12/29/23 19:34

Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Total Metals - PIA

Table row for Lead: 15.8 ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 17:19, BRS, EPA 200.8 REV 5.4



QC SAMPLE RESULTS

Parameter	Result	Unit	Qual	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit
<u>Batch B423111 - DW 200.8 no prep - EPA 200.8 REV 5.4</u>									
Blank (B423111-BLK1)				Prepared & Analyzed: 01/15/24					
Lead	< 1.00	ug/L							
LCS (B423111-BS1)				Prepared & Analyzed: 01/15/24					
Lead	485	ug/L		500.0		97	85-115		
Matrix Spike (B423111-MS1)				Sample: GL04728-24 Prepared & Analyzed: 01/15/24					
Lead	484	ug/L		500.0	0.138	97	70-130		
Matrix Spike (B423111-MS2)				Sample: GL04721-08 Prepared & Analyzed: 01/15/24					
Lead	492	ug/L		500.0	0.860	98	70-130		
Matrix Spike Dup (B423111-MSD1)				Sample: GL04728-24 Prepared & Analyzed: 01/15/24					
Lead	491	ug/L		500.0	0.138	98	70-130	1	20
Matrix Spike Dup (B423111-MSD2)				Sample: GL04721-08 Prepared & Analyzed: 01/15/24					
Lead	481	ug/L		500.0	0.860	96	70-130	2	20
<u>Batch B423188 - DW 200.8 no prep - EPA 200.8 REV 5.4</u>									
Blank (B423188-BLK1)				Prepared & Analyzed: 01/16/24					
Lead	< 1.00	ug/L							
LCS (B423188-BS1)				Prepared & Analyzed: 01/16/24					
Lead	53.7	ug/L		50.00		107	85-115		
Matrix Spike (B423188-MS1)				Sample: HA00539-10 Prepared & Analyzed: 01/16/24					
Lead	53.7	ug/L		50.00	1.63	104	70-130		
Matrix Spike (B423188-MS2)				Sample: HA00539-20 Prepared & Analyzed: 01/16/24					
Lead	60.4	ug/L		50.00	9.24	102	70-130		
Matrix Spike (B423188-MS3)				Sample: HA00539-30 Prepared & Analyzed: 01/16/24					
Lead	56.2	ug/L		50.00	ND	112	70-130		
Matrix Spike (B423188-MS4)				Sample: HA00539-34 Prepared & Analyzed: 01/16/24					
Lead	53.4	ug/L		50.00	ND	107	70-130		
Matrix Spike (B423188-MS5)				Sample: HA00541-07 Prepared & Analyzed: 01/16/24					
Lead	54.2	ug/L		50.00	1.89	105	70-130		
Matrix Spike (B423188-MS6)				Sample: HA00541-17 Prepared & Analyzed: 01/16/24					
Lead	52.3	ug/L		50.00	ND	105	70-130		
Matrix Spike (B423188-MS7)				Sample: HA00541-27 Prepared & Analyzed: 01/16/24					
Lead	75.1	ug/L		50.00	24.3	102	70-130		
Matrix Spike (B423188-MS8)				Sample: HA00541-37 Prepared & Analyzed: 01/16/24					
Lead	54.0	ug/L		50.00	1.22	106	70-130		
Matrix Spike (B423188-MS9)				Sample: HA00541-47 Prepared & Analyzed: 01/16/24					
Lead	51.9	ug/L		50.00	0.753	102	70-130		
Matrix Spike (B423188-MSA)				Sample: HA00541-59 Prepared & Analyzed: 01/16/24					
Lead	52.0	ug/L		50.00	ND	104	70-130		
Matrix Spike (B423188-MSB)				Sample: HA00543-10 Prepared & Analyzed: 01/16/24					
Lead	58.3	ug/L		50.00	1.20	114	70-130		
Matrix Spike (B423188-MSC)				Sample: HA00543-20 Prepared & Analyzed: 01/16/24					
Lead	57.3	ug/L		50.00	0.120	114	70-130		
Matrix Spike (B423188-MSD)				Sample: HA00543-30 Prepared & Analyzed: 01/16/24					
Lead	57.1	ug/L		50.00	2.47	109	70-130		



QC SAMPLE RESULTS

Parameter	Result	Unit	Qual	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit
Matrix Spike Dup (B423188-MSD1)	Sample: HA00539-10			Prepared & Analyzed: 01/16/24					
Lead	54.2	ug/L		50.00	1.63	105	70-130	1	20
Matrix Spike Dup (B423188-MSD2)	Sample: HA00539-20			Prepared & Analyzed: 01/16/24					
Lead	60.3	ug/L		50.00	9.24	102	70-130	0.2	20
Matrix Spike Dup (B423188-MSD3)	Sample: HA00539-30			Prepared & Analyzed: 01/16/24					
Lead	53.9	ug/L		50.00	ND	108	70-130	4	20
Matrix Spike Dup (B423188-MSD4)	Sample: HA00539-34			Prepared & Analyzed: 01/16/24					
Lead	51.5	ug/L		50.00	ND	103	70-130	4	20
Matrix Spike Dup (B423188-MSD5)	Sample: HA00541-07			Prepared & Analyzed: 01/16/24					
Lead	52.3	ug/L		50.00	1.89	101	70-130	4	20
Matrix Spike Dup (B423188-MSD6)	Sample: HA00541-17			Prepared & Analyzed: 01/16/24					
Lead	52.9	ug/L		50.00	ND	106	70-130	1	20
Matrix Spike Dup (B423188-MSD7)	Sample: HA00541-27			Prepared & Analyzed: 01/16/24					
Lead	75.1	ug/L		50.00	24.3	102	70-130	0.02	20
Matrix Spike Dup (B423188-MSD8)	Sample: HA00541-37			Prepared & Analyzed: 01/16/24					
Lead	52.8	ug/L		50.00	1.22	103	70-130	2	20
Matrix Spike Dup (B423188-MSD9)	Sample: HA00541-47			Prepared & Analyzed: 01/16/24					
Lead	53.0	ug/L		50.00	0.753	104	70-130	2	20
Matrix Spike Dup (B423188-MSDA)	Sample: HA00541-59			Prepared & Analyzed: 01/16/24					
Lead	53.2	ug/L		50.00	ND	106	70-130	2	20
Matrix Spike Dup (B423188-MSDB)	Sample: HA00543-10			Prepared & Analyzed: 01/16/24					
Lead	58.1	ug/L		50.00	1.20	114	70-130	0.4	20
Matrix Spike Dup (B423188-MSDC)	Sample: HA00543-20			Prepared & Analyzed: 01/16/24					
Lead	58.0	ug/L		50.00	0.120	116	70-130	1	20
Matrix Spike Dup (B423188-MSDD)	Sample: HA00543-30			Prepared & Analyzed: 01/16/24					
Lead	57.3	ug/L		50.00	2.47	110	70-130	0.4	20
Matrix Spike Dup (B423188-MSDE)	Sample: HA00543-40			Prepared & Analyzed: 01/16/24					
Lead	56.4	ug/L		50.00	ND	113	70-130	0.5	20
Matrix Spike Dup (B423188-MSDF)	Sample: HA00543-50			Prepared & Analyzed: 01/16/24					
Lead	56.8	ug/L		50.00	0.167	113	70-130	0.8	20
Matrix Spike (B423188-MSE)	Sample: HA00543-40			Prepared & Analyzed: 01/16/24					
Lead	56.1	ug/L		50.00	ND	112	70-130		
Matrix Spike (B423188-MSF)	Sample: HA00543-50			Prepared & Analyzed: 01/16/24					
Lead	57.2	ug/L		50.00	0.167	114	70-130		



NOTES

Specifications regarding method revisions, method modifications, and calculations used for analysis are available upon request. Please contact your project manager.

* Not a TNI accredited analyte

Certifications

CHI - McHenry, IL - 4314-A W. Crystal Lake Road, McHenry, IL 60050

TNI Accreditation for Drinking Water and Wastewater Fields of Testing through IL EPA Accreditation No. 100279

Illinois Department of Public Health Bacterial Analysis in Drinking Water Approved Laboratory Registry No. 17556

PIA - Peoria, IL - 2231 W. Altorfer Drive, Peoria, IL 61615

TNI Accreditation for Drinking Water, Wastewater, Solid and Hazardous Material Fields of Testing through IL EPA Accreditation No. 100230

Illinois Department of Public Health Bacterial Analysis in Drinking Water Approved Laboratory Registry No. 17553

Drinking Water Certifications/Accreditations: Iowa (240); Kansas (E-10338); Missouri (870)

Wastewater Certifications/Accreditations: Arkansas (88-0677); Iowa (240); Kansas (E-10338)

Solid and Hazardous Material Certifications/Accreditations: Arkansas (88-0677); Iowa (240); Kansas (E-10338)

SPMO - Springfield, MO - 1805 W Sunset Street, Springfield, MO 65807

USEPA DMR-QA Program

STL - Hazelwood, MO - 944 Anglum Rd, Hazelwood, MO 63042

TNI Accreditation for Wastewater, Solid and Hazardous Material Fields of Testing through KS KDHE Certification No. E-10389

TNI Accreditation for Wastewater, Solid and Hazardous Material Fields of Testing through IL EPA Accreditation No. - 200080

Illinois Department of Public Health Bacterial Analysis in Drinking Water Approved Laboratory, Registry No. 171050

Missouri Department of Natural Resources - Certificate of Approval for Microbiological Laboratory Service - No. 1050



Certified by: Chenise Lambert-Sykes, Project Manager

REGULATORY PROGRAM (CIRCLE):	NPDES
MORBCA	RCRA
CCDD	TACO: RES OR IND/COMM

CHAIN OF CUSTODY RECORD
 STATE WHERE SAMPLE COLLECTED MO

ALL HIGHLIGHTED AREAS MUST BE COMPLETED BY CLIENT (PLEASE PRINT)

1 CLIENT SCI Engineering		PROJECT NUMBER 2016-0860.2T		PROJECT LOCATION Point Elem		PURCHASE ORDER #		3 ANALYSIS REQUESTED				4 (FOR LAB USE ONLY) LOGIN # <u>HA00541</u> LOGGED BY: <u>1/15/24</u> CLIENT: SCI Engineering PROJECT: Drinking Water Lead PROJ. MGR.: Chenise Lambert-Sykes CUSTODY SEAL #:	
ADDRESS 130 Point West Blvd		PHONE NUMBER (314) 581-7570		E-MAIL bliieb@sciengineering.com		DATE SHIPPED		DW Pb Turb Check				REMARKS	
CITY STATE ZIP St. Charles, MO 63301		SAMPLER (PLEASE PRINT) Ethan Boyer		MATRIX TYPES: WW- WASTEWATER DW- DRINKING WATER GW- GROUND WATER WWSL- SLUDGE NAS- NON AQUEOUS SOLID LCHL- LEACHATE OIL-OIL SO-SOIL SOL-SOLID									
CONTACT PERSON Brian Lieb		SAMPLER'S SIGNATURE											
2 SAMPLE DESCRIPTION (UNIQUE DESCRIPTION AS IT WILL APPEAR ON THE ANALYTICAL REPORT)		DATE COLLECTED	TIME COLLECTED	SAMPLE TYPE GRAB COMP	MATRIX TYPE	BOTTLE COUNT	PRES CODE CLIENT PROVIDED						
PES-1		12/29/23	1759	X	DW	1	6	X	X				
PES-2		12/29/23	1800	X	DW	1	6	X	X				
PES-3		12/29/23	1801	X	DW	1	6	X	X				
PES-4		12/29/23	1802	X	DW	1	6	X	X				
PES-5		12/29/23	1805	X	DW	1	6	X	X				
PES-6		12/29/23	1805	X	DW	1	6	X	X				
PES-7		12/29/23	1807	X	DW	1	6	X	X				
PES-8		12/29/23	1808	X	DW	1	6	X	X				
PES-9		12/29/23	1811	X	DW	1	6	X	X				
PES-10		12/29/23	1813	X	DW	1	6	X	X				
PES-11		12/29/23	1815	X	DW	1	6	X	X				
CHEMICAL PRESERVATION CODES:		1 - HCL	2 - H2SO4	3 - HNO3	4 - NAOH	5 - NA2S2O3	6 - UNPRESERVED	7 - OTHER					
5 TURNAROUND TIME REQUESTED (PLEASE CIRCLE) NORMAL RUSH (RUSH TAT IS SUBJECT TO PACE LABS APPROVAL AND SURCHARGE)		RUSH RESULTS VIA (PLEASE CIRCLE) EMAIL PHONE		DATE RESULTS NEEDED		6 I understand that by initialing this box I give the lab permission to proceed with analysis, even though it may not meet all sample conformance requirements as defined in the receiving facility's Sample Acceptance Policy and the data will be qualified. Qualified data may NOT be acceptable to report to all regulatory authorities.						PROCEED WITH ANALYSIS AND QUALIFY RESULTS: (INITIALS)	
EMAIL IF DIFFERENT FROM ABOVE:		PHONE # IF DIFFERENT FROM ABOVE:											
7 RELINQUISHED BY: (SIGNATURE)		DATE 1/3/24	RECEIVED BY: (SIGNATURE)		DATE 1-4-24	8 COMMENTS: (FOR LAB USE ONLY)						SAMPLE TEMPERATURE UPON RECEIPT 20.0 °C	
		TIME 17:00			TIME 1045								
RELINQUISHED BY: (SIGNATURE)		DATE 1-4-24	RECEIVED BY: (SIGNATURE)		DATE							CHILL PROCESS STARTED PRIOR TO RECEIPT Y OR N	
		TIME 1600			TIME							SAMPLE(S) RECEIVED ON ICE Y OR N	
RELINQUISHED BY: (SIGNATURE)		DATE	RECEIVED BY: (SIGNATURE)		DATE 1/7/21							SAMPLE ACCEPTANCE NONCONFORMANT Y OR N	
		TIME			TIME 1630							REPORT IS NEEDED Y OR N	
												DATE AND TIME TAKEN FROM SAMPLE BO	

REGULATORY PROGRAM (CIRCLE):	NPDES
MORBCA	RCRA
CCDD	TACO: RES OR IND/COMM

CHAIN OF CUSTODY RECORD
 STATE WHERE SAMPLE COLLECTED MO

ALL HIGHLIGHTED AREAS MUST BE COMPLETED BY CLIENT (PLEASE PRINT)

1 CLIENT SCI Engineering ADDRESS 130 Point West Blvd CITY STATE ZIP St. Charles, MO 63301 CONTACT PERSON Brian Lieb	PROJECT NUMBER 2016-0860.2T	PROJECT LOCATION Point Elem	PURCHASE ORDER #	3 ANALYSIS REQUESTED + + DW Pb Turb Check	4 (FOR LAB USE ONLY) LOGIN # HA00541 LOGGED BY: MSJ CLIENT: SCI Engineering PROJECT: Drinking Water Lead PROJ. MGR.: Chenise Lambert-Sykes CUSTODY SEAL #:				
	PHONE NUMBER (314) 581-7570	E-MAIL blieb@sciengineering.com	DATE SHIPPED						
	SAMPLER (PLEASE PRINT) Ethan Boyer	MATRIX TYPES: WW-WASTEWATER DW-DRINKING WATER GW-GROUND WATER WWSL-SLUDGE NAS-NON AQUEOUS SOLID LCHT-LEACHATE OIL-OIL SO-SOIL SOL-SOLID							
	SAMPLER'S SIGNATURE 								
2 SAMPLE DESCRIPTION (UNIQUE DESCRIPTION AS IT WILL APPEAR ON THE ANALYTICAL REPORT)	DATE COLLECTED	TIME COLLECTED	SAMPLE TYPE GRAB COMP	MATRIX TYPE	BOTTLE COUNT	PRES CODE CLIENT PROVIDED	DW Pb	Turb Check	REMARKS
	PES-12	12/29/23	1816	X	DW	1 6	X X		
	PES-13	12/29/23	1817	X	DW	1 6	X X		
	PES-14	12/29/23	1818	X	DW	1 6	X X		
	PES-15	12/29/23	1820	X	DW	1 6	X X		
	PES-16	12/29/23	1822	X	DW	1 6	X X		
	PES-17	12/29/23	1825	X	DW	1 6	X X		
	PES-18	12/29/23	1827	X	DW	1 6	X X		
	PES-19	12/29/23	1830	X	DW	1 6	X X		
	PES-20	12/29/23	1832	X	DW	1 6	X X		
	PES-21	12/29/23	1834	X	DW	1 6	X X		
PES-22	12/29/23	1835	X	DW	1 6	X X			
CHEMICAL PRESERVATION CODES: 1-HCL 2-H2SO4 3-HNO3 4-NAOH 5-NA2S2O3 6-UNPRESERVED 7-OTHER									
5 TURNAROUND TIME REQUESTED (PLEASE CIRCLE) NORMAL RUSH (RUSH TAT IS SUBJECT TO PACE LABS APPROVAL AND SURCHARGE) RUSH RESULTS VIA (PLEASE CIRCLE) EMAIL PHONE EMAIL IF DIFFERENT FROM ABOVE: PHONE # IF DIFFERENT FROM ABOVE:				DATE RESULTS NEEDED		6 I understand that by initialing this box I give the lab permission to proceed with analysis, even though it may not meet all sample conformance requirements as defined in the receiving facility's Sample Acceptance Policy and the data will be qualified. Qualified data may NOT be acceptable to report to all regulatory authorities. PROCEED WITH ANALYSIS AND QUALIFY RESULTS: (INITIALS)			
7 RELINQUISHED BY: (SIGNATURE) DATE 1/31/24 TIME 1500		RECEIVED BY: (SIGNATURE) DATE 1-4-24 TIME		COMMENTS: (FOR LAB USE ONLY)		SAMPLE TEMPERATURE UPON RECEIPT 20.0 °C CHILL PROCESS STARTED PRIOR TO RECEIPT Y OR N SAMPLE(S) RECEIVED ON ICE Y OR N SAMPLE ACCEPTANCE NONCONFORMANT REPORT IS NEEDED Y OR N DATE AND TIME TAKEN FROM SAMPLE BO			
RELINQUISHED BY: (SIGNATURE) DATE 1-4-24 TIME 1600		RECEIVED BY: (SIGNATURE) DATE 1/4/21 TIME 1630							
RELINQUISHED BY: (SIGNATURE) DATE TIME		RECEIVED BY: (SIGNATURE) DATE TIME							

REGULATORY PROGRAM (CIRCLE):	NPDES
MORBCA	RCRA
CCDD	TACO: RES OR IND/COMM

CHAIN OF CUSTODY RECORD
 STATE WHERE SAMPLE COLLECTED MO

ALL HIGHLIGHTED AREAS MUST BE COMPLETED BY CLIENT (PLEASE PRINT)

1 CLIENT SCI Engineering	PROJECT NUMBER 2016-0860.2T	PROJECT LOCATION Point Elem	PURCHASE ORDER #	3 ANALYSIS REQUESTED	4 (FOR LAB USE ONLY) LOGIN # <u>HA00541</u> LOGGED BY: <u>TASL</u> CLIENT: SCI Engineering PROJECT: <u>Drinking Water Lead</u> PROJ. MGR.: <u>Chenise Lambert-Sykes</u> CUSTODY SEAL #:
ADDRESS 130 Point West Blvd	PHONE NUMBER (314) 581-7570	E-MAIL blieb@sciengineering.com	DATE SHIPPED	<input checked="" type="checkbox"/> DW Pb <input checked="" type="checkbox"/> Turb Check	
CITY STATE ZIP St. Charles, MO 63301	SAMPLER (PLEASE PRINT) Ethan Boyer	MATRIX TYPES: WW- WASTEWATER DW- DRINKING WATER GW- GROUND WATER WWSL- SLUDGE NAB- NON AQUEOUS SOLID LCHT-LEACHATE OIL-OIL SO-SOIL SOL-SOLID			
CONTACT PERSON Brian Lieb	SAMPLER'S SIGNATURE 				

2 SAMPLE DESCRIPTION (UNIQUE DESCRIPTION AS IT WILL APPEAR ON THE ANALYTICAL REPORT)	DATE COLLECTED	TIME COLLECTED	SAMPLE TYPE		MATRIX TYPE	BOTTLE COUNT	PRES CODE CLIENT PROVIDED	DW Pb	Turb Check									REMARKS
			GRAB	COMP														
PES-23	12/29/23	1836	X		DW	1	6	X	X									
PES-24	12/29/23	1838	X		DW	1	6	X	X									
PES-25	12/29/23	1839	X		DW	1	6	X	X									
PES-26	12/29/23	1840	X		DW	1	6	X	X									
PES-27	12/29/23	1842	X		DW	1	6	X	X									
PES-28	12/29/23	1842	X		DW	1	6	X	X									
PES-29	12/29/23	1847	X		DW	1	6	X	X									
PES-30	12/29/23	1849	X		DW	1	6	X	X									
PES-31	12/29/23	1850	X		DW	1	6	X	X									
PES-32	12/29/23	1852	X		DW	1	6	X	X									
PES-33	12/29/23	1853	X		DW	1	6	X	X									

CHEMICAL PRESERVATION CODES: 1 - HCL 2 - H2SO4 3 - HNO3 4 - NAOH 5 - NA2S2O3 6 - UNPRESERVED 7 - OTHER

5 TURNAROUND TIME REQUESTED (PLEASE CIRCLE) NORMAL RUSH (RUSH TAT IS SUBJECT TO PACE LABS APPROVAL AND SURCHARGE)	DATE RESULTS NEEDED	6 I understand that by initialing this box I give the lab permission to proceed with analysis, even though it may not meet all sample conformance requirements as defined in the receiving facility's Sample Acceptance Policy and the data will be qualified. Qualified data may NOT be acceptable to report to all regulatory authorities.
RUSH RESULTS VIA (PLEASE CIRCLE) EMAIL PHONE		PROCEED WITH ANALYSIS AND QUALIFY RESULTS: (INITIALS) _____
EMAIL IF DIFFERENT FROM ABOVE: PHONE # IF DIFFERENT FROM ABOVE:		

7 RELINQUISHED BY: (SIGNATURE) 	DATE <u>1/3/24</u> TIME <u>15:00</u>	RECEIVED BY: (SIGNATURE) 	DATE <u>1-4-24</u> TIME <u>1045</u>	8 COMMENTS: (FOR LAB USE ONLY)
RELINQUISHED BY: (SIGNATURE) 	DATE <u>1-4-24</u> TIME <u>1600</u>	RECEIVED BY: (SIGNATURE)	DATE	SAMPLE TEMPERATURE UPON RECEIPT <u>20.0</u> °C
RELINQUISHED BY: (SIGNATURE)	DATE	RECEIVED BY: (SIGNATURE) 	DATE <u>1/4/24</u> TIME <u>1630</u>	CHILL PROCESS STARTED PRIOR TO RECEIPT SAMPLE(S) RECEIVED ON ICE Y OR N SAMPLE ACCEPTANCE NONCONFORMANT REPORT IS NEEDED Y OR N
				DATE AND TIME TAKEN FROM SAMPLE BO

REGULATORY PROGRAM (CIRCLE):	NPDES
MORBCA	RCRA
CCDD	TACO: RES OR IND/COMM

ALL HIGHLIGHTED AREAS MUST BE COMPLETED BY CLIENT (PLEASE PRINT)

1 CLIENT SCI Engineering	PROJECT NUMBER 2016-0860.2T	PROJECT LOCATION Point Elem	PURCHASE ORDER #	3 ANALYSIS REQUESTED + + DW Pb Turb Check	4 (FOR LAB USE ONLY) LOGIN # <u>HA00541</u> LOGGED BY: <u>MSI</u> CLIENT: <u>SCI Engineering</u> PROJECT: <u>Drinking Water Lead</u> PROJ. MGR.: <u>Chenise Lambert-Sykes</u> CUSTODY SEAL #:	
	ADDRESS 130 Point West Blvd	PHONE NUMBER (314) 581-7570	E-MAIL blieb@sciengineering.com			DATE SHIPPED
	CITY STATE ZIP St. Charles, MO 63301	SAMPLER (PLEASE PRINT) Ethan Boyer	MATRIX TYPES: WW-WASTEWATER DW-DRINKING WATER GW-GROUND WATER WWSL-SLUDGE NAS-NON AQUEOUS SOLID LCHT-LEACHATE OIL-OIL SO-SOIL SOL-SOLID			
	CONTACT PERSON Brian Lieb	SAMPLER'S SIGNATURE 				

2 SAMPLE DESCRIPTION (UNIQUE DESCRIPTION AS IT WILL APPEAR ON THE ANALYTICAL REPORT)	DATE COLLECTED	TIME COLLECTED	SAMPLE TYPE		MATRIX TYPE	BOTTLE COUNT	PRES CODE CLIENT PROVIDED	DW Pb	Turb	Check	REMARKS
			GRAB	COMP							
PES-34	12/29/23	1853	X		DW	1	6	X	X		
PES-35	12/29/23	1856	X		DW	1	6	X	X		
PES-36	12/29/23	1856	X		DW	1	6	X	X		
PES-37	12/29/23	1902	X		DW	1	6	X	X		
PES-38	12/29/23	1902	X		DW	1	6	X	X		
PES-39	12/29/23	1905	X		DW	1	6	X	X		
PES-40	12/29/23	1905	X		DW	1	6	X	X		
PES-41	12/29/23	1907	X		DW	1	6	X	X		
PES-42	12/29/23	1909	X		DW	1	6	X	X		
PES-43	12/29/23	1910	X		DW	1	6	X	X		
PES-44	12/29/23	1913	X		DW	1	6	X	X		

CHEMICAL PRESERVATION CODES: 1-HCL 2-H2SO4 3-HNO3 4-NAOH 5-NA2S2O3 6-UNPRESERVED 7-OTHER

5 TURNAROUND TIME REQUESTED (PLEASE CIRCLE) NORMAL RUSH (RUSH TAT IS SUBJECT TO PACE LABS APPROVAL AND SURCHARGE)	DATE RESULTS NEEDED	6 I understand that by initialing this box I give the lab permission to proceed with analysis, even though it may not meet all sample conformance requirements as defined in the receiving facility's Sample Acceptance Policy and the data will be qualified. Qualified data may NOT be acceptable to report to all regulatory authorities.
RUSH RESULTS VIA (PLEASE CIRCLE) EMAIL PHONE	PROCEED WITH ANALYSIS AND QUALIFY RESULTS: (INITIALS)	
EMAIL IF DIFFERENT FROM ABOVE: PHONE # IF DIFFERENT FROM ABOVE:		

7 RELINQUISHED BY: (SIGNATURE) 	DATE <u>1/3/24</u>	RECEIVED BY: (SIGNATURE) 	DATE <u>1-4-24</u>	8 COMMENTS: (FOR LAB USE ONLY) SAMPLE TEMPERATURE UPON RECEIPT <u>20.0</u> °C CHILL PROCESS STARTED PRIOR TO RECEIPT Y OR N SAMPLE(S) RECEIVED ON ICE Y OR N SAMPLE ACCEPTANCE NONCONFORMANT REPORT IS NEEDED Y OR N DATE AND TIME TAKEN FROM SAMPLE BOTTLE
	TIME <u>15:00</u>		TIME <u>16:45</u>	
	RELINQUISHED BY: (SIGNATURE) 	DATE <u>1-4-24</u>	RECEIVED BY: (SIGNATURE) 	
RELINQUISHED BY: (SIGNATURE) 	TIME <u>16:00</u>		TIME	
	DATE	RECEIVED BY: (SIGNATURE) 	DATE <u>1/4/24</u>	
	TIME		TIME <u>16:30</u>	

REGULATORY PROGRAM (CIRCLE):	NPDES
MORBCA	RCRA
CCDD	TACO: RES OR IND/COMM

ALL HIGHLIGHTED AREAS MUST BE COMPLETED BY CLIENT (PLEASE PRINT)

1 CLIENT SCI Engineering	PROJECT NUMBER 2016-0860.2T	PROJECT LOCATION Point Elem	PURCHASE ORDER #	3 ANALYSIS REQUESTED + + DW Pb Turb Check	4 (FOR LAB USE ONLY) LOGIN # <u>H1A00541</u> LOGGED BY: <u>JDL</u> CLIENT: SCI Engineering PROJECT: Drinking Water Lead PROJ. MGR.: Chense Lambert-Sykes CUSTODY SEAL #:	
	ADDRESS 130 Point West Blvd	PHONE NUMBER (314) 581-7570	E-MAIL blieb@sciengineering.com			DATE SHIPPED
	CITY STATE ZIP St. Charles, MO 63301	SAMPLER (PLEASE PRINT) Ethan Boyer	MATRIX TYPES: WW- WASTEWATER DW- DRINKING WATER GW- GROUND WATER WWSL- SLUDGE NAS- NON AQUEOUS SOLID LCHT- LEACHATE OIL- OIL SO- SOL SOL- SOLID			
	CONTACT PERSON Brian Lieb	SAMPLER'S SIGNATURE 				

2 SAMPLE DESCRIPTION (UNIQUE DESCRIPTION AS IT WILL APPEAR ON THE ANALYTICAL REPORT)	DATE COLLECTED	TIME COLLECTED	SAMPLE TYPE		MATRIX TYPE	BOTTLE COUNT	PRES CODE CLIENT PROVIDED	DW Pb	Turb Check									REMARKS
			GRAB	COMP														
PES-45	12/29/23	1913	X		DW	1	6	X	X									
PES-46	12/29/23	1916	X		DW	1	6	X	X									
PES-47	12/29/23	1917	X		DW	1	6	X	X									
PES-48	12/29/23	1919	X		DW	1	6	X	X									
PES-49	12/29/23	1919	X		DW	1	6	X	X									
PES-50	12/29/23	1921	X		DW	1	6	X	X									
PES-51	12/29/23	1921	X		DW	1	6	X	X									
PES-52	12/29/23	1924	X		DW	1	6	X	X									
PES-53	12/29/23	1924	X		DW	1	6	X	X									
PES-54	12/29/23	1927	X		DW	1	6	X	X									
PES-55	12/29/23	1927	X		DW	1	6	X	X									

CHEMICAL PRESERVATION CODES: 1 - HCL 2 - H2SO4 3 - HNO3 4 - NAOH 5 - NA2S2O3 6 - UNPRESERVED 7 - OTHER






5 TURNAROUND TIME REQUESTED (PLEASE CIRCLE) NORMAL RUSH (RUSH TAT IS SUBJECT TO PACE LABS APPROVAL AND SURCHARGE)	DATE RESULTS NEEDED	6 I understand that by initialing this box I give the lab permission to proceed with analysis, even though it may not meet all sample conformance requirements as defined in the receiving facility's Sample Acceptance Policy and the data will be qualified. Qualified data may NOT be acceptable to report to all regulatory authorities.
RUSH RESULTS VIA (PLEASE CIRCLE) EMAIL PHONE	PROCEED WITH ANALYSIS AND QUALIFY RESULTS: (INITIALS)	
EMAIL IF DIFFERENT FROM ABOVE: PHONE # IF DIFFERENT FROM ABOVE:		

7 RELINQUISHED BY: (SIGNATURE) 	DATE 1/3/24	RECEIVED BY: (SIGNATURE)	DATE 1-4-24	8 COMMENTS: (FOR LAB USE ONLY) SAMPLE TEMPERATURE UPON RECEIPT <u>20.0</u> °C CHILL PROCESS STARTED PRIOR TO RECEIPT Y OR N SAMPLE(S) RECEIVED ON ICE Y OR N SAMPLE ACCEPTANCE NONCONFORMANT REPORT IS NEEDED Y OR N DATE AND TIME TAKEN FROM SAMPLE BO
	TIME 15:00		TIME 1045	
	RELINQUISHED BY: (SIGNATURE) 	DATE 1-4-24	RECEIVED BY: (SIGNATURE)	
RELINQUISHED BY: (SIGNATURE) 	TIME 1600	RECEIVED BY: (SIGNATURE) 	TIME 1630	

REGULATORY PROGRAM (CIRCLE):	NPDES
MORBCA	RCRA
CCDD	TACO: RES OR IND/COMM

CHAIN OF CUSTODY RECORD
 STATE WHERE SAMPLE COLLECTED MO

ALL HIGHLIGHTED AREAS MUST BE COMPLETED BY CLIENT (PLEASE PRINT)

1 CLIENT SCI Engineering		PROJECT NUMBER 2016-0860.2T		PROJECT LOCATION Point Elem		PURCHASE ORDER #		3 ANALYSIS REQUESTED				4 (FOR LAB USE ONLY) LOGIN # <u>HA00541</u> LOGGED BY: <u>7/2/2</u> CLIENT: SCI Engineering PROJECT: Drinking Water Lead PROJ. MGR.: Chenise Lambert-Sykes CUSTODY SEAL #: _____	
ADDRESS 130 Point West Blvd		PHONE NUMBER (314) 581-7570		E-MAIL blieb@sciengineering.com		DATE SHIPPED		DW Pb Turb Check				REMARKS	
CITY STATE ZIP St. Charles, MO 63301		SAMPLER (PLEASE PRINT) Ethan Boyer		SAMPLER'S SIGNATURE 		MATRIX TYPES: WW- WASTEWATER DW- DRINKING WATER GW- GROUND WATER WWSL- SLUDGE NAB- NON AQUEOUS SOLID LCHT- LEACHATE OIL-OIL SO-SOIL SOL-SOLID							
CONTACT PERSON Brian Lieb		DATE COLLECTED		TIME COLLECTED		SAMPLE TYPE GRAB COMP		MATRIX TYPE		BOTTLE COUNT		PRES CODE CLIENT PROVIDED	
2 SAMPLE DESCRIPTION (UNIQUE DESCRIPTION AS IT WILL APPEAR ON THE ANALYTICAL REPORT)		PES-56		12/29/23 1929		X		DW		1 6		X X	
PES-57		12/29/23 1929		X		DW		1 6		X X			
PES-58		12/29/23 1932		X		DW		1 6		X X			
PES-59		12/29/23 1932		X		DW		1 6		X X			
PES-60		12/29/23 1934		X		DW		1 6		X X			
CHEMICAL PRESERVATION CODES: 1 - HCL 2 - H2SO4 3 - HNO3 4 - NAOH 5 - NA2S2O3 6 - UNPRESERVED 7 - OTHER													
5 TURNAROUND TIME REQUESTED (PLEASE CIRCLE) NORMAL RUSH (RUSH TAT IS SUBJECT TO PACE LABS APPROVAL AND SURCHARGE) RUSH RESULTS VIA (PLEASE CIRCLE) EMAIL PHONE EMAIL IF DIFFERENT FROM ABOVE: PHONE # IF DIFFERENT FROM ABOVE:				DATE RESULTS NEEDED		6 I understand that by initialing this box I give the lab permission to proceed with analysis, even though it may not meet all sample conformance requirements as defined in the receiving facility's Sample Acceptance Policy and the data will be qualified. Qualified data may NOT be acceptable to report to all regulatory authorities. PROCEED WITH ANALYSIS AND QUALIFY RESULTS: (INITIALS) _____							
7 RELINQUISHED BY: (SIGNATURE) 		DATE <u>12/24</u> TIME <u>15:00</u>		RECEIVED BY: (SIGNATURE) 				DATE <u>1-4-24</u> TIME <u>1045</u>		8 COMMENTS: (FOR LAB USE ONLY)			
RELINQUISHED BY: (SIGNATURE) 		DATE <u>1-4-24</u> TIME <u>1000</u>		RECEIVED BY: (SIGNATURE) 				DATE <u>1/4/24</u> TIME <u>1630</u>		SAMPLE TEMPERATURE UPON RECEIPT <u>20.0</u> °C CHILL PROCESS STARTED PRIOR TO RECEIPT Y OR N SAMPLE(S) RECEIVED ON ICE Y OR N SAMPLE ACCEPTANCE NONCONFORMANT REPORT IS NEEDED Y OR N DATE AND TIME TAKEN FROM SAMPLE BO			

REGULATORY PROGRAM (CIRCLE):	NPDES
MORBCA	RCRA
CCDD	TACO: RES OR IND/COMM

CHAIN OF CUSTODY RECORD
STATE WHERE SAMPLE COLLECTED MO

ALL HIGHLIGHTED AREAS MUST BE COMPLETED BY CLIENT (PLEASE PRINT)

1 CLIENT SCI Engineering	PROJECT NUMBER 2016-0860.2T	PROJECT LOCATION Point Elem	PURCHASE ORDER #	3 ANALYSIS REQUESTED	4 (FOR LAB USE ONLY)				
	ADDRESS 130 Point West Blvd	PHONE NUMBER (314) 581-7570	E-MAIL blieb@sciengineering.com		DATE SHIPPED	LOGIN # HA00541	LOGGED BY: 1/25/21	CLIENT: SCI Engineering	
	CITY St. Charles, MO 63301	SAMPLER (PLEASE PRINT) Ethan Boyer	MATRIX TYPES: WW- WASTEWATER DW- DRINKING WATER GW- GROUND WATER WWSL- SLUDGE NAS- NON AQUEOUS SOLID LCHL- LEACHATE OIL-OIL SO-SOIL SOL-SOLID			PROJECT: Drinking Water Lead	PROJ. MGR.: Chenise Lambert-Sykes	CUSTODY SEAL #:	
	CONTACT PERSON Brian Lieb	SAMPLER'S SIGNATURE 							
2 SAMPLE DESCRIPTION (UNIQUE DESCRIPTION AS IT WILL APPEAR ON THE ANALYTICAL REPORT)	DATE COLLECTED	TIME COLLECTED	SAMPLE TYPE GRAB COMP	MATRIX TYPE	BOTTLE COUNT	PRES CODE CLIENT PROVIDED	DW Pb	Turb Check	REMARKS
PES-1	12/29/23	1759	X	DW	1	6	X	X	
PES-2	12/29/23	1800	X	DW	1	6	X	X	
PES-3	12/29/23	1801	X	DW	1	6	X	X	
PES-4	12/29/23	1802	X	DW	1	6	X	X	
PES-5	12/29/23	1805	X	DW	1	6	X	X	
PES-6	12/29/23	1805	X	DW	1	6	X	X	
PES-7	12/29/23	1807	X	DW	1	6	X	X	
PES-8	12/29/23	1808	X	DW	1	6	X	X	
PES-9	12/29/23	1811	X	DW	1	6	X	X	
PES-10	12/29/23	1813	X	DW	1	6	X	X	
PES-11	12/29/23	1815	X	DW	1	6	X	X	
CHEMICAL PRESERVATION CODES:		1 - HCL	2 - H2SO4	3 - HNO3	4 - NAOH	5 - NA2S2O3	6 - UNPRESERVED	7 - OTHER	
5 TURNAROUND TIME REQUESTED (PLEASE CIRCLE) NORMAL RUSH (RUSH TAT IS SUBJECT TO PACE LABS APPROVAL AND SURCHARGE)	DATE RESULTS NEEDED		6 I understand that by initialing this box I give the lab permission to proceed with analysis, even though it may not meet all sample conformance requirements as defined in the receiving facility's Sample Acceptance Policy and the data will be qualified. Qualified data may NOT be acceptable to report to all regulatory authorities.						
RUSH RESULTS VIA (PLEASE CIRCLE) EMAIL PHONE	PROCEED WITH ANALYSIS AND QUALIFY RESULTS: (INITIALS)								
7 RELINQUISHED BY: (SIGNATURE) 	DATE 1/3/24	RECEIVED BY: (SIGNATURE) 	DATE 1-4-24	8 COMMENTS: (FOR LAB USE ONLY)					
RELINQUISHED BY: (SIGNATURE) 	DATE 1-4-24	RECEIVED BY: (SIGNATURE) 	DATE 1/4/24	SAMPLE TEMPERATURE UPON RECEIPT 20.0 °C					
RELINQUISHED BY: (SIGNATURE) 	DATE 1/7/21	RECEIVED BY: (SIGNATURE) 	DATE 1/7/21	CHILL PROCESS STARTED PRIOR TO RECEIPT Y OR N SAMPLE(S) RECEIVED ON ICE Y OR N SAMPLE ACCEPTANCE NONCONFORMANT REPORT IS NEEDED Y OR N					
	TIME 1700		TIME 1645	DATE AND TIME TAKEN FROM SAMPLE BO					
	TIME 1600		TIME 1630						

REGULATORY PROGRAM (CIRCLE):	NPDES
MORBCA	RCRA
CCDD	TACO: RES OR IND/COMM

CHAIN OF CUSTODY RECORD
 STATE WHERE SAMPLE COLLECTED MO

ALL HIGHLIGHTED AREAS MUST BE COMPLETED BY CLIENT (PLEASE PRINT)

1 CLIENT SCI Engineering ADDRESS 130 Point West Blvd CITY STATE ZIP St. Charles, MO 63301 CONTACT PERSON Brian Lieb		PROJECT NUMBER 2016-0860.2T PHONE NUMBER (314) 581-7570		PROJECT LOCATION Point Elem E-MAIL blieb@sciengineering.com		PURCHASE ORDER # DATE SHIPPED MATRIX TYPES: WW-WASTEWATER DW-DRINKING WATER GW-GROUND WATER WWSL-SLUDGE NAS-NON AQUEOUS SOLID LCHT-LEACHATE OIL-OIL SO-SOIL SOL-SOLID		3 ANALYSIS REQUESTED DW Pb Turb Check				4 (FOR LAB USE ONLY) LOGIN # HA00541 LOGGED BY: MSJ CLIENT: SCI Engineering PROJECT: Drinking Water Lead PROJ. MGR.: Chenise Lambert-Sykes CUSTODY SEAL #:	
2 SAMPLE DESCRIPTION (UNIQUE DESCRIPTION AS IT WILL APPEAR ON THE ANALYTICAL REPORT)		DATE COLLECTED	TIME COLLECTED	SAMPLE TYPE GRAB	COMP	MATRIX TYPE	BOTTLE COUNT	PRES CODE CLIENT PROVIDED	DW Pb	Turb Check	REMARKS		
PES-12		12/29/23	1816	X		DW	1	6	X	X			
PES-13		12/29/23	1817	X		DW	1	6	X	X			
PES-14		12/29/23	1818	X		DW	1	6	X	X			
PES-15		12/29/23	1820	X		DW	1	6	X	X			
PES-16		12/29/23	1822	X		DW	1	6	X	X			
PES-17		12/29/23	1825	X		DW	1	6	X	X			
PES-18		12/29/23	1827	X		DW	1	6	X	X			
PES-19		12/29/23	1830	X		DW	1	6	X	X			
PES-20		12/29/23	1832	X		DW	1	6	X	X			
PES-21		12/29/23	1834	X		DW	1	6	X	X			
PES-22		12/29/23	1835	X		DW	1	6	X	X			
CHEMICAL PRESERVATION CODES: 1-HCL 2-H2SO4 3-HNO3 4-NAOH 5-NA2S2O3 6-UNPRESERVED 7-OTHER													
5 TURNAROUND TIME REQUESTED (PLEASE CIRCLE) NORMAL RUSH (RUSH TAT IS SUBJECT TO PACE LABS APPROVAL AND SURCHARGE) RUSH RESULTS VIA (PLEASE CIRCLE) EMAIL PHONE EMAIL IF DIFFERENT FROM ABOVE: PHONE # IF DIFFERENT FROM ABOVE:				DATE RESULTS NEEDED		6 I understand that by initialing this box I give the lab permission to proceed with analysis, even though it may not meet all sample conformance requirements as defined in the receiving facility's Sample Acceptance Policy and the data will be qualified. Qualified data may NOT be acceptable to report to all regulatory authorities. PROCEED WITH ANALYSIS AND QUALIFY RESULTS: (INITIALS)							
7 RELINQUISHED BY: (SIGNATURE) 		DATE 1/31/24 TIME 1500		RECEIVED BY: (SIGNATURE) 		DATE 1-4-24 TIME		8 COMMENTS: (FOR LAB USE ONLY) SAMPLE TEMPERATURE UPON RECEIPT 20.0 °C CHILL PROCESS STARTED PRIOR TO RECEIPT Y OR N SAMPLE(S) RECEIVED ON ICE Y OR N SAMPLE ACCEPTANCE NONCONFORMANT REPORT IS NEEDED Y OR N DATE AND TIME TAKEN FROM SAMPLE BO					
RELINQUISHED BY: (SIGNATURE) 		DATE 1-4-24 TIME 1600		RECEIVED BY: (SIGNATURE) 		DATE 1/4/21 TIME 1630							
RELINQUISHED BY: (SIGNATURE) 		DATE TIME		RECEIVED BY: (SIGNATURE) 		DATE TIME							

REGULATORY PROGRAM (CIRCLE):	NPDES
MORBCA	RCRA
CCDD	TACO: RES OR IND/COMM

CHAIN OF CUSTODY RECORD
 STATE WHERE SAMPLE COLLECTED MO

ALL HIGHLIGHTED AREAS MUST BE COMPLETED BY CLIENT (PLEASE PRINT)

1 CLIENT SCI Engineering	PROJECT NUMBER 2016-0860.2T	PROJECT LOCATION Point Elem	PURCHASE ORDER #	3 ANALYSIS REQUESTED	4 (FOR LAB USE ONLY) LOGIN # <u>HA00541</u> LOGGED BY: <u>TASL</u> CLIENT: SCI Engineering PROJECT: <u>Drinking Water Lead</u> PROJ. MGR.: <u>Chenise Lambert-Sykes</u> CUSTODY SEAL #:
ADDRESS 130 Point West Blvd	PHONE NUMBER (314) 581-7570	E-MAIL blieb@sciengineering.com	DATE SHIPPED	<input checked="" type="checkbox"/> DW Pb <input checked="" type="checkbox"/> Turb Check	
CITY STATE ZIP St. Charles, MO 63301	SAMPLER (PLEASE PRINT) Ethan Boyer	MATRIX TYPES: WW- WASTEWATER DW- DRINKING WATER GW- GROUND WATER WWSL- SLUDGE NAB- NON AQUEOUS SOLID LCHT-LEACHATE OIL-OIL SO-SOIL SOL-SOLID			
CONTACT PERSON Brian Lieb	SAMPLER'S SIGNATURE 				

2 SAMPLE DESCRIPTION (UNIQUE DESCRIPTION AS IT WILL APPEAR ON THE ANALYTICAL REPORT)	DATE COLLECTED	TIME COLLECTED	SAMPLE TYPE		MATRIX TYPE	BOTTLE COUNT	PRES CODE CLIENT PROVIDED	DW Pb	Turb Check									REMARKS
			GRAB	COMP														
PES-23	12/29/23	1836	X		DW	1	6	X	X									
PES-24	12/29/23	1838	X		DW	1	6	X	X									
PES-25	12/29/23	1839	X		DW	1	6	X	X									
PES-26	12/29/23	1840	X		DW	1	6	X	X									
PES-27	12/29/23	1842	X		DW	1	6	X	X									
PES-28	12/29/23	1842	X		DW	1	6	X	X									
PES-29	12/29/23	1847	X		DW	1	6	X	X									
PES-30	12/29/23	1849	X		DW	1	6	X	X									
PES-31	12/29/23	1850	X		DW	1	6	X	X									
PES-32	12/29/23	1852	X		DW	1	6	X	X									
PES-33	12/29/23	1853	X		DW	1	6	X	X									

CHEMICAL PRESERVATION CODES: 1 - HCL 2 - H2SO4 3 - HNO3 4 - NAOH 5 - NA2S2O3 6 - UNPRESERVED 7 - OTHER

5 TURNAROUND TIME REQUESTED (PLEASE CIRCLE) NORMAL RUSH (RUSH TAT IS SUBJECT TO PACE LABS APPROVAL AND SURCHARGE)	DATE RESULTS NEEDED	6 I understand that by initialing this box I give the lab permission to proceed with analysis, even though it may not meet all sample conformance requirements as defined in the receiving facility's Sample Acceptance Policy and the data will be qualified. Qualified data may NOT be acceptable to report to all regulatory authorities.
RUSH RESULTS VIA (PLEASE CIRCLE) EMAIL PHONE		PROCEED WITH ANALYSIS AND QUALIFY RESULTS: (INITIALS) _____
EMAIL IF DIFFERENT FROM ABOVE: PHONE # IF DIFFERENT FROM ABOVE:		

7 RELINQUISHED BY: (SIGNATURE) 	DATE <u>1/3/24</u> TIME <u>15:00</u>	RECEIVED BY: (SIGNATURE) 	DATE <u>1-4-24</u> TIME <u>1045</u>	8 COMMENTS: (FOR LAB USE ONLY)
RELINQUISHED BY: (SIGNATURE) 	DATE <u>1-4-24</u> TIME <u>1600</u>	RECEIVED BY: (SIGNATURE)	DATE	SAMPLE TEMPERATURE UPON RECEIPT <u>20.0</u> °C
RELINQUISHED BY: (SIGNATURE)	DATE	RECEIVED BY: (SIGNATURE) 	DATE <u>1/4/24</u> TIME <u>1630</u>	CHILL PROCESS STARTED PRIOR TO RECEIPT SAMPLE(S) RECEIVED ON ICE Y OR N SAMPLE ACCEPTANCE NONCONFORMANT REPORT IS NEEDED Y OR N
				DATE AND TIME TAKEN FROM SAMPLE BO

REGULATORY PROGRAM (CIRCLE):	NPDES
MORBCA	RCRA
CCDD	TACO: RES OR IND/COMM

ALL HIGHLIGHTED AREAS MUST BE COMPLETED BY CLIENT (PLEASE PRINT)

1 CLIENT SCI Engineering	PROJECT NUMBER 2016-0860.2T	PROJECT LOCATION Point Elem	PURCHASE ORDER #	3 ANALYSIS REQUESTED	4 (FOR LAB USE ONLY)
ADDRESS 130 Point West Blvd	PHONE NUMBER (314) 581-7570	E-MAIL blieb@sciengineering.com	DATE SHIPPED	<input checked="" type="checkbox"/> DW Pb <input checked="" type="checkbox"/> Turb Check	LOGIN # <u>HA00541</u>
CITY STATE ZIP St. Charles, MO 63301	SAMPLER (PLEASE PRINT) Ethan Boyer	MATRIX TYPES: WW-WASTEWATER DW-DRINKING WATER GW-GROUND WATER WWSL-SLUDGE NAS-NON AQUEOUS SOLID LCHT-LEACHATE OIL-OIL SO-SOIL SOL-SOLID			LOGGED BY: <u>MBL</u>
CONTACT PERSON Brian Lieb	SAMPLER'S SIGNATURE 				CLIENT: SCI Engineering
					PROJECT: Drinking Water Lead
					PROJ. MGR.: Chenise Lambert-Sykes
					CUSTODY SEAL #:

2 SAMPLE DESCRIPTION (UNIQUE DESCRIPTION AS IT WILL APPEAR ON THE ANALYTICAL REPORT)	DATE COLLECTED	TIME COLLECTED	SAMPLE TYPE		MATRIX TYPE	BOTTLE COUNT	PRES CODE CLIENT PROVIDED	DW Pb	Turb Check											REMARKS
			GRAB	COMP																
PES-34	12/29/23	1853	X		DW	1	6	X	X											
PES-35	12/29/23	1856	X		DW	1	6	X	X											
PES-36	12/29/23	1856	X		DW	1	6	X	X											
PES-37	12/29/23	1902	X		DW	1	6	X	X											
PES-38	12/29/23	1902	X		DW	1	6	X	X											
PES-39	12/29/23	1905	X		DW	1	6	X	X											
PES-40	12/29/23	1905	X		DW	1	6	X	X											
PES-41	12/29/23	1907	X		DW	1	6	X	X											
PES-42	12/29/23	1909	X		DW	1	6	X	X											
PES-43	12/29/23	1910	X		DW	1	6	X	X											
PES-44	12/29/23	1913	X		DW	1	6	X	X											

CHEMICAL PRESERVATION CODES: 1-HCL 2-H2SO4 3-HNO3 4-NAOH 5-NA2S2O3 6-UNPRESERVED 7-OTHER

5 TURNAROUND TIME REQUESTED (PLEASE CIRCLE) NORMAL RUSH (RUSH TAT IS SUBJECT TO PACE LABS APPROVAL AND SURCHARGE)	DATE RESULTS NEEDED	6 I understand that by initialing this box I give the lab permission to proceed with analysis, even though it may not meet all sample conformance requirements as defined in the receiving facility's Sample Acceptance Policy and the data will be qualified. Qualified data may NOT be acceptable to report to all regulatory authorities.
RUSH RESULTS VIA (PLEASE CIRCLE) EMAIL PHONE		PROCEED WITH ANALYSIS AND QUALIFY RESULTS: (INITIALS)
EMAIL IF DIFFERENT FROM ABOVE: PHONE # IF DIFFERENT FROM ABOVE:		

7 RELINQUISHED BY: (SIGNATURE) 	DATE <u>1/3/24</u> TIME <u>15:00</u>	RECEIVED BY: (SIGNATURE) 	DATE <u>1-4-24</u> TIME <u>16:45</u>	8 COMMENTS: (FOR LAB USE ONLY)
RELINQUISHED BY: (SIGNATURE) 	DATE <u>1-4-24</u> TIME <u>1600</u>	RECEIVED BY: (SIGNATURE)	DATE	SAMPLE TEMPERATURE UPON RECEIPT <u>20.0</u> °C
RELINQUISHED BY: (SIGNATURE)	DATE	RECEIVED BY: (SIGNATURE) 	DATE <u>1/4/24</u> TIME <u>1630</u>	CHILL PROCESS STARTED PRIOR TO RECEIPT Y OR N SAMPLE(S) RECEIVED ON ICE Y OR N SAMPLE ACCEPTANCE NONCONFORMANT REPORT IS NEEDED Y OR N
				DATE AND TIME TAKEN FROM SAMPLE BC

REGULATORY PROGRAM (CIRCLE):	NPDES
MORBCA	RCRA
CCDD	TACO: RES OR IND/COMM

ALL HIGHLIGHTED AREAS MUST BE COMPLETED BY CLIENT (PLEASE PRINT)

1 CLIENT SCI Engineering ADDRESS 130 Point West Blvd CITY STATE ZIP St. Charles, MO 63301 CONTACT PERSON Brian Lieb	PROJECT NUMBER 2016-0860.2T	PROJECT LOCATION Point Elem	PURCHASE ORDER #	3 ANALYSIS REQUESTED + + DW Pb Turb Check	4 (FOR LAB USE ONLY) LOGIN # <u>H1A00541</u> LOGGED BY: <u>JDL</u> CLIENT: SCI Engineering PROJECT: Drinking Water Lead PROJ. MGR.: Chenise Lambert-Sykes CUSTODY SEAL #:
	PHONE NUMBER (314) 581-7570	E-MAIL blieb@sciengineering.com	DATE SHIPPED		
	SAMPLER (PLEASE PRINT) Ethan Boyer	MATRIX TYPES: WW- WASTEWATER DW- DRINKING WATER GW- GROUND WATER WWSL- SLUDGE NAS- NON AQUEOUS SOLID LCHT- LEACHATE OIL- OIL SO- SOL SOL- SOLID			
	SAMPLER'S SIGNATURE 				

2 SAMPLE DESCRIPTION (UNIQUE DESCRIPTION AS IT WILL APPEAR ON THE ANALYTICAL REPORT)	DATE COLLECTED	TIME COLLECTED	SAMPLE TYPE		MATRIX TYPE	BOTTLE COUNT	PRES CODE CLIENT PROVIDED	DW Pb	Turb Check											REMARKS		
			GRAB	COMP																		
PES-45	12/29/23	1913	X		DW	1	6	X	X													
PES-46	12/29/23	1916	X		DW	1	6	X	X													
PES-47	12/29/23	1917	X		DW	1	6	X	X													
PES-48	12/29/23	1919	X		DW	1	6	X	X													
PES-49	12/29/23	1919	X		DW	1	6	X	X													
PES-50	12/29/23	1921	X		DW	1	6	X	X													
PES-51	12/29/23	1921	X		DW	1	6	X	X													
PES-52	12/29/23	1924	X		DW	1	6	X	X													
PES-53	12/29/23	1924	X		DW	1	6	X	X													
PES-54	12/29/23	1927	X		DW	1	6	X	X													
PES-55	12/29/23	1927	X		DW	1	6	X	X													

CHEMICAL PRESERVATION CODES: 1 - HCL 2 - H2SO4 3 - HNO3 4 - NAOH 5 - NA2S2O3 6 - UNPRESERVED 7 - OTHER

5 TURNAROUND TIME REQUESTED (PLEASE CIRCLE) NORMAL RUSH
 (RUSH TAT IS SUBJECT TO PACE LABS APPROVAL AND SURCHARGE)
 RUSH RESULTS VIA (PLEASE CIRCLE) EMAIL PHONE
 EMAIL IF DIFFERENT FROM ABOVE: PHONE # IF DIFFERENT FROM ABOVE:
 6 I understand that by initialing this box I give the lab permission to proceed with analysis, even though it may not meet all sample conformance requirements as defined in the receiving facility's Sample Acceptance Policy and the data will be qualified. Qualified data may NOT be acceptable to report to all regulatory authorities.
 PROCEED WITH ANALYSIS AND QUALIFY RESULTS: (INITIALS)

7 RELINQUISHED BY: (SIGNATURE) 	DATE 1/3/24	RECEIVED BY: (SIGNATURE) 	DATE 1-4-24	8 COMMENTS: (FOR LAB USE ONLY) SAMPLE TEMPERATURE UPON RECEIPT <u>20.0</u> °C CHILL PROCESS STARTED PRIOR TO RECEIPT Y OR N SAMPLE(S) RECEIVED ON ICE Y OR N SAMPLE ACCEPTANCE NONCONFORMANT REPORT IS NEEDED Y OR N DATE AND TIME TAKEN FROM SAMPLE BO
	TIME 15:00		TIME 1045	
	RELINQUISHED BY: (SIGNATURE) 		DATE 1-4-24	
RELINQUISHED BY: (SIGNATURE) 	TIME 1600	RECEIVED BY: (SIGNATURE) 	TIME 1630	

REGULATORY PROGRAM (CIRCLE):	NPDES
MORBCA	RCRA
CCDD	TACO: RES OR IND/COMM

CHAIN OF CUSTODY RECORD
 STATE WHERE SAMPLE COLLECTED MO

ALL HIGHLIGHTED AREAS MUST BE COMPLETED BY CLIENT (PLEASE PRINT)

1 CLIENT SCI Engineering	PROJECT NUMBER 2016-0860.2T	PROJECT LOCATION Point Elem	PURCHASE ORDER #	3 ANALYSIS REQUESTED	4 (FOR LAB USE ONLY) LOGIN # <u>HA00541</u> LOGGED BY: <u>7/22</u> CLIENT: SCI Engineering PROJECT: Drinking Water Lead PROJ. MGR.: Chenise Lambert-Sykes CUSTODY SEAL #:					
	ADDRESS 130 Point West Blvd	PHONE NUMBER (314) 581-7570	E-MAIL blieb@sciengineering.com			DATE SHIPPED				
CITY STATE ZIP St. Charles, MO 63301	SAMPLER (PLEASE PRINT) Ethan Boyer	MATRIX TYPES: WW- WASTEWATER DW- DRINKING WATER GW- GROUND WATER WWSL- SLUDGE NAS- NON AQUEOUS SOLID LCHT- LEACHATE OIL-OIL SO-SOIL SOL-SOLID		DW Pb Turb Check	REMARKS					
CONTACT PERSON Brian Lieb	SAMPLER'S SIGNATURE 									
2 SAMPLE DESCRIPTION (UNIQUE DESCRIPTION AS IT WILL APPEAR ON THE ANALYTICAL REPORT)	DATE COLLECTED	TIME COLLECTED	SAMPLE TYPE GRAB COMP	MATRIX TYPE	BOTTLE COUNT	PRES CODE CLIENT PROVIDED	DW Pb	Turb Check		
PES-56	12/29/23	1929	X	DW	1	6	X	X		
PES-57	12/29/23	1929	X	DW	1	6	X	X		
PES-58	12/29/23	1932	X	DW	1	6	X	X		
PES-59	12/29/23	1932	X	DW	1	6	X	X		
PES-60	12/29/23	1934	X	DW	1	6	X	X		
CHEMICAL PRESERVATION CODES: 1-HCL 2-H2SO4 3-HNO3 4-NAOH 5-NA2S2O3 6-UNPRESERVED 7-OTHER										
5 TURNAROUND TIME REQUESTED (PLEASE CIRCLE) NORMAL RUSH (RUSH TAT IS SUBJECT TO PACE LABS APPROVAL AND SURCHARGE)	DATE RESULTS NEEDED		6 I understand that by initialing this box I give the lab permission to proceed with analysis, even though it may not meet all sample conformance requirements as defined in the receiving facility's Sample Acceptance Policy and the data will be qualified. Qualified data may NOT be acceptable to report to all regulatory authorities.							
RUSH RESULTS VIA (PLEASE CIRCLE) EMAIL PHONE	PROCEED WITH ANALYSIS AND QUALIFY RESULTS: (INITIALS)									
7 RELINQUISHED BY: (SIGNATURE) 	DATE 4/3/24	TIME 15:00	RECEIVED BY: (SIGNATURE) 		DATE 1-4-24	TIME 1045	8 COMMENTS: (FOR LAB USE ONLY)			
RELINQUISHED BY: (SIGNATURE) 	DATE 1-4-24	TIME 1000	RECEIVED BY: (SIGNATURE) 		DATE	TIME	SAMPLE TEMPERATURE UPON RECEIPT <u>20.0</u> °C			
RELINQUISHED BY: (SIGNATURE) 	DATE	TIME	RECEIVED BY: (SIGNATURE) 		DATE 1/4/24	TIME 1630	CHILL PROCESS STARTED PRIOR TO RECEIPT Y OR N SAMPLE(S) RECEIVED ON ICE Y OR N SAMPLE ACCEPTANCE NONCONFORMANT REPORT IS NEEDED Y OR N DATE AND TIME TAKEN FROM SAMPLE BO			