



SCI ENGINEERING, INC.

EARTH • SCIENCE • SOLUTIONS

GEOTECHNICAL
ENVIRONMENTAL
NATURAL RESOURCES
CULTURAL RESOURCES
CONSTRUCTION SERVICES

April 2, 2024

Michael Gegg
Mehlville School District
3120 Lemay Ferry Road
St. Louis, Missouri 63125

RE: Lead in Drinking Water Report
Oakville Middle School
5950 Telegraph Road
St. Louis, Missouri
SCI No. 2016-0860.2T

Dear Michael Gegg:

INTRODUCTION

SCI Engineering, Inc. (SCI) is pleased to submit this report summarizing lead in drinking water sampling activities performed on January 2, 2024. The purpose of the sampling activities was to screen for elevated levels of lead in the drinking water at potable water sources throughout the above-referenced structure.

The drinking water survey is intended to satisfy the requirements for the “Get the Lead Out of School Drinking Water Act” (GTLOSDWA), Section 160.077 administered by the Missouri Department of Health and Senior Services. Potable water sources to be tested were identified by the school district prior to SCI’s field activities.

LIMITATIONS

SCI’s sampling activities were limited to locations identified by the school district. If any additional potable water sources need testing, please contact SCI, and we will make arrangements for sampling these fixtures. Potable water sources that were not sampled will need a sign placed near each fixture informing students and faculty it is not to be used as a drinking water source.

During the course of performing the drinking water sampling of the structure, SCI was unable to sample two fixtures because they were out of order. These fixtures included the sink in the kitchen serving area and the left water fountain outside Room 302. If these fixtures are made operational, they should be sampled or labeled non-potable. SCI was able to sample all other locations identified by the school district.

DRINKING WATER SURVEY

SCI collected “first draw” samples which consisted of collecting a water sample from each fixture or sample location after it remained stagnant for at least eight hours. Prior to sampling, SCI first mobilized

to the site to flush the identified potable water fixtures throughout the structure. Once each fixture was flushed, a sign was placed on the fixture indicating it should not be used. SCI then revisited the site, after a minimum of eight hours, to collect water samples from the fixtures.

SCI collected 35 drinking water samples (OMS-1 through OMS-35) from various water fixtures located throughout the structure and submitted them for analytical testing. The drinking water samples were analyzed for total lead by U.S. EPA Method 200.8. SCI collected a minimum of 250 milliliters of water from each location. Sampled water was containerized in laboratory-provided sample containers and shipped to the lab using standard chain-of-custody procedures. Figures depicting the locations of the sampled water fixtures are enclosed.

The drinking water samples were analyzed for lead in accordance with the GTLOSDWA, Section 160.077, which establishes an action level (AL) of 5 parts per billion (ppb). The drinking water samples which exceeded the AL are identified in Table 1, below. A copy of the analytical test results and chain-of-custody for all samples is enclosed.

Table 1 – Lead in Drinking Water Results

| Sample Number | Sample Location | Sample Description | Result (ppb) |
|---------------|---------------------|---------------------------------|--------------|
| OMS-3 | Kitchen | Triple Basin Sink, Right Faucet | 22.1 |
| OMS-16 | Room 103 | Sink 1 | 6.14 |
| OMS-19 | Hallway by Room 101 | Water Fountain | 16.7 |
| OMS-20 | Room 102 | Sink | 193 |
| OMS-22 | Library | Sink | 34.5 |
| OMS-24 | Room 113 | Right Sink | 958 |
| OMS-32 | Science Office | Sink | 20.6 |
| OMS-35 | Hallway by Room 201 | Right Fountain | 7.96 |

CONCLUSION AND RECOMMENDATIONS

As can be seen in Table 1, above, eight drinking water samples exceeded the AL. SCI recommends any fixture which exceeds the AL be taken out of service until remediated and follow up testing indicates results less than the AL. Alternatively, if a water fixture is determined not to be a potable drinking water source, signage may be installed indicating the purpose and/or restrictions of the fixture.

According to GTLOSDWA, any water fixtures which exceed the AL shall be remediated prior to August 1, 2024, or the first day on which students will be present in the building, whichever is later. Any replacement fixture shall be lead free, as defined in 40 CFR 143.12.

REPORTING

Within seven business days after receiving this report, the school district shall contact parents and staff via written notification which shall include the following:

- The test results and a summary that explains such results;

- A description of any remedial steps taken;
- A description of general health effects of lead contamination and community specific resources; and
- If there is not enough water to meet the drinking water needs of the students, teachers and staff, bottled water shall be provided.

Additionally, within two weeks of receiving this report, the results and any lead remediation plans must be made available on the school's website.

This report, and subsequent annual testing reports, must be submitted to the Missouri Department of Health and Senior Services, Healthy Drinking Water Unit, PO Box 570, Jefferson City, MO 65102-0570.


FUTURE TESTING

After the fixtures identified in Table 1, above, have been remediated, at least 25 percent of the remediated fixtures must be sampled annually until all remediated sources have been tested. However, SCI recommends all fixtures be tested once they have been remediated. Once all fixtures have been tested and are below the action level, the school shall test the potable drinking water fixtures once every five years.

SCI appreciates the opportunity to be of service to you on this project, and we look forward to working with you in the future. Please contact us if you have any questions or comments regarding the information provided.

Respectfully,

SCI ENGINEERING, INC.



Brian L. Lieb
Project Scientist



Jessica B. Keeven, CHMM
Senior Scientist

BLL/JBK/rah

Enclosure

Lead Drinking Water Sampling Plan
Lead Testing Results




GENERAL NOTES/LEGEND

- RESULTS GREATER THAN THE ACTION LEVEL OF 5 PARTS PER BILLION
- RESULTS LESS THAN THE ACTION LEVEL OF 5 PARTS PER BILLION

FLOOR PLANS PROVIDED BY MEHLVILLE SCHOOL DISTRICT. DIMENSIONS AND LOCATIONS ARE APPROXIMATE; ACTUAL MAY VARY. DRAWING SHALL NOT BE USED OUTSIDE THE CONTEXT OF THE REPORT FOR WHICH IT WAS GENERATED.

PROJECT NAME
MEHLVILLE SCHOOL DISTRICT
OAKVILLE MIDDLE SCHOOL - 1ST FLOOR
ST. LOUIS, MISSOURI

LEAD DRINKING WATER SAMPLING PLAN





JOB NUMBER
2016-0860.2T

FIGURE DATE
02/27/2024

DRAWN BY
JTM

CHECKED BY
BLL

FIGURE
1

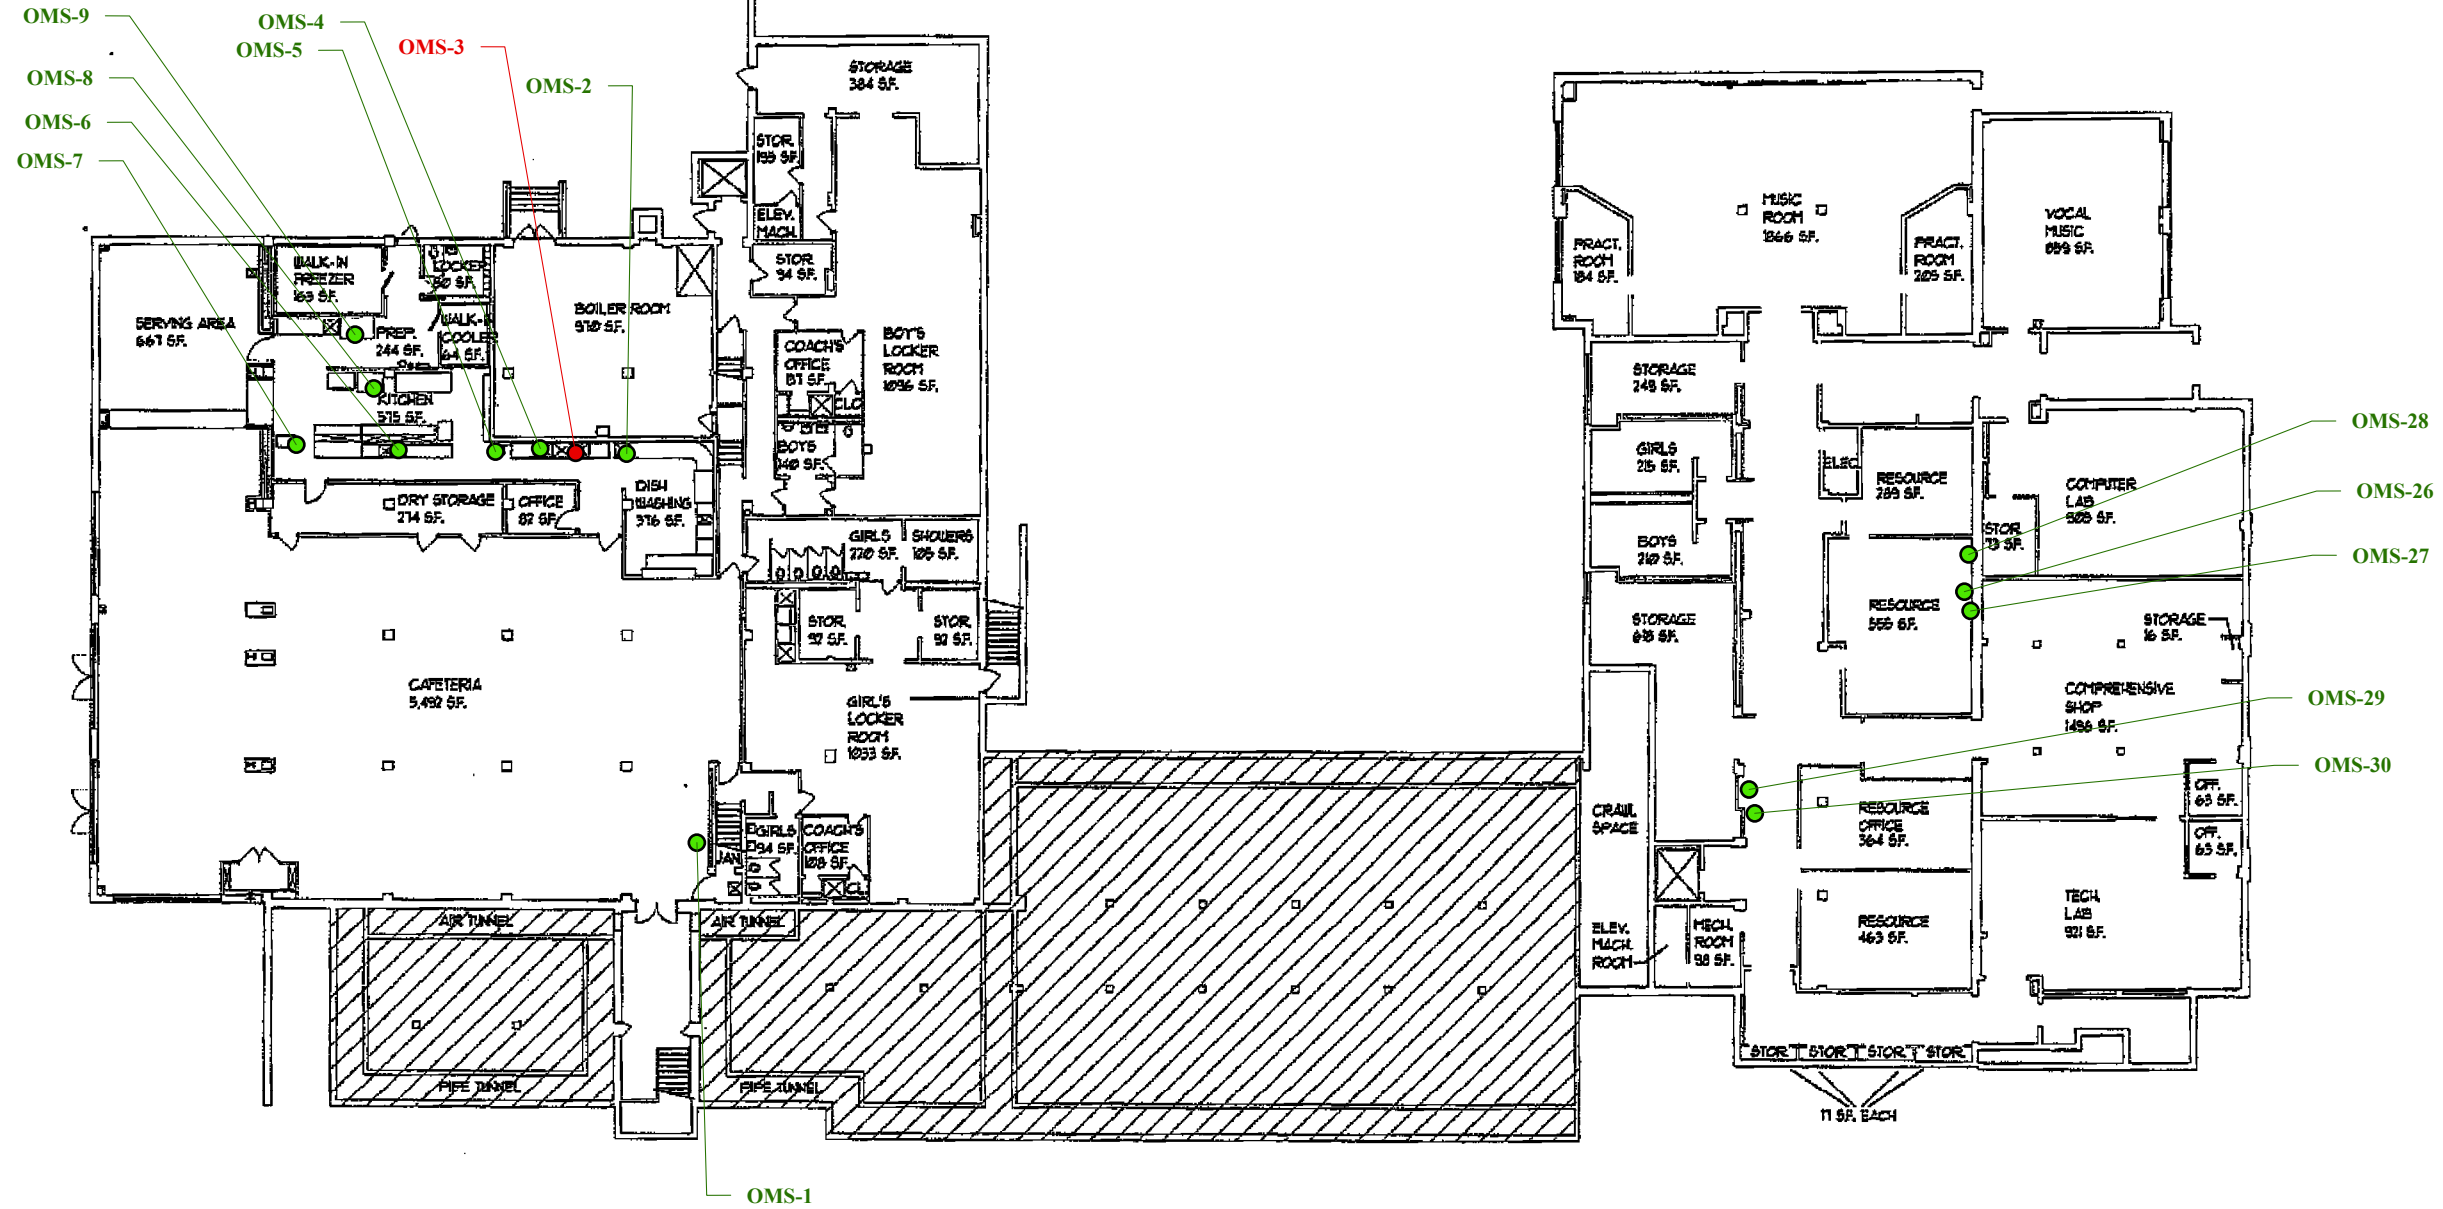




GENERAL NOTES/LEGEND

- RESULTS GREATER THAN THE ACTION LEVEL OF 5 PARTS PER BILLION
- RESULTS LESS THAN THE ACTION LEVEL OF 5 PARTS PER BILLION

FLOOR PLANS PROVIDED BY MEHLVILLE SCHOOL DISTRICT. DIMENSIONS AND LOCATIONS ARE APPROXIMATE; ACTUAL MAY VARY. DRAWING SHALL NOT BE USED OUTSIDE THE CONTEXT OF THE REPORT FOR WHICH IT WAS GENERATED.

PROJECT NAME
MEHLVILLE SCHOOL DISTRICT
OAKVILLE MIDDLE SCHOOL - 2ND FLOOR
ST. LOUIS, MISSOURI

LEAD DRINKING WATER SAMPLING PLAN





JOB NUMBER
2016-0860.2T

FIGURE DATE
02/27/2024

DRAWN BY
JTM

CHECKED BY
BLL

FIGURE
2

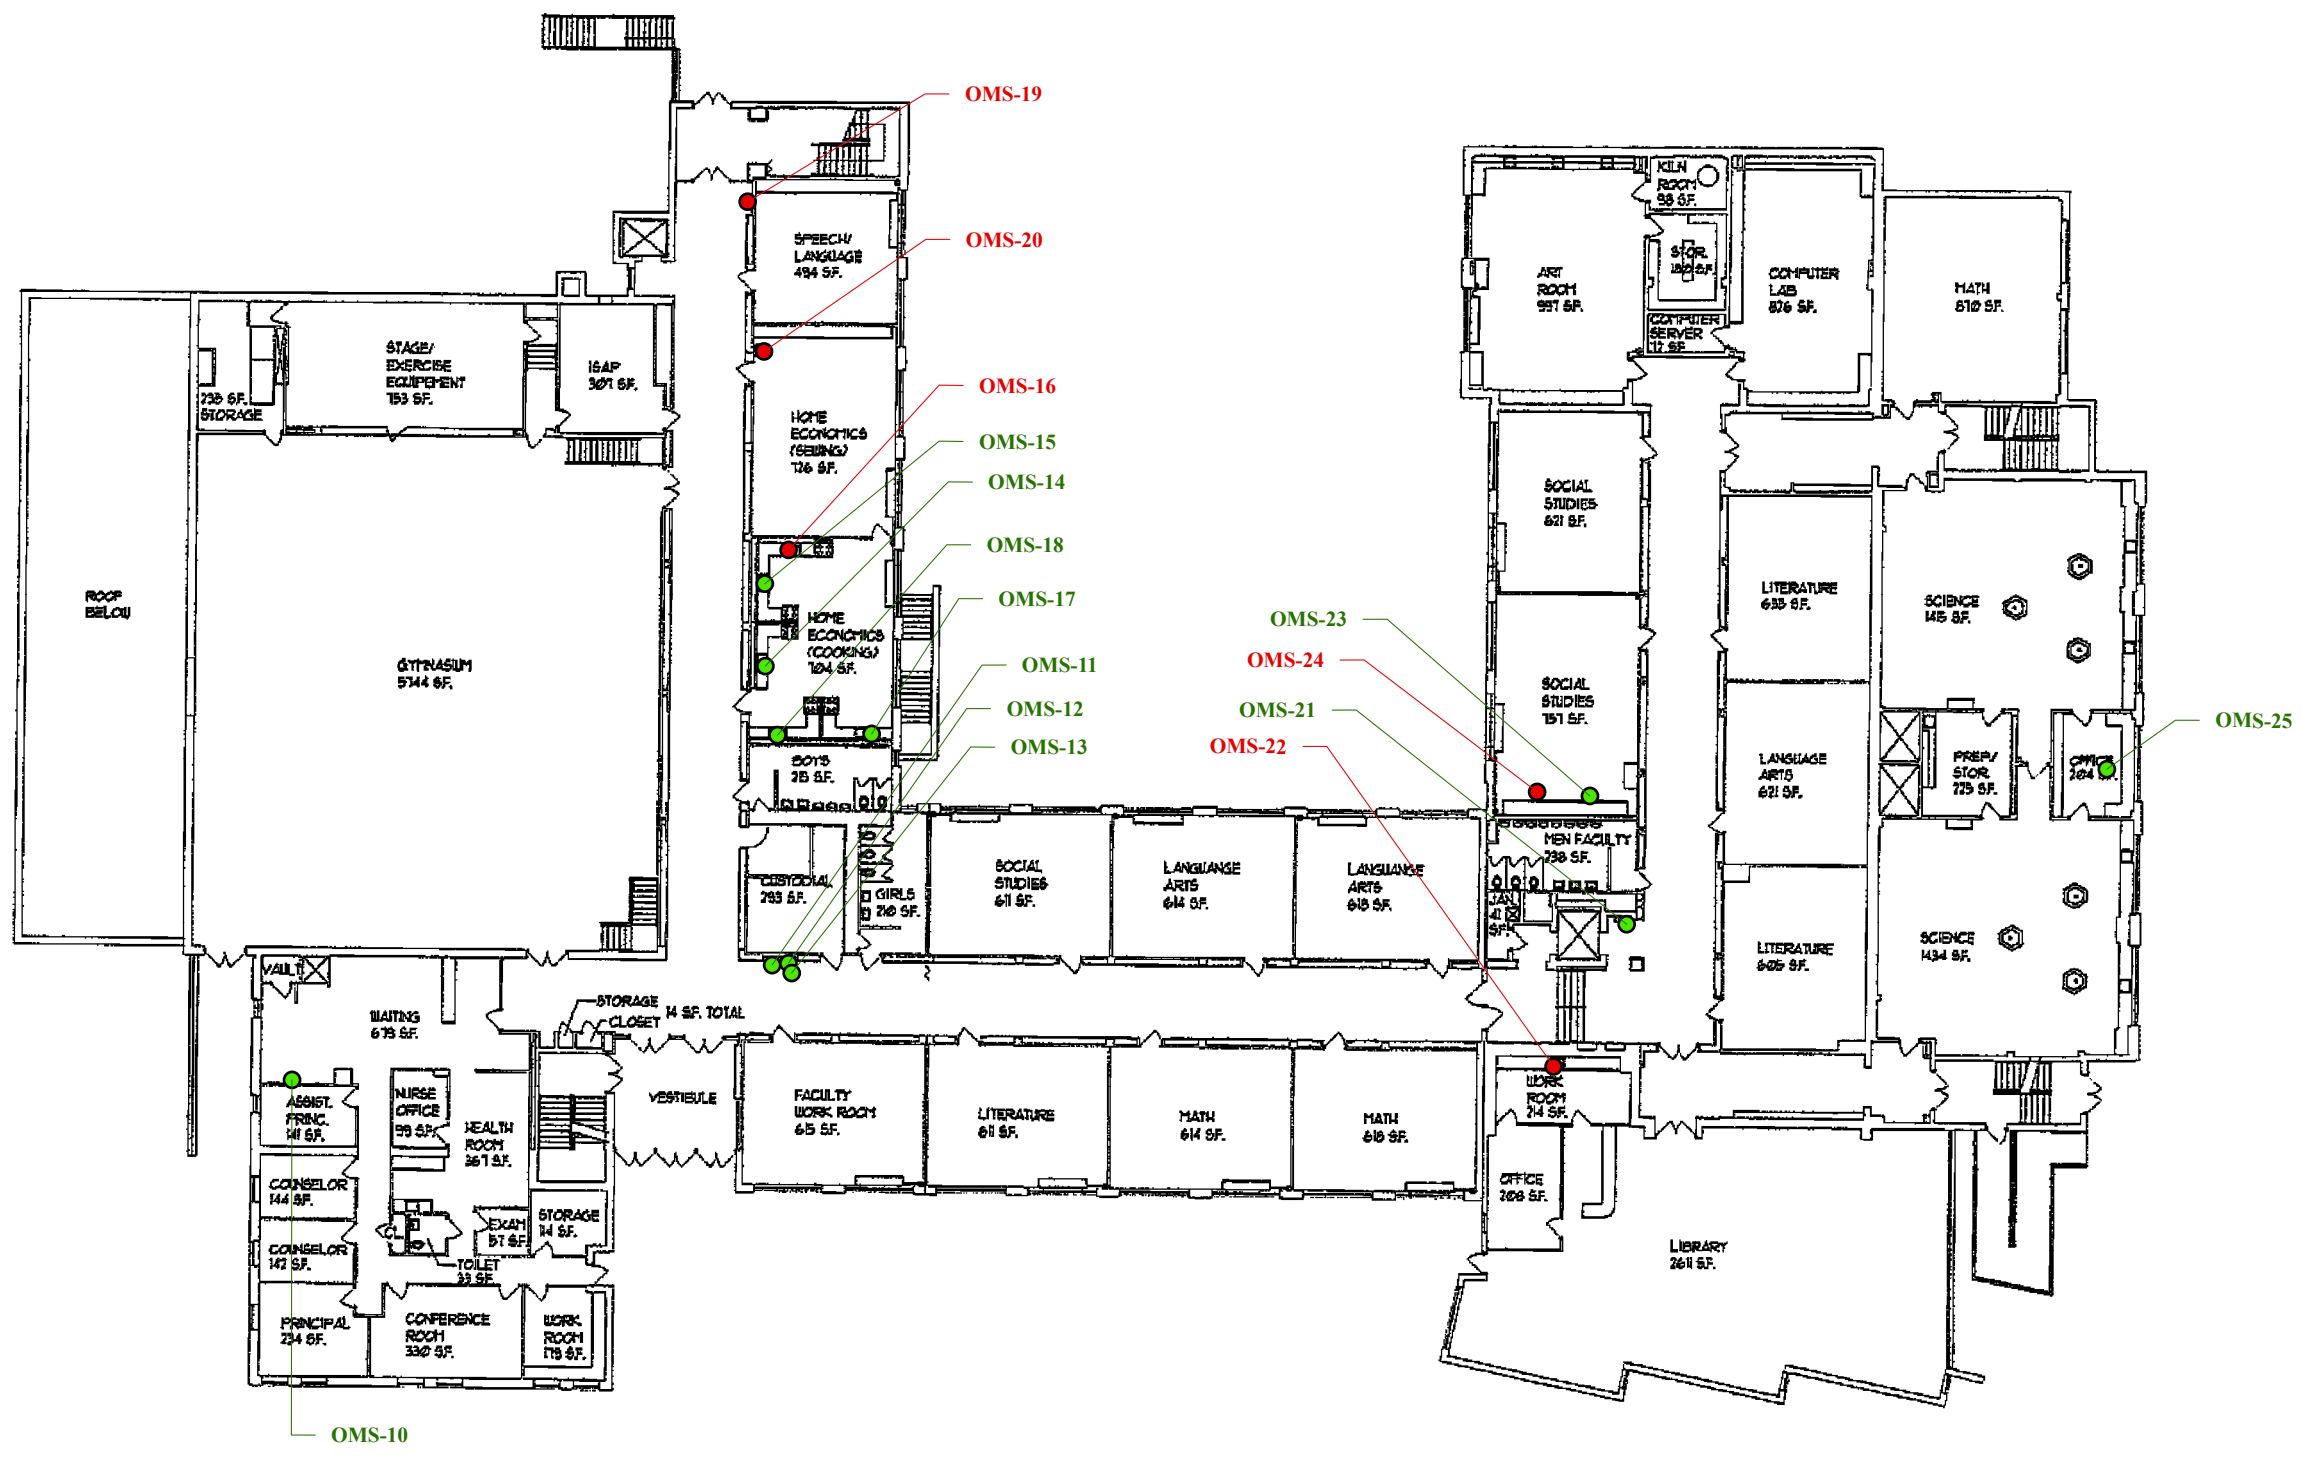




GENERAL NOTES/LEGEND

- RESULTS GREATER THAN THE ACTION LEVEL OF 5 PARTS PER BILLION
- RESULTS LESS THAN THE ACTION LEVEL OF 5 PARTS PER BILLION

FLOOR PLANS PROVIDED BY MEHLVILLE SCHOOL DISTRICT.
DIMENSIONS AND LOCATIONS ARE APPROXIMATE; ACTUAL MAY VARY. DRAWING SHALL NOT BE USED OUTSIDE THE CONTEXT OF THE REPORT FOR WHICH IT WAS GENERATED.

PROJECT NAME
MEHLVILLE SCHOOL DISTRICT
OAKVILLE MIDDLE SCHOOL - 3RD FLOOR
ST. LOUIS, MISSOURI

LEAD DRINKING WATER SAMPLING PLAN





JOB NUMBER
2016-0860.2T

FIGURE DATE
02/27/2024

DRAWN BY
JTM

CHECKED BY
BLL

FIGURE
3

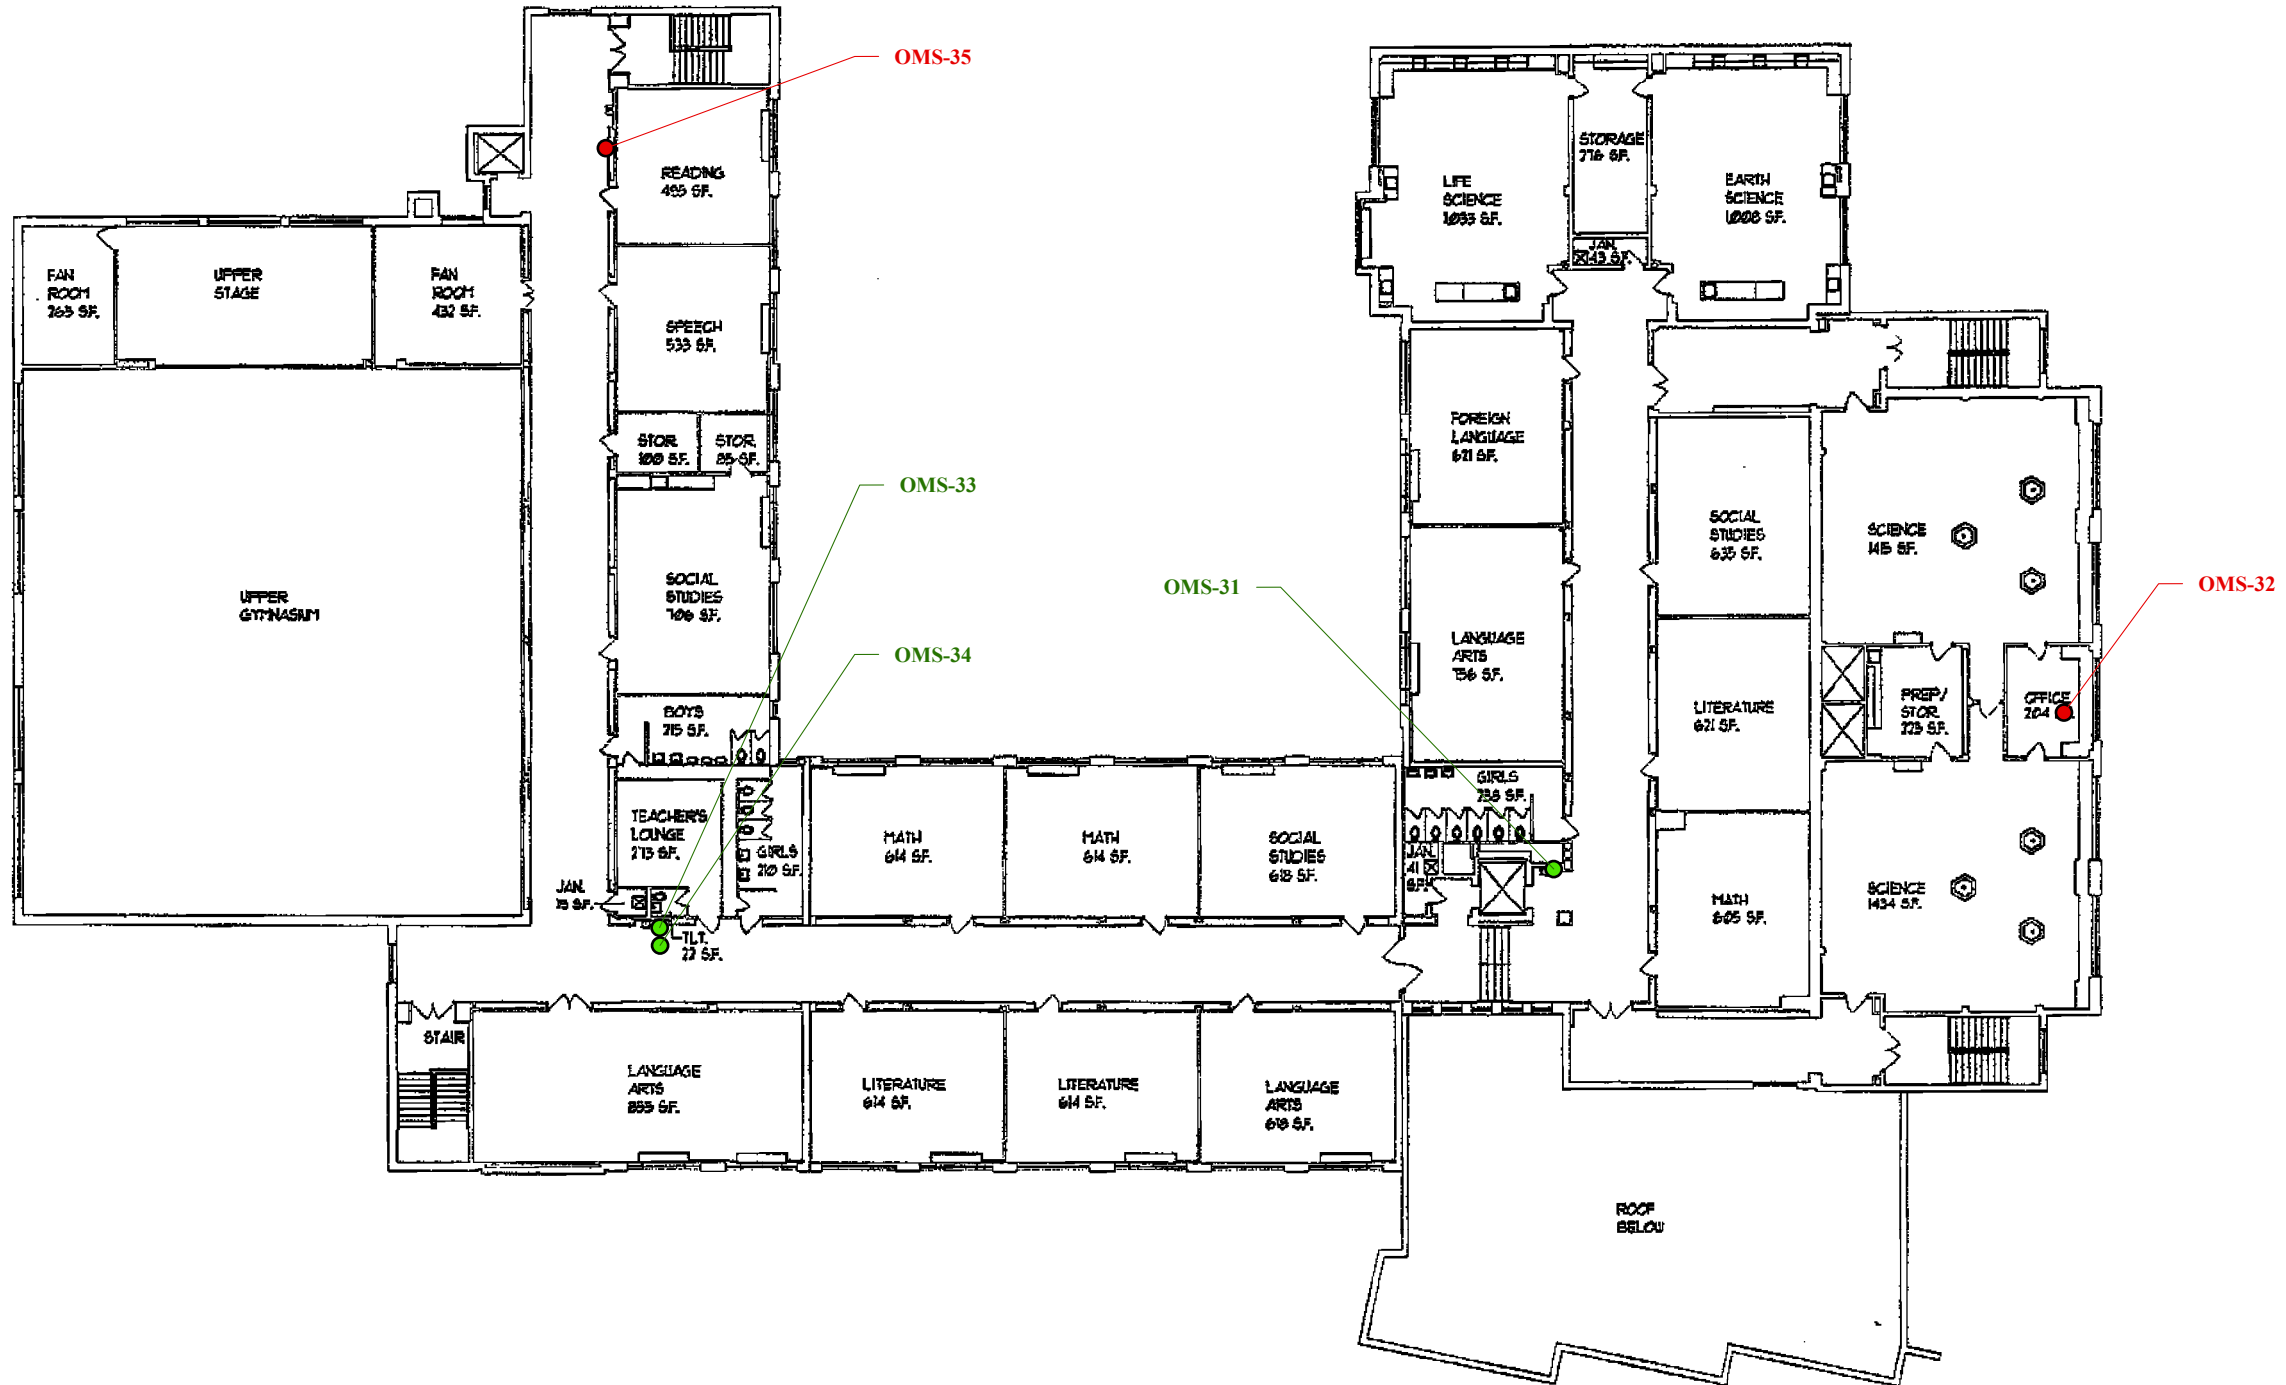



Pace Analytical Services, LLC

2231 W. Altorfer Drive

Peoria, IL 61615

(800)752-6651

January 18, 2024

Glenn Grissom
SCI Engineering
130 Point W. Blvd.
St. Chariles, MO 63301

RE: 2016-0860.2T- OMS

Dear Glenn Grissom:

Please find enclosed the analytical results for the **35** sample(s) the laboratory received on **12/29/23 2:30 pm** and logged in under work order **GL04721**. All testing is performed according to our current TNI accreditations unless otherwise noted. This report cannot be reproduced, except in full, without the written permission of Pace Analytical Services, LLC.

If you have any questions regarding your report, please contact your project manager. Quality and timely data is of the utmost importance to us.

Pace Analytical Services appreciates the opportunity to provide you with analytical expertise . We are always trying to improve our customer service and we welcome you to contact the General Manager, Lisa Grant, with any feedback you have about your experience with our laboratory at 309-683-1764 or lisa.grant@pacelabs.com.

A handwritten signature in black ink, appearing to read "Chenise Lambert-Sykes".

Chenise Lambert-Sykes
Project Manager
(314)432-0550
Chenise.Lambert-Sykes@pacelabs.com



SAMPLE RECEIPT CHECK LIST

Items not applicable will be marked as in compliance

Work Order GL04721

| | |
|-----|--|
| YES | Samples received within temperature compliance when applicable |
| YES | COC present upon sample receipt |
| YES | COC completed & legible |
| YES | Sampler name & signature present |
| YES | Unique sample IDs assigned |
| YES | Sample collection location recorded |
| YES | Date & time collected recorded on COC |
| YES | Relinquished by client signature on COC |
| YES | COC & labels match |
| YES | Sample labels are legible |
| YES | Appropriate bottle(s) received |
| YES | Sufficient sample volume received |
| YES | Sample containers received undamaged |
| NO | Zero headspace, <6 mm present in VOA vials |
| NO | Trip blank(s) received |
| YES | All non-field analyses received within holding times |
| NO | Short hold time analysis |
| YES | Current PDC COC submitted |
| NO | Case narrative provided |



ANALYTICAL RESULTS

Sample: GL04721-01
Name: OMS - 1
Matrix: Drinking Water - Grab

Sampled: 12/28/23 21:32
Received: 12/29/23 14:30

| Parameter | Result | Unit | Qualifier | Prepared | Dilution | MRL | Analyzed | Analyst | Method |
|---------------------------|--------|------|-----------|----------------|----------|------|----------------|---------|-------------------|
| Total Metals - PIA | | | | | | | | | |
| Lead | 3.39 | ug/L | | 01/10/24 10:41 | 1 | 1.00 | 01/10/24 16:13 | BRS | EPA 200.8 REV 5.4 |

Sample: GL04721-02
Name: OMS - 2
Matrix: Drinking Water - Grab

Sampled: 12/28/23 21:34
Received: 12/29/23 14:30

| Parameter | Result | Unit | Qualifier | Prepared | Dilution | MRL | Analyzed | Analyst | Method |
|---------------------------|--------|------|-----------|----------------|----------|------|----------------|---------|-------------------|
| Total Metals - PIA | | | | | | | | | |
| Lead | 1.49 | ug/L | | 01/10/24 10:41 | 1 | 1.00 | 01/10/24 16:15 | BRS | EPA 200.8 REV 5.4 |

Sample: GL04721-03
Name: OMS - 3
Matrix: Drinking Water - Grab

Sampled: 12/28/23 21:35
Received: 12/29/23 14:30

| Parameter | Result | Unit | Qualifier | Prepared | Dilution | MRL | Analyzed | Analyst | Method |
|---------------------------|--------|------|-----------|----------------|----------|------|----------------|---------|-------------------|
| Total Metals - PIA | | | | | | | | | |
| Lead | 22.1 | ug/L | | 01/10/24 10:41 | 1 | 1.00 | 01/10/24 16:19 | BRS | EPA 200.8 REV 5.4 |

Sample: GL04721-04
Name: OMS - 4
Matrix: Drinking Water - Grab

Sampled: 12/28/23 21:36
Received: 12/29/23 14:30

| Parameter | Result | Unit | Qualifier | Prepared | Dilution | MRL | Analyzed | Analyst | Method |
|---------------------------|--------|------|-----------|----------------|----------|------|----------------|---------|-------------------|
| Total Metals - PIA | | | | | | | | | |
| Lead | 3.52 | ug/L | | 01/10/24 10:41 | 1 | 1.00 | 01/10/24 16:21 | BRS | EPA 200.8 REV 5.4 |



ANALYTICAL RESULTS

Sample: GL04721-05
Name: OMS - 5
Matrix: Drinking Water - Grab

Sampled: 12/28/23 21:37
Received: 12/29/23 14:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, 2.14, ug/L, 01/10/24 10:41, 1, 1.00, 01/10/24 16:23, BRS, EPA 200.8 REV 5.4

Sample: GL04721-06
Name: OMS - 6
Matrix: Drinking Water - Grab

Sampled: 12/28/23 21:39
Received: 12/29/23 14:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, 1.71, ug/L, 01/10/24 10:41, 1, 1.00, 01/10/24 16:27, BRS, EPA 200.8 REV 5.4

Sample: GL04721-07
Name: OMS - 7
Matrix: Drinking Water - Grab

Sampled: 12/28/23 21:44
Received: 12/29/23 14:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, < 1.00, ug/L, 01/10/24 10:41, 1, 1.00, 01/10/24 16:29, BRS, EPA 200.8 REV 5.4

Sample: GL04721-08
Name: OMS - 8
Matrix: Drinking Water - Grab

Sampled: 12/28/23 21:44
Received: 12/29/23 14:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, < 1.00, ug/L, 01/15/24 12:04, 1, 1.00, 01/15/24 18:34, BRS, EPA 200.8 REV 5.4



ANALYTICAL RESULTS

Sample: GL04721-09
Name: OMS - 9
Matrix: Drinking Water - Grab

Sampled: 12/28/23 21:47
Received: 12/29/23 14:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, 1.80, ug/L, 01/10/24 10:41, 1, 1.00, 01/10/24 16:30, BRS, EPA 200.8 REV 5.4

Sample: GL04721-10
Name: OMS - 10
Matrix: Drinking Water - Grab

Sampled: 12/28/23 21:51
Received: 12/29/23 14:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, < 1.00, ug/L, 01/10/24 10:41, 1, 1.00, 01/10/24 16:32, BRS, EPA 200.8 REV 5.4

Sample: GL04721-11
Name: OMS - 11
Matrix: Drinking Water - Grab

Sampled: 12/28/23 21:53
Received: 12/29/23 14:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, < 1.00, ug/L, 01/10/24 10:41, 1, 1.00, 01/10/24 16:33, BRS, EPA 200.8 REV 5.4

Sample: GL04721-12
Name: OMS - 12
Matrix: Drinking Water - Grab

Sampled: 12/28/23 21:54
Received: 12/29/23 14:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, < 1.00, ug/L, 01/10/24 10:41, 1, 1.00, 01/10/24 16:38, BRS, EPA 200.8 REV 5.4



ANALYTICAL RESULTS

Sample: GL04721-13
Name: OMS - 13
Matrix: Drinking Water - Grab

Sampled: 12/28/23 21:55

Received: 12/29/23 14:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Total Metals - PIA

Table row for Lead: Lead, < 1.00, ug/L, 01/10/24 10:41, 1, 1.00, 01/10/24 16:40, BRS, EPA 200.8 REV 5.4

Sample: GL04721-14
Name: OMS - 14
Matrix: Drinking Water - Grab

Sampled: 12/28/23 21:56

Received: 12/29/23 14:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Total Metals - PIA

Table row for Lead: Lead, 4.65, ug/L, 01/10/24 10:41, 1, 1.00, 01/10/24 16:41, BRS, EPA 200.8 REV 5.4

Sample: GL04721-15
Name: OMS - 15
Matrix: Drinking Water - Grab

Sampled: 12/28/23 21:58

Received: 12/29/23 14:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Total Metals - PIA

Table row for Lead: Lead, 4.38, ug/L, 01/10/24 10:41, 1, 1.00, 01/10/24 16:43, BRS, EPA 200.8 REV 5.4

Sample: GL04721-16
Name: OMS - 16
Matrix: Drinking Water - Grab

Sampled: 12/28/23 21:59

Received: 12/29/23 14:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Total Metals - PIA

Table row for Lead: Lead, 6.14, ug/L, 01/10/24 10:41, 1, 1.00, 01/10/24 16:44, BRS, EPA 200.8 REV 5.4



ANALYTICAL RESULTS

Sample: GL04721-17
Name: OMS - 17
Matrix: Drinking Water - Grab

Sampled: 12/28/23 22:00

Received: 12/29/23 14:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Total Metals - PIA

Table row for Lead: < 1.00 ug/L, 01/10/24 10:41, 1, 1.00, 01/10/24 16:49, BRS, EPA 200.8 REV 5.4

Sample: GL04721-18
Name: OMS - 18
Matrix: Drinking Water - Grab

Sampled: 12/28/23 22:01

Received: 12/29/23 14:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Total Metals - PIA

Table row for Lead: 4.96 ug/L, 01/10/24 10:41, 1, 1.00, 01/10/24 16:51, BRS, EPA 200.8 REV 5.4

Sample: GL04721-19
Name: OMS - 19
Matrix: Drinking Water - Grab

Sampled: 12/28/23 22:03

Received: 12/29/23 14:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Total Metals - PIA

Table row for Lead: 16.7 ug/L, 01/10/24 10:41, 1, 1.00, 01/10/24 16:52, BRS, EPA 200.8 REV 5.4

Sample: GL04721-20
Name: OMS - 20
Matrix: Drinking Water - Grab

Sampled: 12/28/23 22:04

Received: 12/29/23 14:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Total Metals - PIA

Table row for Lead: 193 ug/L, 01/10/24 10:41, 1, 1.00, 01/10/24 16:57, BRS, EPA 200.8 REV 5.4



ANALYTICAL RESULTS

Sample: GL04721-21
Name: OMS - 21
Matrix: Drinking Water - Grab

Sampled: 12/28/23 22:08

Received: 12/29/23 14:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, < 1.00, ug/L, 01/10/24 10:41, 1, 1.00, 01/10/24 16:58, BRS, EPA 200.8 REV 5.4

Sample: GL04721-22
Name: OMS - 22
Matrix: Drinking Water - Grab

Sampled: 12/28/23 22:09

Received: 12/29/23 14:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, 34.5, ug/L, 01/10/24 10:41, 1, 1.00, 01/10/24 17:00, BRS, EPA 200.8 REV 5.4

Sample: GL04721-23
Name: OMS - 23
Matrix: Drinking Water - Grab

Sampled: 12/28/23 22:11

Received: 12/29/23 14:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, 4.10, ug/L, 01/10/24 10:41, 1, 1.00, 01/10/24 17:02, BRS, EPA 200.8 REV 5.4

Sample: GL04721-24
Name: OMS - 24
Matrix: Drinking Water - Grab

Sampled: 12/28/23 22:12

Received: 12/29/23 14:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, 958, ug/L, 01/10/24 10:41, 1, 1.00, 01/10/24 17:03, BRS, EPA 200.8 REV 5.4



ANALYTICAL RESULTS

Sample: GL04721-25
Name: OMS - 25
Matrix: Drinking Water - Grab

Sampled: 12/28/23 22:14

Received: 12/29/23 14:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Total Metals - PIA

Table row for Lead: 2.16 ug/L, 01/10/24 10:41, 1, 1.00, 01/10/24 17:05, BRS, EPA 200.8 REV 5.4

Sample: GL04721-26
Name: OMS - 26
Matrix: Drinking Water - Grab

Sampled: 12/28/23 22:17

Received: 12/29/23 14:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Total Metals - PIA

Table row for Lead: < 1.00 ug/L, 01/10/24 10:41, 1, 1.00, 01/10/24 17:06, BRS, EPA 200.8 REV 5.4

Sample: GL04721-27
Name: OMS - 27
Matrix: Drinking Water - Grab

Sampled: 12/28/23 22:17

Received: 12/29/23 14:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Total Metals - PIA

Table row for Lead: < 1.00 ug/L, 01/10/24 10:41, 1, 1.00, 01/10/24 17:11, BRS, EPA 200.8 REV 5.4

Sample: GL04721-28
Name: OMS - 28
Matrix: Drinking Water - Grab

Sampled: 12/28/23 22:18

Received: 12/29/23 14:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Total Metals - PIA

Table row for Lead: < 1.00 ug/L, 01/10/24 10:41, 1, 1.00, 01/10/24 17:16, BRS, EPA 200.8 REV 5.4



ANALYTICAL RESULTS

Sample: GL04721-29
Name: OMS - 29
Matrix: Drinking Water - Grab

Sampled: 12/28/23 22:20

Received: 12/29/23 14:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Total Metals - PIA

Table row for Lead: < 1.00 ug/L, 01/10/24 10:41, 1, 1.00, 01/10/24 17:17, BRS, EPA 200.8 REV 5.4

Sample: GL04721-30
Name: OMS - 30
Matrix: Drinking Water - Grab

Sampled: 12/28/23 22:20

Received: 12/29/23 14:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Total Metals - PIA

Table row for Lead: < 1.00 ug/L, 01/10/24 10:41, 1, 1.00, 01/10/24 17:19, BRS, EPA 200.8 REV 5.4

Sample: GL04721-31
Name: OMS - 31
Matrix: Drinking Water - Grab

Sampled: 12/28/23 22:22

Received: 12/29/23 14:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Total Metals - PIA

Table row for Lead: < 1.00 ug/L, 01/10/24 10:41, 1, 1.00, 01/10/24 17:20, BRS, EPA 200.8 REV 5.4

Sample: GL04721-32
Name: OMS - 32
Matrix: Drinking Water - Grab

Sampled: 12/28/23 22:24

Received: 12/29/23 14:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Total Metals - PIA

Table row for Lead: 20.6 ug/L, 01/10/24 10:41, 1, 1.00, 01/10/24 17:22, BRS, EPA 200.8 REV 5.4



ANALYTICAL RESULTS

Sample: GL04721-33
Name: OMS - 33
Matrix: Drinking Water - Grab

Sampled: 12/28/23 22:26
Received: 12/29/23 14:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, < 1.00, ug/L, 01/10/24 10:41, 1, 1.00, 01/10/24 17:23, BRS, EPA 200.8 REV 5.4

Sample: GL04721-34
Name: OMS - 34
Matrix: Drinking Water - Grab

Sampled: 12/28/23 22:28
Received: 12/29/23 14:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, < 1.00, ug/L, 01/10/24 10:41, 1, 1.00, 01/10/24 17:25, BRS, EPA 200.8 REV 5.4

Sample: GL04721-35
Name: OMS - 35
Matrix: Drinking Water - Grab

Sampled: 12/28/23 22:29
Received: 12/29/23 14:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, 7.96, ug/L, 01/10/24 10:41, 1, 1.00, 01/10/24 17:27, BRS, EPA 200.8 REV 5.4



QC SAMPLE RESULTS

| Parameter | Result | Unit | Qual | Spike Level | Source Result | %REC | %REC Limits | RPD | RPD Limit |
|---|--------|------|------|--|---------------|------|-------------|-----|-----------|
| Batch B422796 - DW 200.8 no prep - EPA 200.8 REV 5.4 | | | | | | | | | |
| Blank (B422796-BLK1) | | | | Prepared & Analyzed: 01/10/24 | | | | | |
| Lead | < 1.00 | ug/L | | | | | | | |
| LCS (B422796-BS1) | | | | Prepared & Analyzed: 01/10/24 | | | | | |
| Lead | 53.0 | ug/L | | 50.00 | | 106 | 85-115 | | |
| Matrix Spike (B422796-MS1) | | | | Sample: GL04644-08 Prepared & Analyzed: 01/10/24 | | | | | |
| Lead | 57.0 | ug/L | | 50.00 | 0.356 | 113 | 70-130 | | |
| Matrix Spike (B422796-MS2) | | | | Sample: GL04712-03 Prepared & Analyzed: 01/10/24 | | | | | |
| Lead | 54.0 | ug/L | | 50.00 | ND | 108 | 70-130 | | |
| Matrix Spike (B422796-MS3) | | | | Sample: GL04692-09 Prepared & Analyzed: 01/10/24 | | | | | |
| Lead | 51.9 | ug/L | | 50.00 | ND | 104 | 70-130 | | |
| Matrix Spike (B422796-MS4) | | | | Sample: GL04720-06 Prepared & Analyzed: 01/10/24 | | | | | |
| Lead | 54.8 | ug/L | | 50.00 | 1.34 | 107 | 70-130 | | |
| Matrix Spike (B422796-MS5) | | | | Sample: GL04720-16 Prepared & Analyzed: 01/10/24 | | | | | |
| Lead | 52.9 | ug/L | | 50.00 | ND | 106 | 70-130 | | |
| Matrix Spike (B422796-MS6) | | | | Sample: GL04720-26 Prepared & Analyzed: 01/10/24 | | | | | |
| Lead | 55.1 | ug/L | | 50.00 | 0.436 | 109 | 70-130 | | |
| Matrix Spike (B422796-MS7) | | | | Sample: GL04720-36 Prepared & Analyzed: 01/10/24 | | | | | |
| Lead | 53.4 | ug/L | | 50.00 | 0.580 | 106 | 70-130 | | |
| Matrix Spike (B422796-MS8) | | | | Sample: GL04724-01 Prepared & Analyzed: 01/10/24 | | | | | |
| Lead | 53.9 | ug/L | | 50.00 | 0.689 | 106 | 70-130 | | |
| Matrix Spike (B422796-MS9) | | | | Sample: GL04721-05 Prepared & Analyzed: 01/10/24 | | | | | |
| Lead | 54.9 | ug/L | | 50.00 | 2.14 | 106 | 70-130 | | |
| Matrix Spike (B422796-MSA) | | | | Sample: GL04721-16 Prepared & Analyzed: 01/10/24 | | | | | |
| Lead | 57.9 | ug/L | | 50.00 | 6.14 | 103 | 70-130 | | |
| Matrix Spike (B422796-MSB) | | | | Sample: GL04721-26 Prepared & Analyzed: 01/10/24 | | | | | |
| Lead | 50.9 | ug/L | | 50.00 | 0.451 | 101 | 70-130 | | |
| Matrix Spike (B422796-MSC) | | | | Sample: GL04723-01 Prepared & Analyzed: 01/10/24 | | | | | |
| Lead | 51.6 | ug/L | | 50.00 | ND | 103 | 70-130 | | |
| Matrix Spike Dup (B422796-MSD1) | | | | Sample: GL04644-08 Prepared & Analyzed: 01/10/24 | | | | | |
| Lead | 58.0 | ug/L | | 50.00 | 0.356 | 115 | 70-130 | 2 | 20 |
| Matrix Spike Dup (B422796-MSD2) | | | | Sample: GL04712-03 Prepared & Analyzed: 01/10/24 | | | | | |
| Lead | 56.4 | ug/L | | 50.00 | ND | 113 | 70-130 | 4 | 20 |
| Matrix Spike Dup (B422796-MSD3) | | | | Sample: GL04692-09 Prepared & Analyzed: 01/10/24 | | | | | |
| Lead | 52.0 | ug/L | | 50.00 | ND | 104 | 70-130 | 0.1 | 20 |
| Matrix Spike Dup (B422796-MSD4) | | | | Sample: GL04720-06 Prepared & Analyzed: 01/10/24 | | | | | |
| Lead | 53.4 | ug/L | | 50.00 | 1.34 | 104 | 70-130 | 3 | 20 |
| Matrix Spike Dup (B422796-MSD5) | | | | Sample: GL04720-16 Prepared & Analyzed: 01/10/24 | | | | | |
| Lead | 54.3 | ug/L | | 50.00 | ND | 109 | 70-130 | 3 | 20 |
| Matrix Spike Dup (B422796-MSD6) | | | | Sample: GL04720-26 Prepared & Analyzed: 01/10/24 | | | | | |
| Lead | 54.1 | ug/L | | 50.00 | 0.436 | 107 | 70-130 | 2 | 20 |
| Matrix Spike Dup (B422796-MSD7) | | | | Sample: GL04720-36 Prepared & Analyzed: 01/10/24 | | | | | |
| Lead | 53.3 | ug/L | | 50.00 | 0.580 | 105 | 70-130 | 0.2 | 20 |
| Matrix Spike Dup (B422796-MSD8) | | | | Sample: GL04724-01 Prepared & Analyzed: 01/10/24 | | | | | |
| Lead | 54.6 | ug/L | | 50.00 | 0.689 | 108 | 70-130 | 1 | 20 |



QC SAMPLE RESULTS

| Parameter | Result | Unit | Qual | Spike Level | Source Result | %REC | %REC Limits | RPD | RPD Limit |
|--|--------------------|------|------|-------------------------------|---------------|------|-------------|-----|-----------|
| Matrix Spike Dup (B422796-MSD9) | Sample: GL04721-05 | | | Prepared & Analyzed: 01/10/24 | | | | | |
| Lead | 54.6 | ug/L | | 50.00 | 2.14 | 105 | 70-130 | 0.6 | 20 |
| Matrix Spike Dup (B422796-MSDA) | Sample: GL04721-16 | | | Prepared & Analyzed: 01/10/24 | | | | | |
| Lead | 58.6 | ug/L | | 50.00 | 6.14 | 105 | 70-130 | 1 | 20 |
| Matrix Spike Dup (B422796-MSDB) | Sample: GL04721-26 | | | Prepared & Analyzed: 01/10/24 | | | | | |
| Lead | 51.9 | ug/L | | 50.00 | 0.451 | 103 | 70-130 | 2 | 20 |
| Matrix Spike Dup (B422796-MSDC) | Sample: GL04723-01 | | | Prepared & Analyzed: 01/10/24 | | | | | |
| Lead | 53.2 | ug/L | | 50.00 | ND | 106 | 70-130 | 3 | 20 |
| <u>Batch B423111 - DW 200.8 no prep - EPA 200.8 REV 5.4</u> | | | | | | | | | |
| Blank (B423111-BLK1) | | | | Prepared & Analyzed: 01/15/24 | | | | | |
| Lead | < 1.00 | ug/L | | | | | | | |
| LCS (B423111-BS1) | | | | Prepared & Analyzed: 01/15/24 | | | | | |
| Lead | 485 | ug/L | | 500.0 | | 97 | 85-115 | | |
| Matrix Spike (B423111-MS1) | Sample: GL04728-24 | | | Prepared & Analyzed: 01/15/24 | | | | | |
| Lead | 484 | ug/L | | 500.0 | 0.138 | 97 | 70-130 | | |
| Matrix Spike (B423111-MS2) | Sample: GL04721-08 | | | Prepared & Analyzed: 01/15/24 | | | | | |
| Lead | 492 | ug/L | | 500.0 | 0.860 | 98 | 70-130 | | |
| Matrix Spike Dup (B423111-MSD1) | Sample: GL04728-24 | | | Prepared & Analyzed: 01/15/24 | | | | | |
| Lead | 491 | ug/L | | 500.0 | 0.138 | 98 | 70-130 | 1 | 20 |
| Matrix Spike Dup (B423111-MSD2) | Sample: GL04721-08 | | | Prepared & Analyzed: 01/15/24 | | | | | |
| Lead | 481 | ug/L | | 500.0 | 0.860 | 96 | 70-130 | 2 | 20 |



NOTES

Specifications regarding method revisions, method modifications, and calculations used for analysis are available upon request. Please contact your project manager.

* Not a TNI accredited analyte

Certifications

CHI - McHenry, IL - 4314-A W. Crystal Lake Road, McHenry, IL 60050

TNI Accreditation for Drinking Water and Wastewater Fields of Testing through IL EPA Accreditation No. 100279

Illinois Department of Public Health Bacterial Analysis in Drinking Water Approved Laboratory Registry No. 17556

PIA - Peoria, IL - 2231 W. Altorfer Drive, Peoria, IL 61615

TNI Accreditation for Drinking Water, Wastewater, Solid and Hazardous Material Fields of Testing through IL EPA Accreditation No. 100230

Illinois Department of Public Health Bacterial Analysis in Drinking Water Approved Laboratory Registry No. 17553

Drinking Water Certifications/Accreditations: Iowa (240); Kansas (E-10338); Missouri (870)

Wastewater Certifications/Accreditations: Arkansas (88-0677); Iowa (240); Kansas (E-10338)

Solid and Hazardous Material Certifications/Accreditations: Arkansas (88-0677); Iowa (240); Kansas (E-10338)

SPMO - Springfield, MO - 1805 W Sunset Street, Springfield, MO 65807

USEPA DMR-QA Program

STL - Hazelwood, MO - 944 Anglum Rd, Hazelwood, MO 63042

TNI Accreditation for Wastewater, Solid and Hazardous Material Fields of Testing through KS KDHE Certification No. E-10389

TNI Accreditation for Wastewater, Solid and Hazardous Material Fields of Testing through IL EPA Accreditation No. - 200080

Illinois Department of Public Health Bacterial Analysis in Drinking Water Approved Laboratory, Registry No. 171050

Missouri Department of Natural Resources - Certificate of Approval for Microbiological Laboratory Service - No. 1050



Certified by: Chenise Lambert-Sykes, Project Manager

| | |
|------------------------------|-----------------------|
| REGULATORY PROGRAM (CIRCLE): | NPDES |
| MORBCA | RCRA |
| CCDD | TACO: RES or IND/COMM |

1/4

CHAIN OF CUSTODY RECORD
 STATE WHERE SAMPLE COLLECTED MO

ALL HIGHLIGHTED AREAS MUST BE COMPLETED BY CLIENT (PLEASE PRINT)

| | | | | | |
|---|--|--|------------------|-----------------------------|--|
| 1 CLIENT SCI Engineering | PROJECT NUMBER 2016-0860.2T | PROJECT LOCATION OM 5 | PURCHASE ORDER # | 3 ANALYSIS REQUESTED | 4 (FOR LAB USE ONLY) LOGIN # <u>GLO4721</u> LOGGED BY: <u>SAB</u> CLIENT: <u>SCI Engineering</u> PROJECT: <u>Drinking Water Lead</u> PROJ. MGR.: <u>Chenise Lambert-Sykes</u> CUSTODY SEAL #: |
| ADDRESS 130 Point West Blvd | PHONE NUMBER (314) 581-7570 | E-MAIL blieb@sciengineering.com | DATE SHIPPED | | |
| CITY STATE ZIP St. Charles, MO 63301 | SAMPLER (PLEASE PRINT) Ethan Boyer | MATRIX TYPES: WW- WASTEWATER DW- DRINKING WATER GW- GROUND WATER WWSL- SLUDGE NAS- NON AQUEOUS SOLID LCHL- LEACHATE OIL-OIL SO-SOIL SOL-SOLID | | | |
| CONTACT PERSON Brian Lieb | SAMPLER'S SIGNATURE | | | | |

| 2 SAMPLE DESCRIPTION (UNIQUE DESCRIPTION AS IT WILL APPEAR ON THE ANALYTICAL REPORT) | DATE COLLECTED | TIME COLLECTED | SAMPLE TYPE | | MATRIX TYPE | BOTTLE COUNT | PRES CODE CLIENT PROVIDED | DW Pb | Turb Check | REMARKS |
|---|----------------|----------------|-------------|------|-------------|--------------|------------------------------|-------|------------|---------|
| | | | GRAB | COMP | | | | | | |
| OM 5 -1 | 12/28/23 | 2132 | X | X | DW | 1 | 6 | X | X | |
| OM 5 -2 | | 2134 | | | | | | X | X | |
| OM 5 -3 | | 2135 | | | | | | X | X | |
| OM 5 -4 | | 2136 | | | | | | X | X | |
| OM 5 -5 | | 2137 | | | | | | X | X | |
| OM 5 -6 | | 2139 | | | | | | X | X | |
| OM 5 -7 | | 2144 | | | | | | X | X | |
| OM 5 -8 | | 2144 | | | | | | X | X | |
| OM 5 -9 | | 2147 | | | | | | X | X | |
| OM 5 -10 | | 2151 | | | | | | X | X | |
| OM 5 -11 | | 2153 | | | | | | X | X | |

CHEMICAL PRESERVATION CODES: 1 - HCL 2 - H2SO4 3 - HNO3 4 - NAOH 5 - NA2S2O3 6 - UNPRESERVED 7 - OTHER

| | | |
|---|---|---|
| 5 TURNAROUND TIME REQUESTED (PLEASE CIRCLE) NORMAL RUSH (RUSH TAT IS SUBJECT TO PACE LABS APPROVAL AND SURCHARGE) | DATE RESULTS NEEDED | 6 I understand that by initialing this box I give the lab permission to proceed with analysis, even though it may not meet all sample conformance requirements as defined in the receiving facility's Sample Acceptance Policy and the data will be qualified. Qualified data may NOT be acceptable to report to all regulatory authorities. |
| RUSH RESULTS VIA (PLEASE CIRCLE) EMAIL PHONE | PROCEED WITH ANALYSIS AND QUALIFY RESULTS: (INITIALS) | |

| | | | | |
|---|----------------------------------|------------------------------|-----------------------------------|--|
| 7 RELINQUISHED BY: (SIGNATURE) | DATE 12/29/23 TIME 0045 | RECEIVED BY: (SIGNATURE) | DATE 12/29/23 TIME 10:35 | 8 COMMENTS: (FOR LAB USE ONLY) SAMPLE TEMPERATURE UPON RECEIPT <u>17.8</u> °C CHILL PROCESS STARTED PRIOR TO RECEIPT Y OR N SAMPLE(S) RECEIVED ON ICE Y OR N SAMPLE ACCEPTANCE NONCONFORMANT REPORT IS NEEDED Y OR N DATE AND TIME TAKEN FROM SAMPLE B |
| RELINQUISHED BY: (SIGNATURE) | DATE 12/29/23 TIME 1035 | RECEIVED BY: (SIGNATURE) | DATE 12/29/23 TIME 1040 | |
| RELINQUISHED BY: (SIGNATURE) | DATE 12-29-23 TIME 1430 | RECEIVED BY: (SIGNATURE) | DATE 12/29/23 TIME 1430 | |

counter

| | |
|------------------------------|-----------------------|
| REGULATORY PROGRAM (CIRCLE): | NPDES |
| MORBCA | RCRA |
| CCDD | TACO: RES OR IND/COMM |

ALL HIGHLIGHTED AREAS MUST BE COMPLETED BY CLIENT (PLEASE PRINT)

| | | | | | |
|---|---------------------------------------|---|---|--|---|
| 1 CLIENT SCI Engineering ADDRESS 130 Point West Blvd CITY STATE ZIP St. Charles, MO 63301 CONTACT PERSON Brian Lieb | PROJECT NUMBER 2016-0860.2T | PROJECT LOCATION OMS | PURCHASE ORDER # | 3 ANALYSIS REQUESTED DW Pb Turb Check | 4 (FOR LAB USE ONLY) LOGIN # GLOU721 LOGGED BY: SAB CLIENT: SCI Engineering PROJECT: Drinking Water Lead PROJ. MGR.: Chenise Lambert-Sykes CUSTODY SEAL #: |
| | PHONE NUMBER (314) 581-7570 | E-MAIL blieb@sciengineering.com | DATE SHIPPED | | |
| | SAMPLER (PLEASE PRINT) Ethan Boyer | SAMPLER'S SIGNATURE <i>[Signature]</i> | MATRIX TYPES: WW-WASTEWATER DW-DRINKING WATER GW-GROUND WATER WWSL-SLUDGE NAS-NON AQUEOUS SOLID LCHT-LEACHATE OR-OIL SO-SOIL SOL-SOLID | | |
| | | | | | |

| 2 SAMPLE DESCRIPTION (UNIQUE DESCRIPTION AS IT WILL APPEAR ON THE ANALYTICAL REPORT) | DATE COLLECTED | TIME COLLECTED | SAMPLE TYPE | | MATRIX TYPE | BOTTLE COUNT | PRES CODE CLIENT PROVIDED | DW | Pb | Turb | Check | REMARKS |
|---|----------------|----------------|-------------|------|-------------|--------------|------------------------------|----|----|------|-------|---------|
| | | | GRAB | COMP | | | | | | | | |
| OMS-12 | 12/28/23 | 2154 | X | X | DW | 1 | 6 | X | X | | | |
| OMS-13 | | 2155 | | | | | | X | X | | | |
| OMS-14 | | 2156 | | | | | | X | X | | | |
| OMS-15 | | 2158 | | | | | | X | X | | | |
| OMS-16 | | 2159 | | | | | | X | X | | | |
| OMS-17 | | 2200 | | | | | | X | X | | | |
| OMS-18 | | 2201 | | | | | | X | X | | | |
| OMS-19 | | 2203 | | | | | | X | X | | | |
| OMS-20 | | 2204 | | | | | | X | X | | | |
| OMS-21 | | 2208 | | | | | | X | X | | | |
| OMS-22 | | 2209 | | | | | | X | X | | | |

CHEMICAL PRESERVATION CODES: 1-HCL 2-H2SO4 3-HNO3 4-NAOH 5-NA2S2O3 6-UNPRESERVED 7-OTHER

| | |
|---|--|
| 5 TURNAROUND TIME REQUESTED (PLEASE CIRCLE) NORMAL RUSH RUSH RESULTS VIA (PLEASE CIRCLE) EMAIL PHONE EMAIL IF DIFFERENT FROM ABOVE: PHONE # IF DIFFERENT FROM ABOVE: | 6 I understand that by initialing this box I give the lab permission to proceed with analysis, even though it may not meet all sample conformance requirements as defined in the receiving facility's Sample Acceptance Policy and the data will be qualified. Qualified data may NOT be acceptable to report to all regulatory authorities. PROCEED WITH ANALYSIS AND QUALIFY RESULTS: (INITIALS) |
|---|--|

| | | |
|---|--|--|
| 7 RELINQUISHED BY: (SIGNATURE) <i>[Signature]</i> DATE 12/29/23 TIME 0045 | RECEIVED BY: (SIGNATURE) DATE TIME | 8 COMMENTS: (FOR LAB USE ONLY) SAMPLE TEMPERATURE UPON RECEIPT 17.8 °C CHILL PROCESS STARTED PRIOR TO RECEIPT Y OR N SAMPLE(S) RECEIVED ON ICE Y OR N SAMPLE ACCEPTANCE NONCONFORMANT REPORT IS NEEDED Y OR N DATE AND TIME TAKEN FROM SAMPLE BOTTLE |
| RELINQUISHED BY: (SIGNATURE) DATE TIME | RECEIVED BY: (SIGNATURE) DATE 12-29-23 TIME 1040 | |
| RELINQUISHED BY: (SIGNATURE) <i>[Signature]</i> DATE 12-29-23 TIME 1430 | RECEIVED BY: (SIGNATURE) <i>[Signature]</i> DATE 12/29/23 TIME 1430 | |

| | |
|------------------------------|-----------------------|
| REGULATORY PROGRAM (CIRCLE): | NPDES |
| MORBCA | RCRA |
| CCDD | TACO: RES OR IND/COMM |

3/4

ALL HIGHLIGHTED AREAS MUST BE COMPLETED BY CLIENT (PLEASE PRINT)

| | | | | | |
|---|---|--|------------------|--|---|
| 1 CLIENT SCI Engineering ADDRESS 130 Point West Blvd CITY STATE ZIP St. Charles, MO 63301 CONTACT PERSON Brian Lieb | PROJECT NUMBER 2016-0860.2T | PROJECT LOCATION OMS | PURCHASE ORDER # | 3 ANALYSIS REQUESTED DW Pb Turb Check | 4 (FOR LAB USE ONLY) LOGIN # <u>GLOU721</u> LOGGED BY: <u>SJB</u> CLIENT: SCI Engineering PROJECT: Drinking Water Lead PROJ. MGR.: Chenise Lambert-Sykes CUSTODY SEAL #: _____ |
| | PHONE NUMBER (314) 581-7570 | E-MAIL blieb@sciengineering.com | DATE SHIPPED | | |
| | SAMPLER (PLEASE PRINT) Ethan Boyer | MATRIX TYPES: <small> WW- WASTEWATER DW- DRINKING WATER GW- GROUND WATER WWSL- SLUDGE NAs- NON AQUEOUS SOLID LCHT- LEACHATE OIL- OIL SO- SOIL SOL- SOLID </small> | | | |
| | SAMPLER'S SIGNATURE <i>Ethan Boyer</i> | | | | |

| 2 SAMPLE DESCRIPTION (UNIQUE DESCRIPTION AS IT WILL APPEAR ON THE ANALYTICAL REPORT) | DATE COLLECTED | TIME COLLECTED | SAMPLE TYPE | | MATRIX TYPE | BOTTLE COUNT | PRES CODE CLIENT PROVIDED | DW | Pb | Turb | Check | REMARKS |
|---|----------------|----------------|-------------|------|-------------|--------------|------------------------------|----|----|------|-------|---------|
| | | | GRAB | COMP | | | | | | | | |
| OMS - 23 | 12/28/23 | 2211 | X | X | DW | 1 | 6 | X | X | | | |
| OMS - 24 | | 2212 | | | | | | X | X | | | |
| OMS - 25 | | 2214 | | | | | | X | X | | | |
| OMS - 26 | | 2217 | | | | | | X | X | | | |
| OMS - 27 | | 2217 | | | | | | X | X | | | |
| OMS - 28 | | 2218 | | | | | | X | X | | | |
| OMS - 29 | | 2220 | | | | | | X | X | | | |
| OMS - 30 | | 2220 | | | | | | X | X | | | |
| OMS - 31 | | 2222 | | | | | | X | X | | | |
| OMS - 32 | | 2224 | | | | | | X | X | | | |
| OMS - 33 | | 2226 | | | | | | X | X | | | |

CHEMICAL PRESERVATION CODES: 1-HCL 2-H2SO4 3-HNO3 4-NAOH 5-NA2S2O3 6-UNPRESERVED 7-OTHER

| | |
|---|--|
| 5 TURNAROUND TIME REQUESTED (PLEASE CIRCLE) NORMAL RUSH RUSH RESULTS VIA (PLEASE CIRCLE) EMAIL PHONE EMAIL IF DIFFERENT FROM ABOVE: PHONE # IF DIFFERENT FROM ABOVE: | 6 I understand that by initialing this box I give the lab permission to proceed with analysis, even though it may not meet all sample conformance requirements as defined in the receiving facility's Sample Acceptance Policy and the data will be qualified. Qualified data may NOT be acceptable to report to all regulatory authorities. PROCEED WITH ANALYSIS AND QUALIFY RESULTS: (INITIALS) _____ |
|---|--|

| | |
|---|---|
| 7 RELINQUISHED BY: (SIGNATURE) <i>[Signature]</i> DATE: 12/29/23 TIME: 1045 RECEIVED BY: (SIGNATURE) <i>[Signature]</i> DATE: 12/29/23 TIME: 1035 RECEIVED BY: (SIGNATURE) <i>[Signature]</i> RELINQUISHED BY: (SIGNATURE) <i>[Signature]</i> DATE: 12-29-23 TIME: 1430 RECEIVED BY: (SIGNATURE) <i>[Signature]</i> | 8 COMMENTS: (FOR LAB USE ONLY) SAMPLE TEMPERATURE UPON RECEIPT <u>17.8</u> °C CHILL PROCESS STARTED PRIOR TO RECEIPT Y OR N SAMPLE(S) RECEIVED ON ICE Y OR N SAMPLE ACCEPTANCE NONCONFORMANT REPORT IS NEEDED Y OR N DATE AND TIME TAKEN FROM SAMPLE BOTTLE _____ |
|---|---|

