



SCI ENGINEERING, INC.

EARTH • SCIENCE • SOLUTIONS

GEOTECHNICAL
ENVIRONMENTAL
NATURAL RESOURCES
CULTURAL RESOURCES
CONSTRUCTION SERVICES

April 2, 2024

Michael Gegg
Mehlville School District
3120 Lemay Ferry Road
St. Louis, Missouri 63125

RE: Lead in Drinking Water Report
Oakville High School
5557 Milburn Road
St. Louis, Missouri
SCI No. 2016-0860.2T

Dear Michael Gegg:

INTRODUCTION

SCI Engineering, Inc. (SCI) is pleased to submit this report summarizing lead in drinking water sampling activities performed on January 2, 2024. The purpose of the sampling activities was to screen for elevated levels of lead in the drinking water at potable water sources throughout the above-referenced structure.

The drinking water survey is intended to satisfy the requirements for the “Get the Lead Out of School Drinking Water Act” (GTLOSDWA), Section 160.077 administered by the Missouri Department of Health and Senior Services. Potable water sources to be tested were identified by the school district prior to SCI’s field activities.

LIMITATIONS

SCI’s sampling activities were limited to locations identified by the school district. If any additional potable water sources need testing, please contact SCI, and we will make arrangements for sampling these fixtures. Potable water sources that were not sampled will need a sign placed near each fixture informing students and faculty it is not to be used as a drinking water source.

During the course of performing the drinking water sampling of the structure, SCI was unable to sample five fixtures because they were out of order. These fixtures included the skillet faucet in the kitchen, the bottle filler and water fountain in the hallway south of the main entrance, the ice maker near the library, and the left water fountain outside Room 302. If these fixtures are made operational, they should be sampled or labeled non-potable. SCI was able to sample all other locations identified by the school district.

DRINKING WATER SURVEY

SCI collected “first draw” samples which consisted of collecting a water sample from each fixture or sample location after it remained stagnant for at least eight hours. Prior to sampling, SCI first mobilized

to the site to flush the identified potable water fixtures throughout the structure. Once each fixture was flushed, a sign was placed on the fixture indicating it should not be used. SCI then revisited the site, after a minimum of eight hours, to collect water samples from the fixtures.

SCI collected 50 drinking water samples (OHS-1 through OHS-50) from various water fixtures located throughout the structure and submitted them for analytical testing. The drinking water samples were analyzed for total lead by U.S. EPA Method 200.8. SCI collected a minimum of 250 milliliters of water from each location. Sampled water was containerized in laboratory-provided sample containers and shipped to the lab using standard chain-of-custody procedures. Figures depicting the locations of the sampled water fixtures are enclosed.

The drinking water samples were analyzed for lead in accordance with the GTLOSDWA, Section 160.077, which establishes an action level (AL) of 5 parts per billion (ppb). The drinking water samples which exceeded the AL are identified in Table 1, below. A copy of the analytical test results and chain-of-custody for all samples is enclosed.

Table 1 – Lead in Drinking Water Results

Sample Number	Sample Location	Sample Description	Result (ppb)
OHS-7	Kitchen	Left Combi-Oven	5.87
OHS-12	Kitchen – Serving Area	Hand Wash Sink	6.94
OHS-23	Lounge	Sink	5.46

CONCLUSION AND RECOMMENDATIONS

As can be seen in Table 1, above, three drinking water samples exceeded the AL. SCI recommends any fixture which exceeds the AL be taken out of service until remediated and follow up testing indicates results less than the AL. Alternatively, if a water fixture is determined not to be a potable drinking water source, signage may be installed indicating the purpose and/or restrictions of the fixture.

According to GTLOSDWA, any water fixtures which exceed the AL shall be remediated prior to August 1, 2024, or the first day on which students will be present in the building, whichever is later. Any replacement fixture shall be lead free, as defined in 40 CFR 143.12.

REPORTING

Within seven business days after receiving this report, the school district shall contact parents and staff via written notification which shall include the following:

- The test results and a summary that explains such results;
- A description of any remedial steps taken;
- A description of general health effects of lead contamination and community specific resources; and

- If there is not enough water to meet the drinking water needs of the students, teachers and staff, bottled water shall be provided.

Additionally, within two weeks of receiving this report, the results and any lead remediation plans must be made available on the school's website.

This report, and subsequent annual testing reports, must be submitted to the Missouri Department of Health and Senior Services, Healthy Drinking Water Unit, PO Box 570, Jefferson City, MO 65102-0570.

FUTURE TESTING

After the fixtures identified in Table 1, above, have been remediated, at least 25 percent of the remediated fixtures must be sampled annually until all remediated sources have been tested. However, SCI recommends all fixtures be tested once they have been remediated. Once all fixtures have been tested and are below the action level, the school shall test the potable drinking water fixtures once every five years.

SCI appreciates the opportunity to be of service to you on this project, and we look forward to working with you in the future. Please contact us if you have any questions or comments regarding the information provided.

Respectfully,

SCI ENGINEERING, INC.



Brian L. Lieb
Project Scientist




Jessica B. Keeven, CHMM
Senior Scientist

BLL/JBK/rah

Enclosure

Lead Drinking Water Sampling Plan
Lead Testing Results

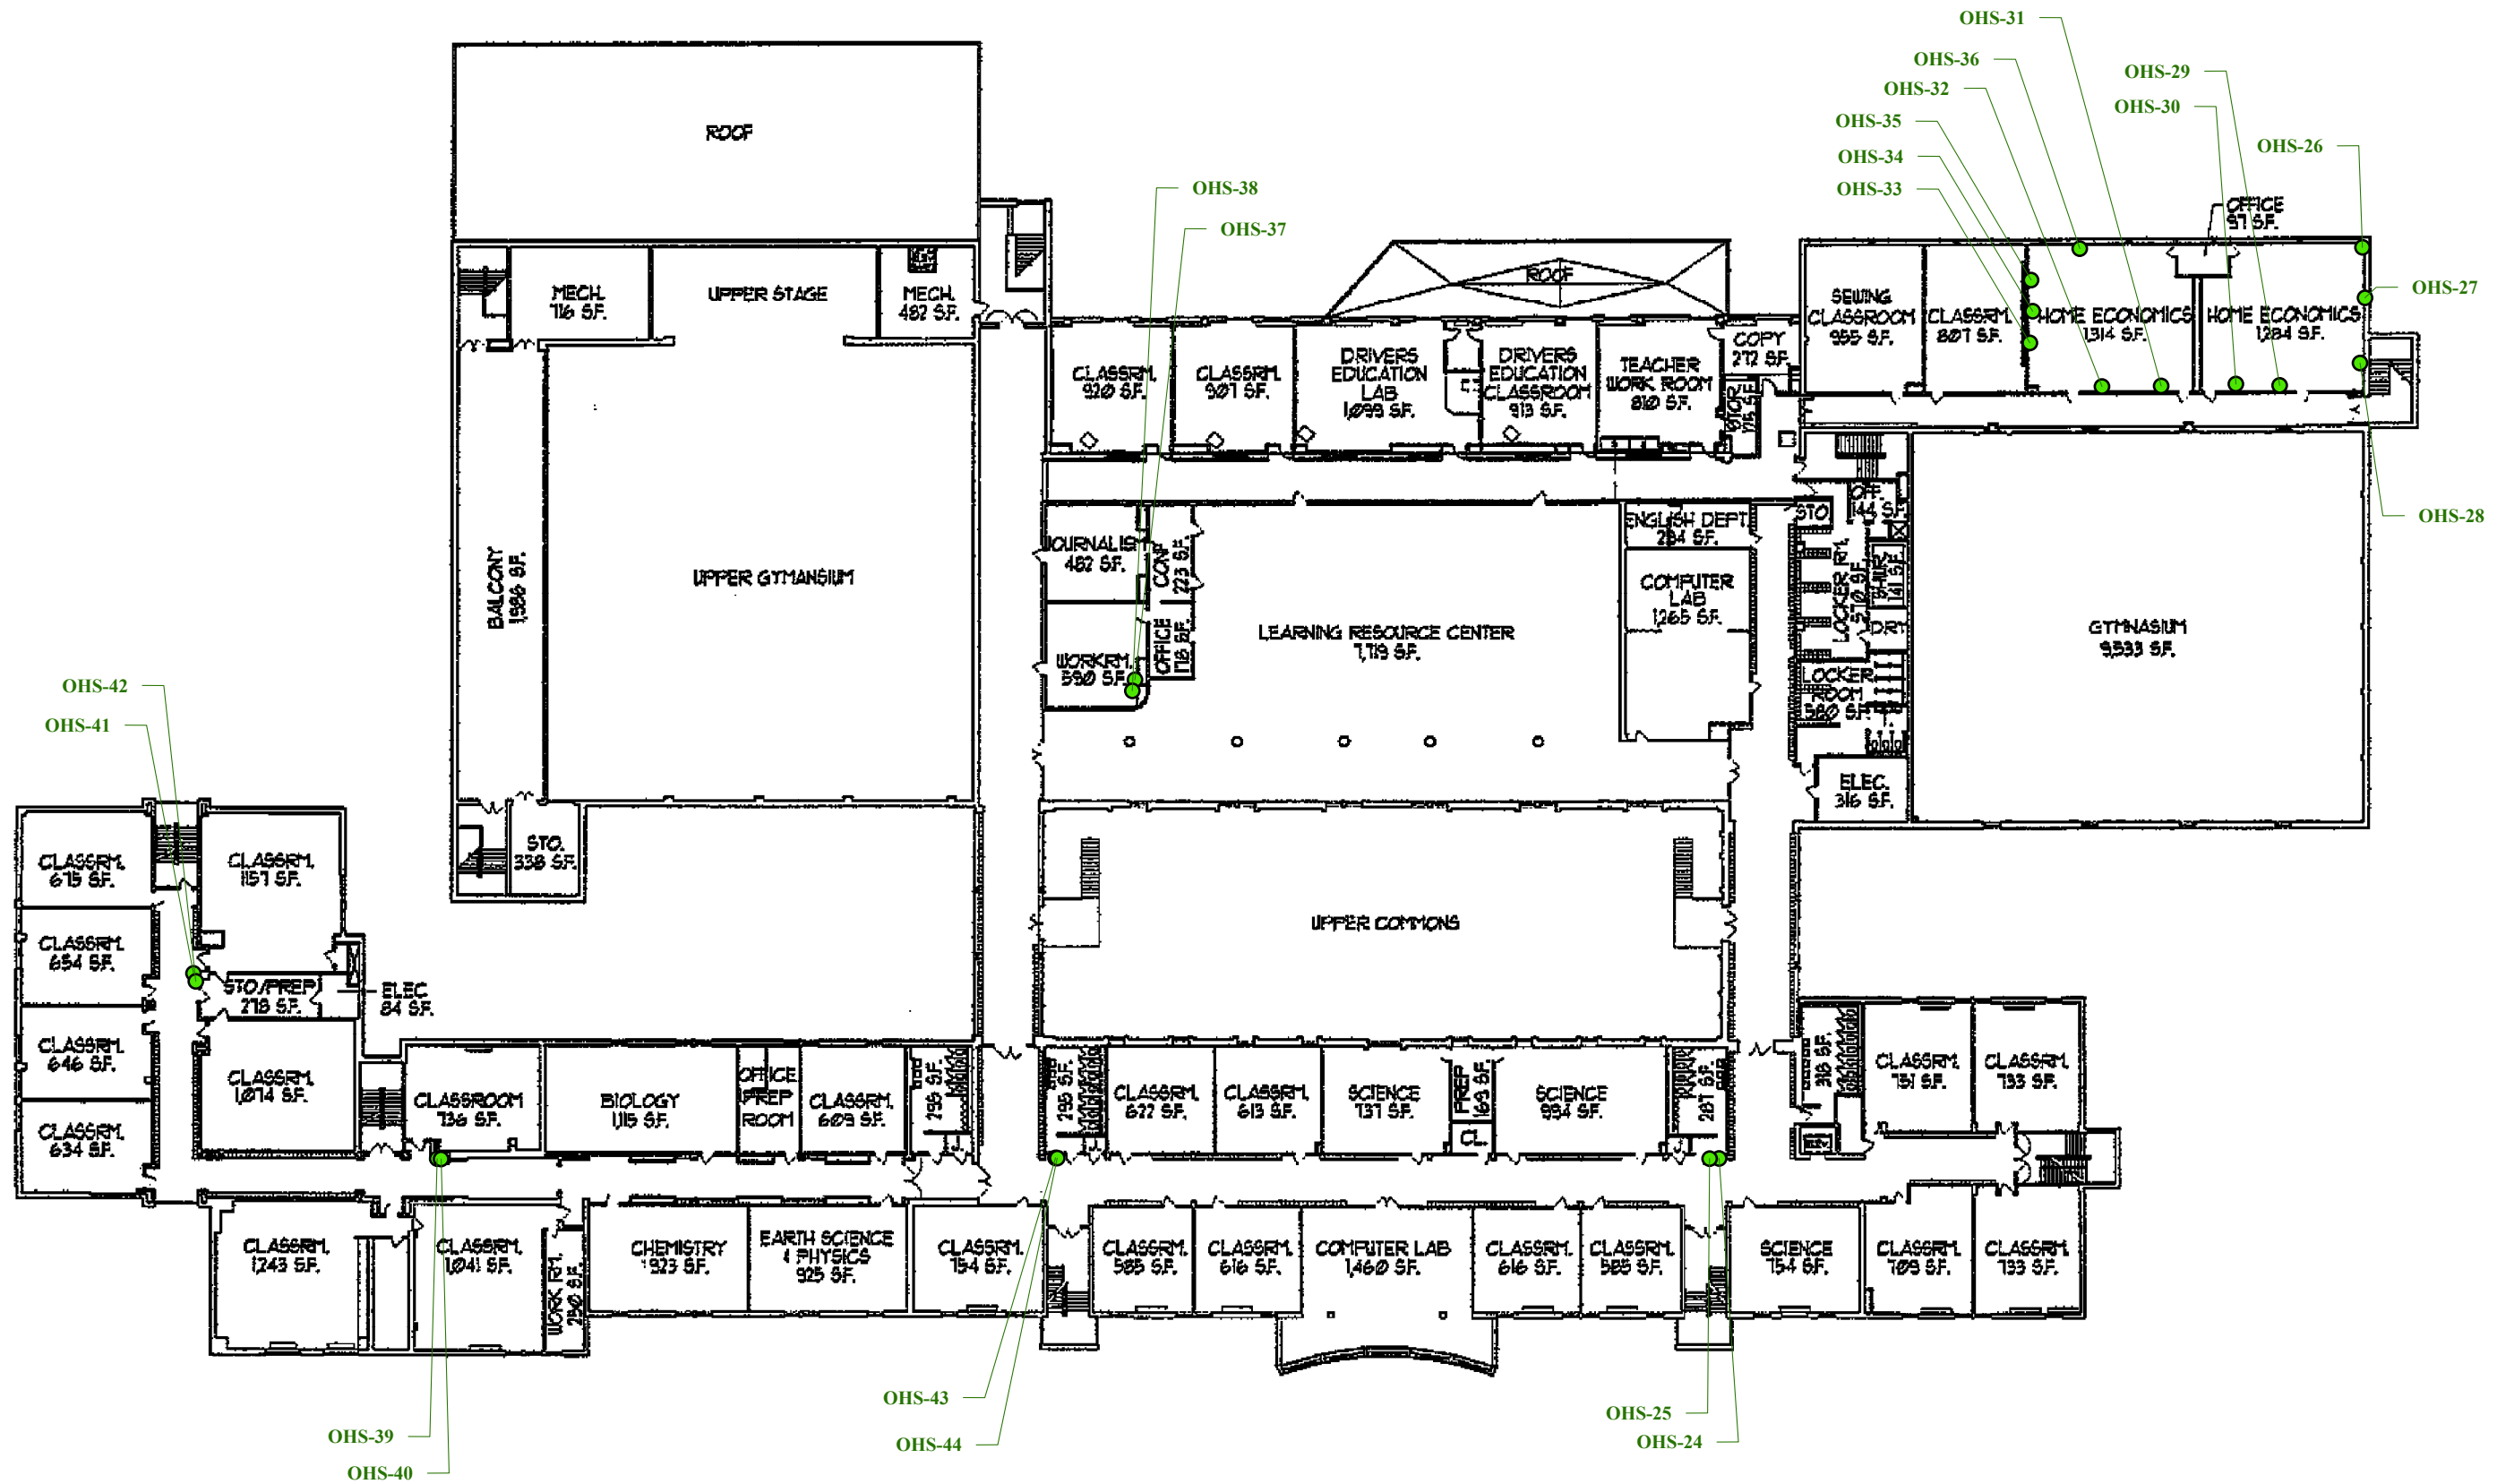


GENERAL NOTES/LEGEND

● RESULTS LESS THAN THE ACTION LEVEL OF 5 PARTS PER BILLION

FLOOR PLANS PROVIDED BY MEHLVILLE SCHOOL DISTRICT. DIMENSIONS AND LOCATIONS ARE APPROXIMATE; ACTUAL MAY VARY. DRAWING SHALL NOT BE USED OUTSIDE THE CONTEXT OF THE REPORT FOR WHICH IT WAS GENERATED.


PROJECT NAME
 MEHLVILLE SCHOOL DISTRICT
 OAKVILLE HIGH SCHOOL - 2ND FLOOR
 ST. LOUIS, MISSOURI

LEAD DRINKING WATER SAMPLING PLAN



JOB NUMBER	2016-0860.2T
FIGURE DATE	02/27/2024
DRAWN BY	JTM
CHECKED BY	BLL
FIGURE	2



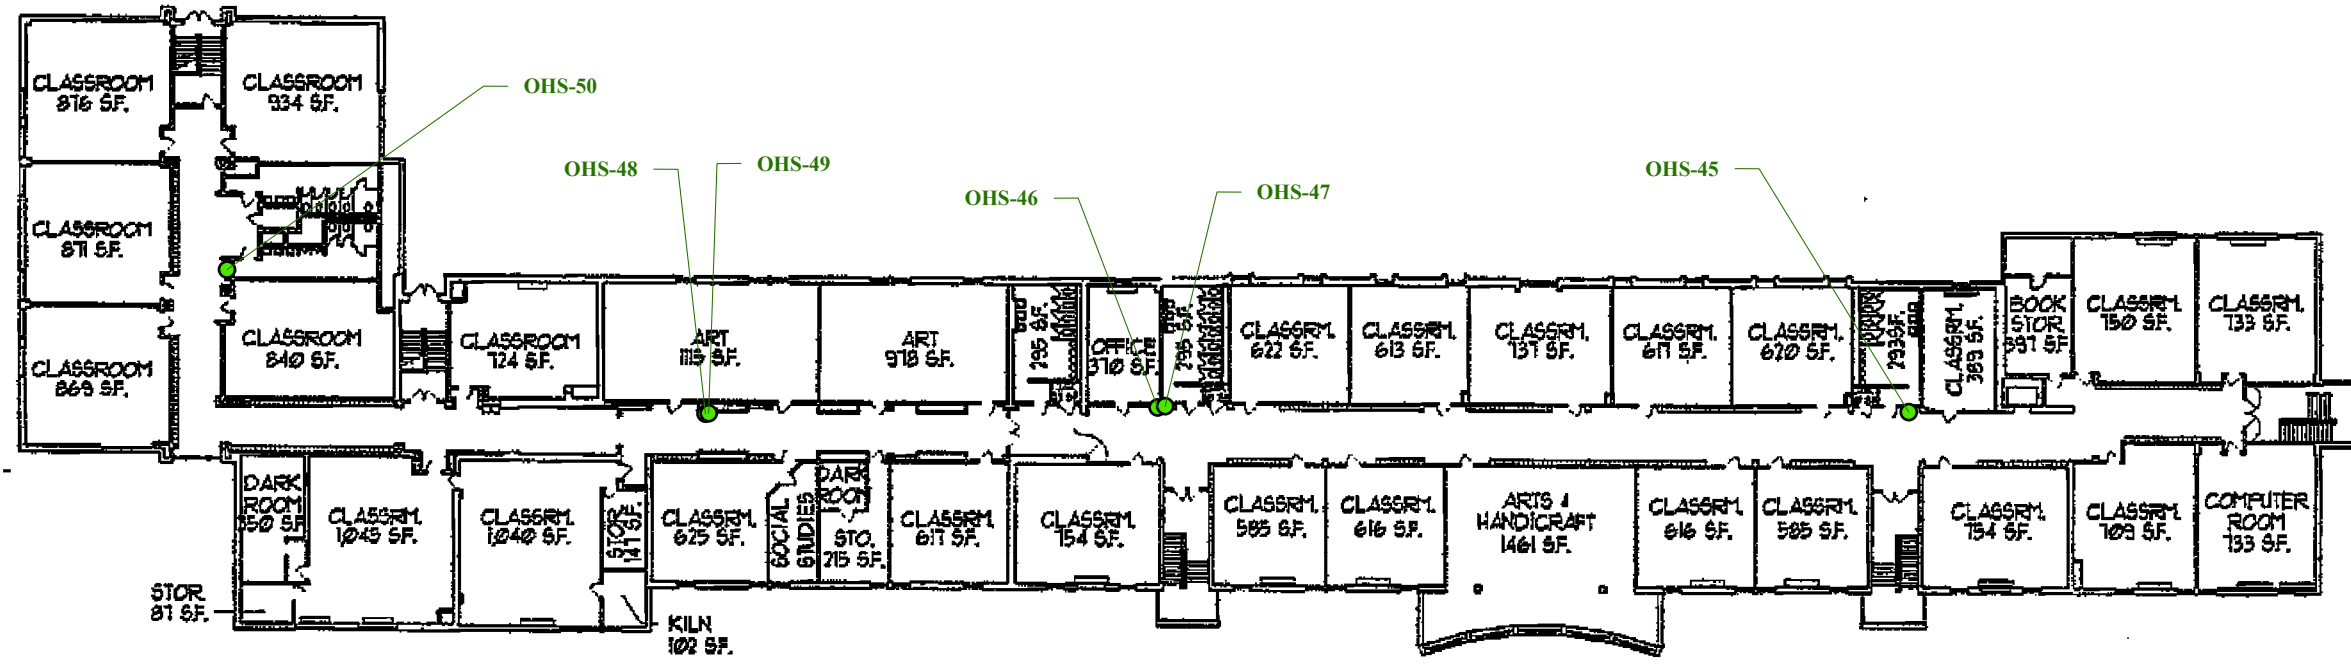


GENERAL NOTES/LEGEND

● RESULTS LESS THAN THE ACTION LEVEL OF 5 PARTS PER BILLION


FLOOR PLANS PROVIDED BY MEHLVILLE SCHOOL DISTRICT. DIMENSIONS AND LOCATIONS ARE APPROXIMATE; ACTUAL MAY VARY. DRAWING SHALL NOT BE USED OUTSIDE THE CONTEXT OF THE REPORT FOR WHICH IT WAS GENERATED.

PROJECT NAME
MEHLVILLE SCHOOL DISTRICT
OAKVILLE HIGH SCHOOL - 3RD FLOOR
ST. LOUIS, MISSOURI

LEAD DRINKING WATER SAMPLING PLAN



JOB NUMBER	2016-0860.2T
FIGURE DATE	02/27/2024
DRAWN BY	JTM
CHECKED BY	BLL
FIGURE	3





Pace Analytical Services, LLC

2231 W. Altorfer Drive

Peoria, IL 61615

(800)752-6651

January 20, 2024

Glenn Grissom
SCI Engineering
130 Point W. Blvd.
St. Chariles, MO 63301

RE: 2016.0860.2T-Oakville High School

Dear Glenn Grissom:

Please find enclosed the analytical results for the **50** sample(s) the laboratory received on **1/4/24 4:30 pm** and logged in under work order **HA00543**. All testing is performed according to our current TNI accreditations unless otherwise noted. This report cannot be reproduced, except in full, without the written permission of Pace Analytical Services, LLC.

If you have any questions regarding your report, please contact your project manager. Quality and timely data is of the utmost importance to us.

Pace Analytical Services appreciates the opportunity to provide you with analytical expertise. We are always trying to improve our customer service and we welcome you to contact the General Manager, Lisa Grant, with any feedback you have about your experience with our laboratory at 309-683-1764 or lisa.grant@pacelabs.com.

A handwritten signature in black ink, appearing to read "Chenise Lambert-Sykes".

Chenise Lambert-Sykes
Project Manager
(314)432-0550
Chenise.Lambert-Sykes@pacelabs.com



SAMPLE RECEIPT CHECK LIST

Items not applicable will be marked as in compliance

Work Order HA00543

YES	Samples received within temperature compliance when applicable
YES	COC present upon sample receipt
YES	COC completed & legible
YES	Sampler name & signature present
YES	Unique sample IDs assigned
YES	Sample collection location recorded
YES	Date & time collected recorded on COC
YES	Relinquished by client signature on COC
YES	COC & labels match
YES	Sample labels are legible
YES	Appropriate bottle(s) received
YES	Sufficient sample volume received
YES	Sample containers received undamaged
NO	Zero headspace, <6 mm present in VOA vials
NO	Trip blank(s) received
YES	All non-field analyses received within holding times
NO	Short hold time analysis
YES	Current PDC COC submitted
NO	Case narrative provided



ANALYTICAL RESULTS

Sample: HA00543-01
Name: OHS-1
Matrix: Drinking Water - Grab

Sampled: 01/02/24 18:40
Received: 01/04/24 16:30

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
Total Metals - PIA									
Lead	< 1.00	ug/L		01/16/24 10:28	1	1.00	01/16/24 17:20	BRS	EPA 200.8 REV 5.4

Sample: HA00543-02
Name: OHS-2
Matrix: Drinking Water - Grab

Sampled: 01/02/24 18:42
Received: 01/04/24 16:30

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
Total Metals - PIA									
Lead	1.36	ug/L		01/16/24 10:28	1	1.00	01/16/24 17:22	BRS	EPA 200.8 REV 5.4

Sample: HA00543-03
Name: OHS-3
Matrix: Drinking Water - Grab

Sampled: 01/02/24 18:46
Received: 01/04/24 16:30

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
Total Metals - PIA									
Lead	< 1.00	ug/L		01/16/24 10:28	1	1.00	01/16/24 17:23	BRS	EPA 200.8 REV 5.4

Sample: HA00543-04
Name: OHS-4
Matrix: Drinking Water - Grab

Sampled: 01/02/24 18:47
Received: 01/04/24 16:30

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
Total Metals - PIA									
Lead	< 1.00	ug/L		01/16/24 10:28	1	1.00	01/16/24 17:28	BRS	EPA 200.8 REV 5.4



ANALYTICAL RESULTS

Sample: HA00543-05
Name: OHS-5
Matrix: Drinking Water - Grab

Sampled: 01/02/24 18:48
Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, < 1.00, ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 17:30, BRS, EPA 200.8 REV 5.4

Sample: HA00543-06
Name: OHS-6
Matrix: Drinking Water - Grab

Sampled: 01/02/24 18:50
Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, 1.36, ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 17:31, BRS, EPA 200.8 REV 5.4

Sample: HA00543-07
Name: OHS-7
Matrix: Drinking Water - Grab

Sampled: 01/02/24 18:51
Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, 5.87, ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 17:33, BRS, EPA 200.8 REV 5.4

Sample: HA00543-08
Name: OHS-8
Matrix: Drinking Water - Grab

Sampled: 01/02/24 18:52
Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, < 1.00, ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 17:34, BRS, EPA 200.8 REV 5.4



ANALYTICAL RESULTS

Sample: HA00543-09
Name: OHS-9
Matrix: Drinking Water - Grab

Sampled: 01/02/24 18:56

Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Total Metals - PIA

Table row for Lead: < 1.00 ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 17:36, BRS, EPA 200.8 REV 5.4

Sample: HA00543-10
Name: OHS-10
Matrix: Drinking Water - Grab

Sampled: 01/02/24 18:57

Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Total Metals - PIA

Table row for Lead: 1.20 ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 17:38, BRS, EPA 200.8 REV 5.4

Sample: HA00543-11
Name: OHS-11
Matrix: Drinking Water - Grab

Sampled: 01/02/24 18:59

Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Total Metals - PIA

Table row for Lead: < 1.00 ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 17:42, BRS, EPA 200.8 REV 5.4

Sample: HA00543-12
Name: OHS-12
Matrix: Drinking Water - Grab

Sampled: 01/02/24 19:00

Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Total Metals - PIA

Table row for Lead: 6.94 ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 17:47, BRS, EPA 200.8 REV 5.4



ANALYTICAL RESULTS

Sample: HA00543-13
Name: OHS-13
Matrix: Drinking Water - Grab

Sampled: 01/02/24 19:04
Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, < 1.00, ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 17:48, BRS, EPA 200.8 REV 5.4

Sample: HA00543-14
Name: OHS-14
Matrix: Drinking Water - Grab

Sampled: 01/02/24 19:05
Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, < 1.00, ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 17:50, BRS, EPA 200.8 REV 5.4

Sample: HA00543-15
Name: OHS-15
Matrix: Drinking Water - Grab

Sampled: 01/02/24 19:08
Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, < 1.00, ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 17:52, BRS, EPA 200.8 REV 5.4

Sample: HA00543-16
Name: OHS-16
Matrix: Drinking Water - Grab

Sampled: 01/02/24 19:09
Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, < 1.00, ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 17:53, BRS, EPA 200.8 REV 5.4



ANALYTICAL RESULTS

Sample: HA00543-17
Name: OHS-17
Matrix: Drinking Water - Grab

Sampled: 01/02/24 19:11
Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, < 1.00, ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 17:55, BRS, EPA 200.8 REV 5.4

Sample: HA00543-18
Name: OHS-18
Matrix: Drinking Water - Grab

Sampled: 01/02/24 19:14
Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, < 1.00, ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 17:56, BRS, EPA 200.8 REV 5.4

Sample: HA00543-19
Name: OHS-19
Matrix: Drinking Water - Grab

Sampled: 01/02/24 19:15
Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, < 1.00, ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 17:58, BRS, EPA 200.8 REV 5.4

Sample: HA00543-20
Name: OHS-20
Matrix: Drinking Water - Grab

Sampled: 01/02/24 19:17
Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, < 1.00, ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 17:59, BRS, EPA 200.8 REV 5.4



ANALYTICAL RESULTS

Sample: HA00543-21
Name: OHS-21
Matrix: Drinking Water - Grab

Sampled: 01/02/24 19:19
Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, < 1.00, ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 18:07, BRS, EPA 200.8 REV 5.4

Sample: HA00543-22
Name: OHS-22
Matrix: Drinking Water - Grab

Sampled: 01/02/24 19:20
Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, < 1.00, ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 18:09, BRS, EPA 200.8 REV 5.4

Sample: HA00543-23
Name: OHS-23
Matrix: Drinking Water - Grab

Sampled: 01/02/24 19:21
Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, 5.46, ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 18:10, BRS, EPA 200.8 REV 5.4

Sample: HA00543-24
Name: OHS-24
Matrix: Drinking Water - Grab

Sampled: 01/02/24 19:25
Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, < 1.00, ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 18:12, BRS, EPA 200.8 REV 5.4



ANALYTICAL RESULTS

Sample: HA00543-25
Name: OHS-25
Matrix: Drinking Water - Grab

Sampled: 01/02/24 19:26

Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Total Metals - PIA

Table row for Lead: Lead, < 1.00, ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 18:13, BRS, EPA 200.8 REV 5.4

Sample: HA00543-26
Name: OHS-26
Matrix: Drinking Water - Grab

Sampled: 01/02/24 19:29

Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Total Metals - PIA

Table row for Lead: Lead, 3.18, ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 18:15, BRS, EPA 200.8 REV 5.4

Sample: HA00543-27
Name: OHS-27
Matrix: Drinking Water - Grab

Sampled: 01/02/24 19:30

Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Total Metals - PIA

Table row for Lead: Lead, 2.08, ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 18:16, BRS, EPA 200.8 REV 5.4

Sample: HA00543-28
Name: OHS-28
Matrix: Drinking Water - Grab

Sampled: 01/02/24 19:31

Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Total Metals - PIA

Table row for Lead: Lead, 2.63, ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 18:18, BRS, EPA 200.8 REV 5.4



ANALYTICAL RESULTS

Sample: HA00543-29
Name: OHS-29
Matrix: Drinking Water - Grab

Sampled: 01/02/24 19:32
Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, 2.22, ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 18:20, BRS, EPA 200.8 REV 5.4

Sample: HA00543-30
Name: OHS-30
Matrix: Drinking Water - Grab

Sampled: 01/02/24 19:33
Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, 2.47, ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 18:24, BRS, EPA 200.8 REV 5.4

Sample: HA00543-31
Name: OHS-31
Matrix: Drinking Water - Grab

Sampled: 01/02/24 19:38
Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, 1.44, ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 18:29, BRS, EPA 200.8 REV 5.4

Sample: HA00543-32
Name: OHS-32
Matrix: Drinking Water - Grab

Sampled: 01/02/24 19:39
Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, 1.76, ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 18:31, BRS, EPA 200.8 REV 5.4



ANALYTICAL RESULTS

Sample: HA00543-33
Name: OHS-33
Matrix: Drinking Water - Grab

Sampled: 01/02/24 19:41
Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, 3.77, ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 18:32, BRS, EPA 200.8 REV 5.4

Sample: HA00543-34
Name: OHS-34
Matrix: Drinking Water - Grab

Sampled: 01/02/24 19:41
Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, 4.52, ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 18:34, BRS, EPA 200.8 REV 5.4

Sample: HA00543-35
Name: OHS-35
Matrix: Drinking Water - Grab

Sampled: 01/02/24 19:42
Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, 3.39, ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 18:35, BRS, EPA 200.8 REV 5.4

Sample: HA00543-36
Name: OHS-36
Matrix: Drinking Water - Grab

Sampled: 01/02/24 19:45
Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method. Row 1: Lead, < 1.00, ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 18:37, BRS, EPA 200.8 REV 5.4



ANALYTICAL RESULTS

Sample: HA00543-37
Name: OHS-37
Matrix: Drinking Water - Grab

Sampled: 01/02/24 19:52

Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Total Metals - PIA

Table row for Lead: 2.41 ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 18:38, BRS, EPA 200.8 REV 5.4

Sample: HA00543-38
Name: OHS-38
Matrix: Drinking Water - Grab

Sampled: 01/02/24 19:53

Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Total Metals - PIA

Table row for Lead: 3.51 ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 18:43, BRS, EPA 200.8 REV 5.4

Sample: HA00543-39
Name: OHS-39
Matrix: Drinking Water - Grab

Sampled: 01/02/24 19:57

Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Total Metals - PIA

Table row for Lead: < 1.00 ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 18:45, BRS, EPA 200.8 REV 5.4

Sample: HA00543-40
Name: OHS-40
Matrix: Drinking Water - Grab

Sampled: 01/02/24 19:58

Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Total Metals - PIA

Table row for Lead: < 1.00 ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 18:46, BRS, EPA 200.8 REV 5.4



ANALYTICAL RESULTS

Sample: HA00543-41
Name: OHS-41
Matrix: Drinking Water - Grab

Sampled: 01/02/24 20:00

Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Total Metals - PIA

Table row for Lead: < 1.00 ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 18:51, BRS, EPA 200.8 REV 5.4

Sample: HA00543-42
Name: OHS-42
Matrix: Drinking Water - Grab

Sampled: 01/02/24 20:01

Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Total Metals - PIA

Table row for Lead: < 1.00 ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 18:52, BRS, EPA 200.8 REV 5.4

Sample: HA00543-43
Name: OHS-43
Matrix: Drinking Water - Grab

Sampled: 01/02/24 20:03

Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Total Metals - PIA

Table row for Lead: 4.96 ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 18:54, BRS, EPA 200.8 REV 5.4

Sample: HA00543-44
Name: OHS-44
Matrix: Drinking Water - Grab

Sampled: 01/02/24 20:04

Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Total Metals - PIA

Table row for Lead: 1.31 ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 18:56, BRS, EPA 200.8 REV 5.4



ANALYTICAL RESULTS

Sample: HA00543-45
Name: OHS-45
Matrix: Drinking Water - Grab

Sampled: 01/02/24 20:08

Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Total Metals - PIA

Table row for Lead: 1.42 ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 18:57, BRS, EPA 200.8 REV 5.4

Sample: HA00543-46
Name: OHS-46
Matrix: Drinking Water - Grab

Sampled: 01/02/24 20:11

Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Total Metals - PIA

Table row for Lead: < 1.00 ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 19:02, BRS, EPA 200.8 REV 5.4

Sample: HA00543-47
Name: OHS-47
Matrix: Drinking Water - Grab

Sampled: 01/02/24 20:12

Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Total Metals - PIA

Table row for Lead: < 1.00 ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 19:03, BRS, EPA 200.8 REV 5.4

Sample: HA00543-48
Name: OHS-48
Matrix: Drinking Water - Grab

Sampled: 01/02/24 20:13

Received: 01/04/24 16:30

Table with 10 columns: Parameter, Result, Unit, Qualifier, Prepared, Dilution, MRL, Analyzed, Analyst, Method

Total Metals - PIA

Table row for Lead: < 1.00 ug/L, 01/16/24 10:28, 1, 1.00, 01/16/24 19:05, BRS, EPA 200.8 REV 5.4



ANALYTICAL RESULTS

Sample: HA00543-49
Name: OHS-49
Matrix: Drinking Water - Grab

Sampled: 01/02/24 20:14
Received: 01/04/24 16:30

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
Total Metals - PIA									
Lead	< 1.00	ug/L		01/16/24 10:28	1	1.00	01/16/24 19:06	BRS	EPA 200.8 REV 5.4

Sample: HA00543-50
Name: OHS-50
Matrix: Drinking Water - Grab

Sampled: 01/02/24 20:15
Received: 01/04/24 16:30

Parameter	Result	Unit	Qualifier	Prepared	Dilution	MRL	Analyzed	Analyst	Method
Total Metals - PIA									
Lead	< 1.00	ug/L		01/16/24 10:28	1	1.00	01/16/24 19:08	BRS	EPA 200.8 REV 5.4



QC SAMPLE RESULTS

Parameter	Result	Unit	Qual	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit
Batch B423188 - DW 200.8 no prep - EPA 200.8 REV 5.4									
Blank (B423188-BLK1)				Prepared & Analyzed: 01/16/24					
Lead	< 1.00	ug/L							
LCS (B423188-BS1)				Prepared & Analyzed: 01/16/24					
Lead	53.7	ug/L		50.00		107	85-115		
Matrix Spike (B423188-MS1)				Sample: HA00539-10 Prepared & Analyzed: 01/16/24					
Lead	53.7	ug/L		50.00	1.63	104	70-130		
Matrix Spike (B423188-MS2)				Sample: HA00539-20 Prepared & Analyzed: 01/16/24					
Lead	60.4	ug/L		50.00	9.24	102	70-130		
Matrix Spike (B423188-MS3)				Sample: HA00539-30 Prepared & Analyzed: 01/16/24					
Lead	56.2	ug/L		50.00	ND	112	70-130		
Matrix Spike (B423188-MS4)				Sample: HA00539-34 Prepared & Analyzed: 01/16/24					
Lead	53.4	ug/L		50.00	ND	107	70-130		
Matrix Spike (B423188-MS5)				Sample: HA00541-07 Prepared & Analyzed: 01/16/24					
Lead	54.2	ug/L		50.00	1.89	105	70-130		
Matrix Spike (B423188-MS6)				Sample: HA00541-17 Prepared & Analyzed: 01/16/24					
Lead	52.3	ug/L		50.00	ND	105	70-130		
Matrix Spike (B423188-MS7)				Sample: HA00541-27 Prepared & Analyzed: 01/16/24					
Lead	75.1	ug/L		50.00	24.3	102	70-130		
Matrix Spike (B423188-MS8)				Sample: HA00541-37 Prepared & Analyzed: 01/16/24					
Lead	54.0	ug/L		50.00	1.22	106	70-130		
Matrix Spike (B423188-MS9)				Sample: HA00541-47 Prepared & Analyzed: 01/16/24					
Lead	51.9	ug/L		50.00	0.753	102	70-130		
Matrix Spike (B423188-MSA)				Sample: HA00541-59 Prepared & Analyzed: 01/16/24					
Lead	52.0	ug/L		50.00	ND	104	70-130		
Matrix Spike (B423188-MSB)				Sample: HA00543-10 Prepared & Analyzed: 01/16/24					
Lead	58.3	ug/L		50.00	1.20	114	70-130		
Matrix Spike (B423188-MSC)				Sample: HA00543-20 Prepared & Analyzed: 01/16/24					
Lead	57.3	ug/L		50.00	0.120	114	70-130		
Matrix Spike (B423188-MSD)				Sample: HA00543-30 Prepared & Analyzed: 01/16/24					
Lead	57.1	ug/L		50.00	2.47	109	70-130		
Matrix Spike Dup (B423188-MSD1)				Sample: HA00539-10 Prepared & Analyzed: 01/16/24					
Lead	54.2	ug/L		50.00	1.63	105	70-130	1	20
Matrix Spike Dup (B423188-MSD2)				Sample: HA00539-20 Prepared & Analyzed: 01/16/24					
Lead	60.3	ug/L		50.00	9.24	102	70-130	0.2	20
Matrix Spike Dup (B423188-MSD3)				Sample: HA00539-30 Prepared & Analyzed: 01/16/24					
Lead	53.9	ug/L		50.00	ND	108	70-130	4	20
Matrix Spike Dup (B423188-MSD4)				Sample: HA00539-34 Prepared & Analyzed: 01/16/24					
Lead	51.5	ug/L		50.00	ND	103	70-130	4	20
Matrix Spike Dup (B423188-MSD5)				Sample: HA00541-07 Prepared & Analyzed: 01/16/24					
Lead	52.3	ug/L		50.00	1.89	101	70-130	4	20
Matrix Spike Dup (B423188-MSD6)				Sample: HA00541-17 Prepared & Analyzed: 01/16/24					
Lead	52.9	ug/L		50.00	ND	106	70-130	1	20
Matrix Spike Dup (B423188-MSD7)				Sample: HA00541-27 Prepared & Analyzed: 01/16/24					
Lead	75.1	ug/L		50.00	24.3	102	70-130	0.02	20



QC SAMPLE RESULTS

Parameter	Result	Unit	Qual	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit
Matrix Spike Dup (B423188-MSD8)	Sample: HA00541-37			Prepared & Analyzed: 01/16/24					
Lead	52.8	ug/L		50.00	1.22	103	70-130	2	20
Matrix Spike Dup (B423188-MSD9)	Sample: HA00541-47			Prepared & Analyzed: 01/16/24					
Lead	53.0	ug/L		50.00	0.753	104	70-130	2	20
Matrix Spike Dup (B423188-MSDA)	Sample: HA00541-59			Prepared & Analyzed: 01/16/24					
Lead	53.2	ug/L		50.00	ND	106	70-130	2	20
Matrix Spike Dup (B423188-MSDB)	Sample: HA00543-10			Prepared & Analyzed: 01/16/24					
Lead	58.1	ug/L		50.00	1.20	114	70-130	0.4	20
Matrix Spike Dup (B423188-MSDC)	Sample: HA00543-20			Prepared & Analyzed: 01/16/24					
Lead	58.0	ug/L		50.00	0.120	116	70-130	1	20
Matrix Spike Dup (B423188-MSDD)	Sample: HA00543-30			Prepared & Analyzed: 01/16/24					
Lead	57.3	ug/L		50.00	2.47	110	70-130	0.4	20
Matrix Spike Dup (B423188-MSDE)	Sample: HA00543-40			Prepared & Analyzed: 01/16/24					
Lead	56.4	ug/L		50.00	ND	113	70-130	0.5	20
Matrix Spike Dup (B423188-MSDF)	Sample: HA00543-50			Prepared & Analyzed: 01/16/24					
Lead	56.8	ug/L		50.00	0.167	113	70-130	0.8	20
Matrix Spike (B423188-MSE)	Sample: HA00543-40			Prepared & Analyzed: 01/16/24					
Lead	56.1	ug/L		50.00	ND	112	70-130		
Matrix Spike (B423188-MSF)	Sample: HA00543-50			Prepared & Analyzed: 01/16/24					
Lead	57.2	ug/L		50.00	0.167	114	70-130		



NOTES

Specifications regarding method revisions, method modifications, and calculations used for analysis are available upon request. Please contact your project manager.

* Not a TNI accredited analyte

Certifications

CHI - McHenry, IL - 4314-A W. Crystal Lake Road, McHenry, IL 60050

TNI Accreditation for Drinking Water and Wastewater Fields of Testing through IL EPA Accreditation No. 100279

Illinois Department of Public Health Bacterial Analysis in Drinking Water Approved Laboratory Registry No. 17556

PIA - Peoria, IL - 2231 W. Altorfer Drive, Peoria, IL 61615

TNI Accreditation for Drinking Water, Wastewater, Solid and Hazardous Material Fields of Testing through IL EPA Accreditation No. 100230

Illinois Department of Public Health Bacterial Analysis in Drinking Water Approved Laboratory Registry No. 17553

Drinking Water Certifications/Accreditations: Iowa (240); Kansas (E-10338); Missouri (870)

Wastewater Certifications/Accreditations: Arkansas (88-0677); Iowa (240); Kansas (E-10338)

Solid and Hazardous Material Certifications/Accreditations: Arkansas (88-0677); Iowa (240); Kansas (E-10338)

SPMO - Springfield, MO - 1805 W Sunset Street, Springfield, MO 65807

USEPA DMR-QA Program

STL - Hazelwood, MO - 944 Anglum Rd, Hazelwood, MO 63042

TNI Accreditation for Wastewater, Solid and Hazardous Material Fields of Testing through KS KDHE Certification No. E-10389

TNI Accreditation for Wastewater, Solid and Hazardous Material Fields of Testing through IL EPA Accreditation No. - 200080

Illinois Department of Public Health Bacterial Analysis in Drinking Water Approved Laboratory, Registry No. 171050

Missouri Department of Natural Resources - Certificate of Approval for Microbiological Laboratory Service - No. 1050



Certified by: Chenise Lambert-Sykes, Project Manager

REGULATORY PROGRAM (CIRCLE):	NPDES
MORBCA	RCRA
CCDD	TACO: RES OR IND/COMM

ALL HIGHLIGHTED AREAS MUST BE COMPLETED BY CLIENT (PLEASE PRINT)

1 CLIENT SCI Engineering ADDRESS 130 Point West Blvd CITY STATE ZIP St. Charles, MO 63301 CONTACT PERSON Brian Lieb		PROJECT NUMBER 2016-0860.2T PHONE NUMBER (314) 581-7570		PROJECT LOCATION Oakville HS E-MAIL blieb@sciengineering.com		PURCHASE ORDER # DATE SHIPPED 		3 ANALYSIS REQUESTED + + DW Pb Turb Check				4 (FOR LAB USE ONLY) LOGIN # <u>HA00543</u> LOGGED BY: <u>ges</u> CLIENT: <u>SCI Engineering</u> PROJECT: <u>Drinking Water Lead</u> PROJ. MGR.: <u>Chenise Lambert-Sykes</u> CUSTODY SEAL #: _____	
2 SAMPLE DESCRIPTION (UNIQUE DESCRIPTION AS IT WILL APPEAR ON THE ANALYTICAL REPORT)		DATE COLLECTED	TIME COLLECTED	SAMPLE TYPE		MATRIX TYPE	BOTTLE COUNT	PRES CODE CLIENT PROVIDED	DW Pb	Turb Check	REMARKS		
OHS-1		1/2/24	1840	X		DW	1	6	X	X			
OHS-2		1/2/24	1842	X		DW	1	6	X	X			
OHS-3		1/2/24	1846	X		DW	1	6	X	X			
OHS-4		1/2/24	1847	X		DW	1	6	X	X			
OHS-5		1/2/24	1848	X		DW	1	6	X	X			
OHS-6		1/2/24	1850	X		DW	1	6	X	X			
OHS-7		1/2/24	1851	X		DW	1	6	X	X			
OHS-8		1/2/24	1852	X		DW	1	6	X	X			
OHS-9		1/2/24	1856	X		DW	1	6	X	X			
OHS-10		1/2/24	1857	X		DW	1	6	X	X			
OHS-11		1/2/24	1859	X		DW	1	6	X	X			
CHEMICAL PRESERVATION CODES: 1 - HCL 2 - H2SO4 3 - HNO3 4 - NAOH 5 - NA2S2O3 6 - UNPRESERVED 7 - OTHER													
5 TURNAROUND TIME REQUESTED (PLEASE CIRCLE) NORMAL RUSH (RUSH TAT IS SUBJECT TO PACE LABS APPROVAL AND SURCHARGE) RUSH RESULTS VIA (PLEASE CIRCLE) EMAIL PHONE EMAIL IF DIFFERENT FROM ABOVE: PHONE # IF DIFFERENT FROM ABOVE:						DATE RESULTS NEEDED		6 I understand that by initialing this box I give the lab permission to proceed with analysis, even though it may not meet all sample conformance requirements as defined in the receiving facility's Sample Acceptance Policy and the data will be qualified. Qualified data may <u>NOT</u> be acceptable to report to all regulatory authorities. PROCEED WITH ANALYSIS AND QUALIFY RESULTS: (INITIALS) _____					
7 RELINQUISHED BY: (SIGNATURE) <u>Kieran Kleinhenz</u>		DATE	RECEIVED BY: (SIGNATURE)				DATE	8 COMMENTS: (FOR LAB USE ONLY)					
		TIME	<u>[Signature]</u>				1-4-24						
RELINQUISHED BY: (SIGNATURE)		DATE	RECEIVED BY: (SIGNATURE)				TIME	SAMPLE TEMPERATURE UPON RECEIPT _____ °C					
<u>[Signature]</u>		1-4-24	<u>[Signature]</u>				10:15	CHILL PROCESS STARTED PRIOR TO RECEIPT Y OR N					
		TIME						SAMPLE(S) RECEIVED ON ICE Y OR N					
RELINQUISHED BY: (SIGNATURE)		DATE	RECEIVED BY: (SIGNATURE)				TIME	SAMPLE ACCEPTANCE NONCONFORMANT REPORT IS NEEDED Y OR N					
<u>[Signature]</u>		1/2/24	<u>[Signature]</u>				10:30	DATE AND TIME TAKEN FROM SAMPLE BOTTLE _____					
		TIME											

三
三
三

REGULATORY PROGRAM (CIRCLE):	NPDES
MORBCA	RCRA
CCDD	TACO: RES OR IND/COMM

ALL HIGHLIGHTED AREAS MUST BE COMPLETED BY CLIENT (PLEASE PRINT)

1 CLIENT SCI Engineering		PROJECT NUMBER 2016-0860.2T		PROJECT LOCATION Oakville HS		PURCHASE ORDER #		3 ANALYSIS REQUESTED				4 (FOR LAB USE ONLY) LOGIN # <u>HA00513</u> LOGGED BY: <u>[Signature]</u> CLIENT: SCI Engineering PROJECT: Drinking Water Lead PROJ. MGR.: Chenise Lambert-Sykes CUSTODY SEAL #: _____			
ADDRESS 130 Point West Blvd		PHONE NUMBER (314) 581-7570		E-MAIL bliieb@sciengineering.com		DATE SHIPPED		<input checked="" type="checkbox"/> DW Pb <input checked="" type="checkbox"/> Turb Check				REMARKS			
CITY STATE ZIP St. Charles, MO 63301		SAMPLER (PLEASE PRINT) Kieran Kleinhenz		SAMPLER'S SIGNATURE		MATRIX TYPES: WW- WASTEWATER DW- DRINKING WATER GW- GROUND WATER WWSL- SLUDGE NAS- NON AQUEOUS SOLID LCHT- LEACHATE OIL-OIL SO-SOIL SOL-SOLID									
CONTACT PERSON Brian Lieb		DATE COLLECTED		TIME COLLECTED		SAMPLE TYPE GRAB COMP		MATRIX TYPE		BOTTLE COUNT		PRES CODE CLIENT PROVIDED			
2 SAMPLE DESCRIPTION (UNIQUE DESCRIPTION AS IT WILL APPEAR ON THE ANALYTICAL REPORT)															
OHS-12		1/2/24		1900		X		DW		1		6		X X	
OHS-13		1/2/24		1904		X		DW		1		6		X X	
OHS-14		1/2/24		1905		X		DW		1		6		X X	
OHS-15		1/2/24		1908		X		DW		1		6		X X	
OHS-16		1/2/24		1909		X		DW		1		6		X X	
OHS-17		1/2/24		1911		X		DW		1		6		X X	
OHS-18		1/2/24		1914		X		DW		1		6		X X	
OHS-19		1/2/24		1915		X		DW		1		6		X X	
OHS-20		1/2/24		1917		X		DW		1		6		X X	
OHS-21		1/2/24		1919		X		DW		1		6		X X	
OHS-22		1/2/24		1920		X		DW		1		6		X X	
CHEMICAL PRESERVATION CODES: 1 - HCL 2 - H2SO4 3 - HNO3 4 - NAOH 5 - NA2S2O3 6 - UNPRESERVED 7 - OTHER															
5 TURNAROUND TIME REQUESTED (PLEASE CIRCLE) NORMAL RUSH (RUSH TAT IS SUBJECT TO PACE LABS APPROVAL AND SURCHARGE)				DATE RESULTS NEEDED				6 I understand that by initialing this box I give the lab permission to proceed with analysis, even though it may not meet all sample conformance requirements as defined in the receiving facility's Sample Acceptance Policy and the data will be qualified. Qualified data may NOT be acceptable to report to all regulatory authorities.				PROCEED WITH ANALYSIS AND QUALIFY RESULTS: (INITIALS) _____			
RUSH RESULTS VIA (PLEASE CIRCLE) EMAIL PHONE															
EMAIL IF DIFFERENT FROM ABOVE: PHONE # IF DIFFERENT FROM ABOVE:															
7 RELINQUISHED BY: (SIGNATURE) <u>[Signature]</u>		DATE TIME		RECEIVED BY: (SIGNATURE) <u>[Signature]</u>		DATE TIME		8 COMMENTS: (FOR LAB USE ONLY)							
RELINQUISHED BY: (SIGNATURE) <u>[Signature]</u>		DATE 1-4-24 TIME 1000		RECEIVED BY: (SIGNATURE) <u>[Signature]</u>		DATE TIME		SAMPLE TEMPERATURE UPON RECEIPT _____ °C							
RELINQUISHED BY: (SIGNATURE) <u>[Signature]</u>		DATE TIME		RECEIVED BY: (SIGNATURE) <u>[Signature]</u>		DATE 1/4/24 TIME 1630		CHILL PROCESS STARTED PRIOR TO RECEIPT Y OR N SAMPLE(S) RECEIVED ON ICE Y OR N SAMPLE ACCEPTANCE NONCONFORMANT REPORT IS NEEDED Y OR N							
								DATE AND TIME TAKEN FROM SAMPLE BOTTLE _____							

REGULATORY PROGRAM (CIRCLE):	NPDES
MORBCA	RCRA
CCDD	TACO: RES OR IND/COMM

ALL HIGHLIGHTED AREAS MUST BE COMPLETED BY CLIENT (PLEASE PRINT)

1 CLIENT SCI Engineering		PROJECT NUMBER 2016-0860.2T		PROJECT LOCATION Oakville HS		PURCHASE ORDER #		3 ANALYSIS REQUESTED				4 (FOR LAB USE ONLY) LOGIN # <u>HA00543</u> LOGGED BY: <u>[Signature]</u> CLIENT: SCI Engineering PROJECT: Drinking Water Lead PROJ. MGR.: Chenise Lambert-Sykes CUSTODY SEAL #:			
ADDRESS 130 Point West Blvd		PHONE NUMBER (314) 581-7570		E-MAIL blieb@sciengineering.com		DATE SHIPPED		<input checked="" type="checkbox"/> DW Pb <input checked="" type="checkbox"/> Turb Check				REMARKS			
CITY STATE ZIP St. Charles, MO 63301		SAMPLER (PLEASE PRINT) Kieran Kleinhenz		SAMPLER'S SIGNATURE		MATRIX TYPES: WW- WASTEWATER DW- DRINKING WATER GW- GROUND WATER WWSL- SLUDGE NAS- NON AQUEOUS SOLID LCHT-LEACHATE OIL-OIL SO-SOIL SOL-SOLID									
CONTACT PERSON Brian Lieb		DATE COLLECTED		TIME COLLECTED		SAMPLE TYPE GRAB COMP		MATRIX TYPE		BOTTLE COUNT		PRES CODE CLIENT PROVIDED		REMARKS	
OHS-34		1/2/24		1941		X		DW		1		6		X X	
OHS-35		1/2/24		1942		X		DW		1		6		X X	
OHS-36		1/2/24		1945		X		DW		1		6		X X	
OHS-37		1/2/24		1952		X		DW		1		6		X X	
OHS-38		1/2/24		1953		X		DW		1		6		X X	
OHS-39		1/2/24		1957		X		DW		1		6		X X	
OHS-40		1/2/24		1958		X		DW		1		6		X X	
OHS-41		1/2/24		2000		X		DW		1		6		X X	
OHS-42		1/2/24		2001		X		DW		1		6		X X	
OHS-43		1/2/24		2003		X		DW		1		6		X X	
OHS-44		1/2/24		2004		X		DW		1		6		X X	
CHEMICAL PRESERVATION CODES: 1-HCL 2-H2SO4 3-HNO3 4-NAOH 5-NA2S2O3 6-UNPRESERVED 7-OTHER															
5 TURNAROUND TIME REQUESTED (PLEASE CIRCLE) NORMAL RUSH (RUSH TAT IS SUBJECT TO PACE LABS APPROVAL AND SURCHARGE) RUSH RESULTS VIA (PLEASE CIRCLE) EMAIL PHONE EMAIL IF DIFFERENT FROM ABOVE: PHONE # IF DIFFERENT FROM ABOVE:				DATE RESULTS NEEDED				6 I understand that by initialing this box I give the lab permission to proceed with analysis, even though it may not meet all sample conformance requirements as defined in the receiving facility's Sample Acceptance Policy and the data will be qualified. Qualified data may NOT be acceptable to report to all regulatory authorities. PROCEED WITH ANALYSIS AND QUALIFY RESULTS: (INITIALS)							
7 RELINQUISHED BY: (SIGNATURE) <u>Kieran Kleinhenz</u>		DATE TIME		RECEIVED BY: (SIGNATURE) <u>[Signature]</u>		DATE TIME		8 COMMENTS: (FOR LAB USE ONLY)							
RELINQUISHED BY: (SIGNATURE) <u>[Signature]</u>		DATE TIME		RECEIVED BY: (SIGNATURE) <u>[Signature]</u>		DATE TIME		SAMPLE TEMPERATURE UPON RECEIPT <u> </u> °C CHILL PROCESS STARTED PRIOR TO RECEIPT Y OR N SAMPLE(S) RECEIVED ON ICE Y OR N SAMPLE ACCEPTANCE NONCONFORMANT REPORT IS NEEDED Y OR N DATE AND TIME TAKEN FROM SAMPLE BOTTLE							
RELINQUISHED BY: (SIGNATURE) <u>[Signature]</u>		DATE TIME		RECEIVED BY: (SIGNATURE) <u>[Signature]</u>		DATE TIME									

REGULATORY PROGRAM (CIRCLE):	NPDES
MORBCA	RCRA
CCDD	TACO: RES OR IND/COMM

ALL HIGHLIGHTED AREAS MUST BE COMPLETED BY CLIENT (PLEASE PRINT)

1 CLIENT SCI Engineering ADDRESS: 130 Point West Blvd CITY STATE ZIP: St. Charles, MO 63301 CONTACT PERSON: Brian Lieb		PROJECT NUMBER: 2016-0860.2T PHONE NUMBER: (314) 581-7570	PROJECT LOCATION: Oakville HS E-MAIL: blieb@sciengineering.com	PURCHASE ORDER # DATE SHIPPED	3 ANALYSIS REQUESTED + + DW Pb Turb Check		4 (FOR LAB USE ONLY) LOGIN # <u>HA00543</u> LOGGED BY: <u>gls</u> CLIENT: SCI Engineering PROJECT: Drinking Water Lead PROJ. MGR.: Chenise Lambert-Sykes CUSTODY SEAL #:				
2 SAMPLE DESCRIPTION (UNIQUE DESCRIPTION AS IT WILL APPEAR ON THE ANALYTICAL REPORT)		DATE COLLECTED	TIME COLLECTED	SAMPLE TYPE		MATRIX TYPE	BOTTLE COUNT	PRES CODE CLIENT PROVIDED	DW Pb	Turb Check	REMARKS
OHS-45		1/2/24	2008	X		DW	1	6	X	X	
OHS-46		1/2/24	2011	X		DW	1	6	X	X	
OHS-47		1/2/24	2012	X		DW	1	6	X	X	
OHS-48		1/2/24	2013	X		DW	1	6	X	X	
OHS-49		1/2/24	2014	X		DW	1	6	X	X	
OHS-50		1/2/24	2015	X		DW	1	6	X	X	
CHEMICAL PRESERVATION CODES:		1 - HCL	2 - H2SO4	3 - HNO3	4 - NAOH	5 - NA2S2O3	6 - UNPRESERVED	7 - OTHER			
5 TURNAROUND TIME REQUESTED (PLEASE CIRCLE) NORMAL RUSH (RUSH TAT IS SUBJECT TO PACE LABS APPROVAL AND SURCHARGE) RUSH RESULTS VIA (PLEASE CIRCLE) EMAIL PHONE EMAIL IF DIFFERENT FROM ABOVE: PHONE # IF DIFFERENT FROM ABOVE:		DATE RESULTS NEEDED		6 I understand that by initialing this box I give the lab permission to proceed with analysis, even though it may not meet all sample conformance requirements as defined in the receiving facility's Sample Acceptance Policy and the data will be qualified. Qualified data may NOT be acceptable to report to all regulatory authorities. PROCEED WITH ANALYSIS AND QUALIFY RESULTS: (INITIALS)							
7 RELINQUISHED BY: (SIGNATURE) Brian Lieb		DATE	RECEIVED BY: (SIGNATURE)		DATE	COMMENTS: (FOR LAB USE ONLY)					
		TIME			TIME						
RELINQUISHED BY: (SIGNATURE) Cheryl M		DATE 1-4-24	RECEIVED BY: (SIGNATURE)		DATE	SAMPLE TEMPERATURE UPON RECEIPT		<input type="text"/> °C			
		TIME 1000			TIME	CHILL PROCESS STARTED PRIOR TO RECEIPT		Y OR N			
RELINQUISHED BY: (SIGNATURE) Cheryl M		DATE	RECEIVED BY: (SIGNATURE)		DATE	SAMPLE(S) RECEIVED ON ICE		Y OR N			
		TIME			TIME	SAMPLE ACCEPTANCE NONCONFORMANT REPORT IS NEEDED		Y OR N			
			RECEIVED BY: (SIGNATURE) g...		DATE 1/4/24	DATE AND TIME TAKEN FROM SAMPLE BOTTLE					
					TIME 1630						

REGULATORY PROGRAM (CIRCLE):	NPDES
MORBCA	RCRA
CCDD	TACO: RES OR IND/COMM

CHAIN OF CUSTODY RECORD
STATE WHERE SAMPLE COLLECTED MO

ALL HIGHLIGHTED AREAS MUST BE COMPLETED BY CLIENT (PLEASE PRINT)

1 CLIENT SCI Engineering		PROJECT NUMBER 2016-0860.2T		PROJECT LOCATION Oakville HS		PURCHASE ORDER #		3 ANALYSIS REQUESTED				4 (FOR LAB USE ONLY)		
ADDRESS 130 Point West Blvd		PHONE NUMBER (314) 581-7570		E-MAIL blieb@sciengineering.com		DATE SHIPPED		+ +				LOGIN # <u>HA00543</u> LOGGED BY: <u>[Signature]</u> CLIENT: SCI Engineering PROJECT: <u>Drinking Water-Lead</u> PROJ. MGR.: <u>Chenise Lambert-Sykes</u> CUSTODY SEAL #: _____		
CITY STATE ZIP St. Charles, MO 63301		SAMPLER (PLEASE PRINT) Kieran Kleinhenz		MATRIX TYPES: <small> WW- WASTEWATER DW- DRINKING WATER GW- GROUND WATER WWSL- SLUDGE NAS- NON AQUEOUS SOLID LCHL- LEACHATE OIL-OIL SO-SOIL SOL-SOLID </small>		DW Pb Turb Check						REMARKS		
CONTACT PERSON Brian Lieb		SAMPLER'S SIGNATURE												
2 SAMPLE DESCRIPTION (UNIQUE DESCRIPTION AS IT WILL APPEAR ON THE ANALYTICAL REPORT)		DATE COLLECTED	TIME COLLECTED	SAMPLE TYPE GRAB COMP		MATRIX TYPE	BOTTLE COUNT	PRES CODE CLIENT PROVIDED						
OHS-23		1/2/24	1921	X		DW	1	6	X X					
OHS-24		1/2/24	1925	X		DW	1	6	X X					
OHS-25		1/2/24	1926	X		DW	1	6	X X					
OHS-26		1/2/24	1929	X		DW	1	6	X X					
OHS-27		1/2/24	1930	X		DW	1	6	X X					
OHS-28		1/2/24	1931	X		DW	1	6	X X					
OHS-29		1/2/24	1932	X		DW	1	6	X X					
OHS-30		1/2/24	1933	X		DW	1	6	X X					
OHS-31		1/2/24	1938	X		DW	1	6	X X					
OHS-32		1/2/24	1939	X		DW	1	6	X X					
OHS-33		1/2/24	1941	X		DW	1	6	X X					
CHEMICAL PRESERVATION CODES: 1-HCL 2-H2SO4 3-HNO3 4-NAOH 5-NA2S2O3 6-UNPRESERVED 7-OTHER														
5 TURNAROUND TIME REQUESTED (PLEASE CIRCLE) NORMAL RUSH (RUSH TAT IS SUBJECT TO PACE LABS APPROVAL AND SURCHARGE) RUSH RESULTS VIA (PLEASE CIRCLE) EMAIL PHONE EMAIL IF DIFFERENT FROM ABOVE: PHONE # IF DIFFERENT FROM ABOVE:					DATE RESULTS NEEDED			6 I understand that by initialing this box I give the lab permission to proceed with analysis, even though it may not meet all sample conformance requirements as defined in the receiving facility's Sample Acceptance Policy and the data will be qualified. Qualified data may NOT be acceptable to report to all regulatory authorities. PROCEED WITH ANALYSIS AND QUALIFY RESULTS: (INITIALS) _____						
7 RELINQUISHED BY: (SIGNATURE) <u>[Signature]</u>		DATE	RECEIVED BY: (SIGNATURE) <u>[Signature]</u>				DATE	8 COMMENTS: (FOR LAB USE ONLY)						
		TIME					TIME							
RELINQUISHED BY: (SIGNATURE) <u>[Signature]</u>		DATE	RECEIVED BY: (SIGNATURE) <u>[Signature]</u>				DATE	SAMPLE TEMPERATURE UPON RECEIPT _____ °C						
		TIME					TIME	CHILL PROCESS STARTED PRIOR TO RECEIPT Y OR N SAMPLE(S) RECEIVED ON ICE Y OR N SAMPLE ACCEPTANCE NONCONFORMANT REPORT IS NEEDED Y OR N						
RELINQUISHED BY: (SIGNATURE) <u>[Signature]</u>		DATE	RECEIVED BY: (SIGNATURE) <u>[Signature]</u>				DATE	DATE AND TIME TAKEN FROM SAMPLE BOTTLE _____						
		TIME					TIME							

REGULATORY PROGRAM (CIRCLE):	NPDES
MORBCA	RCRA
CCDD	TACO: RES OR IND/COMM

CHAIN OF CUSTODY RECORD
 STATE WHERE SAMPLE COLLECTED MO

ALL HIGHLIGHTED AREAS MUST BE COMPLETED BY CLIENT (PLEASE PRINT)

1 CLIENT SCI Engineering ADDRESS: 130 Point West Blvd CITY STATE ZIP: St. Charles, MO 63301 CONTACT PERSON: Brian Lieb		PROJECT NUMBER: 2016-0860.2T PHONE NUMBER: (314) 581-7570		PROJECT LOCATION: Oakville HS E-MAIL: blieb@sciengineering.com		PURCHASE ORDER #		3 ANALYSIS REQUESTED + DW Pb + Turb Check		4 (FOR LAB USE ONLY) LOGIN #: HA00543 LOGGED BY: <i>ges</i> CLIENT: SCI Engineering PROJECT: Drinking Water Lead PROJ. MGR.: Chenise Lambert-Sykes CUSTODY SEAL #:	
2 SAMPLE DESCRIPTION (UNIQUE DESCRIPTION AS IT WILL APPEAR ON THE ANALYTICAL REPORT)		DATE COLLECTED	TIME COLLECTED	SAMPLE TYPE GRAB	COMP	MATRIX TYPE	BOTTLE COUNT	PRES CODE CLIENT PROVIDED	DW Pb	Turb Check	REMARKS
OHS-1		1/2/24	1840	X		DW	1	6	X	X	
OHS-2		1/2/24	1842	X		DW	1	6	X	X	
OHS-3		1/2/24	1846	X		DW	1	6	X	X	
OHS-4		1/2/24	1847	X		DW	1	6	X	X	
OHS-5		1/2/24	1848	X		DW	1	6	X	X	
OHS-6		1/2/24	1850	X		DW	1	6	X	X	
OHS-7		1/2/24	1851	X		DW	1	6	X	X	
OHS-8		1/2/24	1852	X		DW	1	6	X	X	
OHS-9		1/2/24	1856	X		DW	1	6	X	X	
OHS-10		1/2/24	1857	X		DW	1	6	X	X	
OHS-11		1/2/24	1859	X		DW	1	6	X	X	
CHEMICAL PRESERVATION CODES: 1 - HCL 2 - H2SO4 3 - HNO3 4 - NAOH 5 - NA2S2O3 6 - UNPRESERVED 7 - OTHER											
5 TURNAROUND TIME REQUESTED (PLEASE CIRCLE) NORMAL RUSH (RUSH TAT IS SUBJECT TO PACE LABS APPROVAL AND SURCHARGE) RUSH RESULTS VIA (PLEASE CIRCLE) EMAIL PHONE EMAIL IF DIFFERENT FROM ABOVE: PHONE # IF DIFFERENT FROM ABOVE:						DATE RESULTS NEEDED		6 I understand that by initialing this box I give the lab permission to proceed with analysis, even though it may not meet all sample conformance requirements as defined in the receiving facility's Sample Acceptance Policy and the data will be qualified. Qualified data may NOT be acceptable to report to all regulatory authorities. PROCEED WITH ANALYSIS AND QUALIFY RESULTS: (INITIALS)			
7 RELINQUISHED BY: (SIGNATURE) <i>Kieran Kleinhenz</i>		DATE	RECEIVED BY: (SIGNATURE)		DATE	COMMENTS: (FOR LAB USE ONLY)					
		TIME			TIME						
RELINQUISHED BY: (SIGNATURE) <i>Kieran Kleinhenz</i>		DATE 1-4-24	RECEIVED BY: (SIGNATURE)		DATE	SAMPLE TEMPERATURE UPON RECEIPT		<input type="text"/> °C			
		TIME 1600			TIME	CHILL PROCESS STARTED PRIOR TO RECEIPT		Y OR N			
RELINQUISHED BY: (SIGNATURE) <i>Kieran Kleinhenz</i>		DATE	RECEIVED BY: (SIGNATURE)		DATE 1/4/24	SAMPLE(S) RECEIVED ON ICE		Y OR N			
		TIME			TIME 1630	SAMPLE ACCEPTANCE NONCONFORMANT REPORT IS NEEDED		Y OR N			
						DATE AND TIME TAKEN FROM SAMPLE BOTTLE					

courier

REGULATORY PROGRAM (CIRCLE):	NPDES
MORBCA	RCRA
CCDD	TACO: RES OR IND/COMM

CHAIN OF CUSTODY RECORD
STATE WHERE SAMPLE COLLECTED MO

ALL HIGHLIGHTED AREAS MUST BE COMPLETED BY CLIENT (PLEASE PRINT)

1 CLIENT SCI Engineering		PROJECT NUMBER 2016-0860.2T		PROJECT LOCATION Oakville HS		PURCHASE ORDER #		3 ANALYSIS REQUESTED				4 (FOR LAB USE ONLY) LOGIN # <u>HA00513</u> LOGGED BY: <u>[Signature]</u> CLIENT: SCI Engineering PROJECT: Drinking Water Lead PROJ. MGR.: Chenise Lambert-Sykes CUSTODY SEAL #: _____	
ADDRESS 130 Point West Blvd		PHONE NUMBER (314) 581-7570		E-MAIL blieb@sciengineering.com		DATE SHIPPED		<input checked="" type="checkbox"/> DW Pb <input checked="" type="checkbox"/> Turb Check				REMARKS	
CITY STATE ZIP St. Charles, MO 63301		SAMPLER (PLEASE PRINT) Kieran Kleinhenz		MATRIX TYPES: WW- WASTEWATER DW- DRINKING WATER GW- GROUND WATER WWML- SLUDGE NAS- NON AQUEOUS SOLID LCHT- LEACHATE OIL- OIL SO- SOIL SOL- SOLID		SAMPLER'S SIGNATURE							
CONTACT PERSON Brian Lieb		SAMPLER'S SIGNATURE		SAMPLE TYPE <input type="checkbox"/> GRAB <input type="checkbox"/> COMP		MATRIX TYPE		BOTTLE COUNT		PRES CODE CLIENT PROVIDED			
2 SAMPLE DESCRIPTION (UNIQUE DESCRIPTION AS IT WILL APPEAR ON THE ANALYTICAL REPORT)		DATE COLLECTED	TIME COLLECTED	<input checked="" type="checkbox"/>	<input type="checkbox"/>	MATRIX TYPE	BOTTLE COUNT	PRES CODE CLIENT PROVIDED	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>			
OHS-12		1/2/24	1900	<input checked="" type="checkbox"/>	<input type="checkbox"/>	DW	1	6	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>			
OHS-13		1/2/24	1904	<input checked="" type="checkbox"/>	<input type="checkbox"/>	DW	1	6	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>			
OHS-14		1/2/24	1905	<input checked="" type="checkbox"/>	<input type="checkbox"/>	DW	1	6	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>			
OHS-15		1/2/24	1908	<input checked="" type="checkbox"/>	<input type="checkbox"/>	DW	1	6	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>			
OHS-16		1/2/24	1909	<input checked="" type="checkbox"/>	<input type="checkbox"/>	DW	1	6	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>			
OHS-17		1/2/24	1911	<input checked="" type="checkbox"/>	<input type="checkbox"/>	DW	1	6	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>			
OHS-18		1/2/24	1914	<input checked="" type="checkbox"/>	<input type="checkbox"/>	DW	1	6	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>			
OHS-19		1/2/24	1915	<input checked="" type="checkbox"/>	<input type="checkbox"/>	DW	1	6	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>			
OHS-20		1/2/24	1917	<input checked="" type="checkbox"/>	<input type="checkbox"/>	DW	1	6	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>			
OHS-21		1/2/24	1919	<input checked="" type="checkbox"/>	<input type="checkbox"/>	DW	1	6	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>			
OHS-22		1/2/24	1920	<input checked="" type="checkbox"/>	<input type="checkbox"/>	DW	1	6	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>			
CHEMICAL PRESERVATION CODES: 1 - HCL 2 - H2SO4 3 - HNO3 4 - NAOH 5 - NA2S2O3 6 - UNPRESERVED 7 - OTHER													
5 TURNAROUND TIME REQUESTED (PLEASE CIRCLE) NORMAL RUSH (RUSH TAT IS SUBJECT TO PACE LABS APPROVAL AND SURCHARGE) RUSH RESULTS VIA (PLEASE CIRCLE) EMAIL PHONE				DATE RESULTS NEEDED		6 I understand that by initialing this box I give the lab permission to proceed with analysis, even though it may not meet all sample conformance requirements as defined in the receiving facility's Sample Acceptance Policy and the data will be qualified. Qualified data may NOT be acceptable to report to all regulatory authorities.							
EMAIL IF DIFFERENT FROM ABOVE: _____ PHONE # IF DIFFERENT FROM ABOVE: _____						PROCEED WITH ANALYSIS AND QUALIFY RESULTS: (INITIALS) _____							
7 RELINQUISHED BY: (SIGNATURE) <u>[Signature]</u>		DATE	RECEIVED BY: (SIGNATURE) <u>[Signature]</u>			DATE <u>1-4-24</u>		8 COMMENTS: (FOR LAB USE ONLY)					
		TIME				TIME <u>1045</u>							
RELINQUISHED BY: (SIGNATURE) <u>[Signature]</u>		DATE <u>1-4-24</u>	RECEIVED BY: (SIGNATURE) <u>[Signature]</u>			DATE		SAMPLE TEMPERATURE UPON RECEIPT _____ °C					
		TIME <u>1600</u>				TIME		CHILL PROCESS STARTED PRIOR TO RECEIPT Y OR N <u>Y</u> SAMPLE(S) RECEIVED ON ICE Y OR N <u>Y</u> SAMPLE ACCEPTANCE NONCONFORMANT REPORT IS NEEDED Y OR N <u>Y</u>					
RELINQUISHED BY: (SIGNATURE) <u>[Signature]</u>		DATE	RECEIVED BY: (SIGNATURE) <u>[Signature]</u>			DATE <u>1/4/24</u>		DATE AND TIME TAKEN FROM SAMPLE BOTTLE _____					
		TIME				TIME <u>1630</u>							

REGULATORY PROGRAM (CIRCLE):	NPDES
MORBCA	RCRA
CCDD	TACO: RES OR IND/COMM

CHAIN OF CUSTODY RECORD
 STATE WHERE SAMPLE COLLECTED MO

ALL HIGHLIGHTED AREAS MUST BE COMPLETED BY CLIENT (PLEASE PRINT)

1 CLIENT SCI Engineering ADDRESS: 130 Point West Blvd CITY STATE ZIP: St. Charles, MO 63301 CONTACT PERSON: Brian Lieb		PROJECT NUMBER: 2016-0860.2T PHONE NUMBER: (314) 581-7570	PROJECT LOCATION: Oakville HS E-MAIL: blieb@sciengineering.com	PURCHASE ORDER # DATE SHIPPED	3 ANALYSIS REQUESTED + + DW Pb Turb Check		4 (FOR LAB USE ONLY) LOGIN #: HA00543 LOGGED BY: [Signature] CLIENT: SCI Engineering PROJECT: Drinking Water-Lead PROJ. MGR.: Chenise Lambert-Sykes CUSTODY SEAL #:			
2 SAMPLE DESCRIPTION (UNIQUE DESCRIPTION AS IT WILL APPEAR ON THE ANALYTICAL REPORT)		DATE COLLECTED	TIME COLLECTED	SAMPLE TYPE GRAB COMP	MATRIX TYPE	BOTTLE COUNT	PRES CODE CLIENT PROVIDED	DW Pb	Turb Check	REMARKS
OHS-23		1/2/24	1921	X	DW	1	6	X	X	
OHS-24		1/2/24	1925	X	DW	1	6	X	X	
OHS-25		1/2/24	1926	X	DW	1	6	X	X	
OHS-26		1/2/24	1929	X	DW	1	6	X	X	
OHS-27		1/2/24	1930	X	DW	1	6	X	X	
OHS-28		1/2/24	1931	X	DW	1	6	X	X	
OHS-29		1/2/24	1932	X	DW	1	6	X	X	
OHS-30		1/2/24	1933	X	DW	1	6	X	X	
OHS-31		1/2/24	1938	X	DW	1	6	X	X	
OHS-32		1/2/24	1939	X	DW	1	6	X	X	
OHS-33		1/2/24	1941	X	DW	1	6	X	X	
CHEMICAL PRESERVATION CODES: 1-HCL 2-H2SO4 3-HNO3 4-NAOH 5-NA2S2O3 6-UNPRESERVED 7-OTHER										
5 TURNAROUND TIME REQUESTED (PLEASE CIRCLE) NORMAL RUSH (RUSH TAT IS SUBJECT TO PACE LABS APPROVAL AND SURCHARGE) RUSH RESULTS VIA (PLEASE CIRCLE) EMAIL PHONE EMAIL IF DIFFERENT FROM ABOVE: PHONE # IF DIFFERENT FROM ABOVE:				DATE RESULTS NEEDED		6 I understand that by initialing this box I give the lab permission to proceed with analysis, even though it may not meet all sample conformance requirements as defined in the receiving facility's Sample Acceptance Policy and the data will be qualified. Qualified data may NOT be acceptable to report to all regulatory authorities. PROCEED WITH ANALYSIS AND QUALIFY RESULTS: (INITIALS)				
7 RELINQUISHED BY: (SIGNATURE) [Signature]		DATE	RECEIVED BY: (SIGNATURE)			DATE	8 COMMENTS: (FOR LAB USE ONLY)			
RELINQUISHED BY: (SIGNATURE)		TIME	[Signature]			TIME	SAMPLE TEMPERATURE UPON RECEIPT [] °C			
RELINQUISHED BY: (SIGNATURE)		DATE	RECEIVED BY: (SIGNATURE)			DATE	CHILL PROCESS STARTED PRIOR TO RECEIPT Y OR N SAMPLE(S) RECEIVED ON ICE Y OR N SAMPLE ACCEPTANCE NONCONFORMANT REPORT IS NEEDED Y OR N			
RELINQUISHED BY: (SIGNATURE)		TIME	[Signature]			TIME	DATE AND TIME TAKEN FROM SAMPLE BOTTLE			

REGULATORY PROGRAM (CIRCLE):	NPDES
MORBCA	RCRA
CCDD	TACO: RES OR IND/COMM

CHAIN OF CUSTODY RECORD
 STATE WHERE SAMPLE COLLECTED MO

ALL HIGHLIGHTED AREAS MUST BE COMPLETED BY CLIENT (PLEASE PRINT)

1 CLIENT SCI Engineering		PROJECT NUMBER 2016-0860.2T		PROJECT LOCATION Oakville HS		PURCHASE ORDER #		3 ANALYSIS REQUESTED				4 (FOR LAB USE ONLY) LOGIN # <u>HA00543</u> LOGGED BY: <u>[Signature]</u> CLIENT: SCI Engineering PROJECT: Drinking Water Lead PROJ. MGR.: Chenise Lambert-Sykes CUSTODY SEAL #:		
ADDRESS 130 Point West Blvd		PHONE NUMBER (314) 581-7570		E-MAIL blieb@sciengineering.com		DATE SHIPPED		<input checked="" type="checkbox"/> DW Pb <input checked="" type="checkbox"/> Turb Check				REMARKS		
CITY STATE ZIP St. Charles, MO 63301		SAMPLER (PLEASE PRINT) Kieran Kleinhenz		SAMPLER'S SIGNATURE		MATRIX TYPES: WW- WASTEWATER DW- DRINKING WATER GW- GROUND WATER WWSL- SLUDGE NAS- NON AQUEOUS SOLID LCHT-LEACHATE OIL-OIL SO-SOIL SOL-SOLID								
CONTACT PERSON Brian Lieb		SAMPLER'S SIGNATURE												
2 SAMPLE DESCRIPTION (UNIQUE DESCRIPTION AS IT WILL APPEAR ON THE ANALYTICAL REPORT)		DATE COLLECTED	TIME COLLECTED	SAMPLE TYPE GRAB COMP		MATRIX TYPE	BOTTLE COUNT	PRES CODE CLIENT PROVIDED						
OHS-34		1/2/24	1941	X		DW	1	6	X X					
OHS-35		1/2/24	1942	X		DW	1	6	X X					
OHS-36		1/2/24	1945	X		DW	1	6	X X					
OHS-37		1/2/24	1952	X		DW	1	6	X X					
OHS-38		1/2/24	1953	X		DW	1	6	X X					
OHS-39		1/2/24	1957	X		DW	1	6	X X					
OHS-40		1/2/24	1958	X		DW	1	6	X X					
OHS-41		1/2/24	2000	X		DW	1	6	X X					
OHS-42		1/2/24	2001	X		DW	1	6	X X					
OHS-43		1/2/24	2003	X		DW	1	6	X X					
OHS-44		1/2/24	2004	X		DW	1	6	X X					
CHEMICAL PRESERVATION CODES: 1 - HCL 2 - H2SO4 3 - HNO3 4 - NAOH 5 - NA2S2O3 6 - UNPRESERVED 7 - OTHER														
5 TURNAROUND TIME REQUESTED (PLEASE CIRCLE) NORMAL RUSH RUSH RESULTS VIA (PLEASE CIRCLE) EMAIL PHONE EMAIL IF DIFFERENT FROM ABOVE: PHONE # IF DIFFERENT FROM ABOVE:		DATE RESULTS NEEDED		6 I understand that by initialing this box I give the lab permission to proceed with analysis, even though it may not meet all sample conformance requirements as defined in the receiving facility's Sample Acceptance Policy and the data will be qualified. Qualified data may NOT be acceptable to report to all regulatory authorities. PROCEED WITH ANALYSIS AND QUALIFY RESULTS: (INITIALS) _____										
7 RELINQUISHED BY: (SIGNATURE) <u>Kieran Kleinhenz</u>		DATE TIME		RECEIVED BY: (SIGNATURE) <u>[Signature]</u>		DATE TIME		8 COMMENTS: (FOR LAB USE ONLY)						
RELINQUISHED BY: (SIGNATURE) <u>[Signature]</u>		DATE TIME		RECEIVED BY: (SIGNATURE) <u>[Signature]</u>		DATE TIME		SAMPLE TEMPERATURE UPON RECEIPT _____ °C CHILL PROCESS STARTED PRIOR TO RECEIPT Y OR N SAMPLE(S) RECEIVED ON ICE Y OR N SAMPLE ACCEPTANCE NONCONFORMANT REPORT IS NEEDED Y OR N DATE AND TIME TAKEN FROM SAMPLE BOTTLE _____						
RELINQUISHED BY: (SIGNATURE) <u>[Signature]</u>		DATE TIME		RECEIVED BY: (SIGNATURE) <u>[Signature]</u>		DATE TIME								

REGULATORY PROGRAM (CIRCLE):	NPDES
MORBCA	RCRA
CCDD	TACO: RES OR IND/COMM

ALL HIGHLIGHTED AREAS MUST BE COMPLETED BY CLIENT (PLEASE PRINT)

1 CLIENT SCI Engineering	PROJECT NUMBER 2016-0860.2T	PROJECT LOCATION Oakville HS	PURCHASE ORDER #	3 ANALYSIS REQUESTED	4 (FOR LAB USE ONLY)
ADDRESS 130 Point West Blvd	PHONE NUMBER (314) 581-7570	E-MAIL blieb@sciengineering.com	DATE SHIPPED	<input checked="" type="checkbox"/> DW Pb	LOGIN # <u>H100543</u>
CITY STATE ZIP St. Charles, MO 63301	SAMPLER (PLEASE PRINT) Kieran Kleinhenz	MATRIX TYPES: <small>DW- WASTEWATER DW- DRINKING WATER GW- GROUND WATER WWSL- SLUDGE NAS- NON AQUEOUS SOLID LCHT- LEACHATE OIL-OIL SO-SOIL SOL-SOLID</small>		<input checked="" type="checkbox"/> Turb Check	LOGGED BY: <u>gls</u>
CONTACT PERSON Brian Lieb	SAMPLER'S SIGNATURE				CLIENT: SCI Engineering
					PROJECT: Drinking Water Lead
					PROJ. MGR.: Chenise Lambert-Sykes
					CUSTODY SEAL #:

2 SAMPLE DESCRIPTION (UNIQUE DESCRIPTION AS IT WILL APPEAR ON THE ANALYTICAL REPORT)	DATE COLLECTED	TIME COLLECTED	SAMPLE TYPE		MATRIX TYPE	BOTTLE COUNT	PRES CODE CLIENT PROVIDED	DW Pb	Turb Check	REMARKS
			GRAB	COMP						
OHS-45	1/2/24	2008	X		DW	1	6	X	X	
OHS-46	1/2/24	2011	X		DW	1	6	X	X	
OHS-47	1/2/24	2012	X		DW	1	6	X	X	
OHS-48	1/2/24	2013	X		DW	1	6	X	X	
OHS-49	1/2/24	2014	X		DW	1	6	X	X	
OHS-50	1/2/24	2015	X		DW	1	6	X	X	

CHEMICAL PRESERVATION CODES:	1 - HCL	2 - H2SO4	3 - HNO3	4 - NAOH	5 - NA2S2O3	6 - UNPRESERVED	7 - OTHER
5 TURNAROUND TIME REQUESTED (PLEASE CIRCLE) NORMAL RUSH (RUSH TAT IS SUBJECT TO PACE LABS APPROVAL AND SURCHARGE)	DATE RESULTS NEEDED		6 I understand that by initialing this box I give the lab permission to proceed with analysis, even though it may not meet all sample conformance requirements as defined in the receiving facility's Sample Acceptance Policy and the data will be qualified. Qualified data may NOT be acceptable to report to all regulatory authorities.				
RUSH RESULTS VIA (PLEASE CIRCLE) EMAIL PHONE	PROCEED WITH ANALYSIS AND QUALIFY RESULTS: (INITIALS)						
EMAIL IF DIFFERENT FROM ABOVE: PHONE # IF DIFFERENT FROM ABOVE:							

7 RELINQUISHED BY: (SIGNATURE) <u>Kim Kiehn</u>	DATE 1-4-24	RECEIVED BY: (SIGNATURE) <u>Clayton M</u>	DATE 1-4-24	8 COMMENTS: (FOR LAB USE ONLY)
RELINQUISHED BY: (SIGNATURE) <u>Clayton M</u>	TIME 10:00	RECEIVED BY: (SIGNATURE)	TIME 1045	SAMPLE TEMPERATURE UPON RECEIPT <input type="text"/> °C
RELINQUISHED BY: (SIGNATURE)	DATE	RECEIVED BY: (SIGNATURE)	DATE 1/4/24	CHILL PROCESS STARTED PRIOR TO RECEIPT Y OR N
	TIME		TIME 1630	SAMPLE(S) RECEIVED ON ICE Y OR N
				SAMPLE ACCEPTANCE NONCONFORMANT REPORT IS NEEDED Y OR N
				DATE AND TIME TAKEN FROM SAMPLE BOTTLE